MIL-C-52286C(ME)
28 April 1980
SUPERSEDING
MIL-C-52286B(ME)
4 May 1970

MILITARY SPECIFICATION

CABLE ASSEMBLIES, POWER, ELECTRICAL

(WITH MOLDED ON TERMINATIONS)

This specification is approved for use by the Mobility Equipment Research and Development Command, Department of the Army, and is available for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers cable assemblies with one or more molded-rubber terminals for interior and exterior power and lighting.

2. APPLICABLE DOCUMENTS

2.1 Issues of documents. The following documents of the issue in effect on date of invitation for bids or request for proposal form a part of this specification to the extent specified herein:

SPECIFICATIONS

FEDERAL

T-T-881	- Twine, Cotton, Seine.
W-L-142	- Lampholder, Adapter, and Shadeholder, Medium-Screw-Shell, 125, 250, and 600 Volts.

☆U.S. GOVERNMENT PRINTING OFFICE: 1980—603-121/2241

FSC 6150

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: US Army Mobility Equipment Research and Development Command, ATTN: DRDME-DS, Fort Belvoir, VA 22060 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

QQ-A-601	- Aluminum Alloy Sand Castings.
QQ-S-781	- Strapping, Steel and Seals.
QQ-Z-325	- Zinc Coating, Electrodeposited, Requirement for. Weldless, and Roller Chain.
RR-C-271	- Chains and Attachments, Welded, Weldness and Roller Chain.
MMM-A-260	- Adhesive, Water-Resistant, (for Sealing Waterproofed Paper).
PPP-B-601	- Boxes, Wood, Cleated-Plywood.
PPP-B-636	- Box, Fiberboard.
PPP-B-1055	- Barrier Material, Waterproofed, Flexible.

MILITARY

MIL-T-704	- Treatment and Painting of Materiel.
MIL-C-3432	- Cable and Wire, Electrical (Power and Control; Semi-Flexible and Extra Flexible, 300 and 600 Volts).
MIL-I-3930	- Insulating and Jacketing Compounds, Electrical (for Cables, Cords, and Wires).
MIL-S-6872	- Soldering Process, General Specification for.
MIL-T-7928	- Terminals, Lug: Splices, Conductor: Crimp Style, Copper, General Specification for.
MIL-T-15659	- Terminal, Lug: Solder, Copper and Phosphor Bronze.
MIL-I-24391	- Insulation Tape, Electrical, Plastic, Pressure Sensitive.

STANDARDS

FEDERAL

FED-STD-601	- Rubber: Sampling and Testing

MILITARY

MIL-STD-105	- Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-108	- Definitions of and Basic Requirements for Enlosures for Electrical and Electronic Equipment.
MIL-STD-129	- Marking for Shipment and Storage.
MIL-STD-130	- Indentification Marking of U.S. Military Property.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

MIL-STD-1186	- Cushioning, Anchoring, Bracing, Blocking and Waterproofing; with Appropriate Test Methods.
MIL-STD-1188	- Commercial Packaging of Supplies and Equipment.

(Copies of specifications and stanadard required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

3. REQUIREMENTS

3.1 Description. Cable assemblies shall consist of cables, connectors, dummy connectors, adapters, and terminal lugs and shall be as shown on figures 1 through 44 and applicable specification sheets. Dimensions and tolerances are shown where required. Where tolerances are not shown or where those prescribed could result in incorrect fits, the contractor is responsible for providing tolerances to insure correct fit, assembly, and operation of each assembly. No deviation from dimensions or tolerances shown on the figures is permissible without prior approval of the contracting officer.

3.2 First articles.

3.2.1 Preproduction model. The contractor shall furnish two cable assemblies of each type supplied for examination and test within the time frame specified (see 6.2). to prove prior to starting production that his production methods and choice of design detail will produce cable assemblies that comply with the requirements of this specification. Examination and tests shall be as specified in section 4; and, unless otherwise specified herein, all examinations and tests shall be conducted by the contractor subject to surveillance and approval by the Government (see 6.3). When specified (see 6.2), the Government will conduct any or all of the preproduction examination and tests as specified (see 6.2).

3.3 Operation. Each cable assembly, when connected to a source of power and carrying rated current, shall not overheat or show signs of arcing. The connectors or terminals shall show no signs of electrical or mechanical malfunction or damage when connected or disconnected.

3.4 Cable. The cable shall be of the low-temperature, heat-resistant kind, conforming to MIL-C-3432 and shall be of the type and length specified on the applicable specification sheet.

3.5 Molded connectors (plugs, receptacles, inserts, adapters, and dummy connectors. Material used for insulation and jacketing shall be the same as the cable to which the connectors are to be vulcanized and shall have a shore durometer "A" hardness of 60 plus or minus 10. The insulation shall fully enclose the base of the pins and sockets. The jacket shall be molded integrally to the insulation. The connector shall be vulcanized to the cable and shall form a watertight seal as defined in MIL-STD-108.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

3.6 Metal connector with molded insert.

3.6.1 Shell and Cover. Connector shells and covers for molded inserts shall be of cast aluminum conforming to QQ-A-601, alloy 356, temper T6. Pins and nuts used to secure the covers shall be of carbon steel.

3.6.2 Removability of inserts. All molded inserts for connectors shall be removable. Provisions shall be made to position inserts to prevent rotation with respect to the shell.

3.7 Dummy Connectors. Dummy connectors shall be molded from insulation material conforming to MIL-I-3930 and as specified on the applicable figure. Dummy connectors shall prevent the entrance of moisture, dirt, or other foreign material into the specified plug.

3.7.1 Attaching means. Dummies shall be attached to the cable by either a length of cotton twine or a brass chain as specified on the applicable specification sheet.

3.7.1.1 Cotton twine. Cotton twine shall conform to T-T-881, No. 18, and shall be attached to the dummy and cable assembly by means of a durable knot which will not slip when pulled.

3.7.1.2 Chain. Chain shall conform to RR-C-271, type II, class 6 (safety chain); nominal metal thickness 0.023 inch; approximately 24 links per foot; and minimum tensile strength of 110 pounds.

3.8 Connector adapters. Connector adapters shall consist of plugs and receptacles molded together to form a single piece. The material used for insulation shall be IS-L and jacketing shall be JS-L in accordance with MIL-I-3930. The insulation shall fully enclose the base of the pins and sockets. The jacket shall be molded integrally to the insulation. Three-way adapters shall be furnished with two dummy connectors; five-way adapters shall be furnished with four dummy connectors.

3.9 Caps. A watertight cap shall be placed on each single-conductor plug and each single-conductor receptacle for protection during shipment and installation. The cap shall consist of a rubber plug or receptacle made of jacket material conforming to MIL-I-3930 and shall be designed to protect the mating surfaces of the connector from moisture and dirt. Tape shall be wrapped over the joining seam to hold the cap securely in place and to give additional protection from moisture and dirt. The tape shall conform to MIL-I-24391 and shall be 0.007 inch thick and 0.75 inch wide. The cap shall not damage or deform the connector in any way.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

3.10 Pins and sockets. Pins and sockets of the molded connectors, inserts, and adapters shall be centered, anchored, and molded perpendicular to the face of the component so that they will not loosen by repeated connection and disconnection with other electrical connectors. There shall be no intrusion of insulation or foreign material into the socket. Contact dimensions shall be as specified in table I. The illustrations shown on figure 1 are for dimensional purposes only and are not intended to indicate the design. Applicable type numbers of contacts shall be as specified on the applicable figure.

3.10.1 Pins. The entering end of the pin shall be hemispherical with a radius of approximately one-half of the pin diameter.

3.10.2 Sockets. The receiving end of the socket shall be rounded or chamfered for directing and centering the entering pin. Sockets shall have three slots 0.02 inch maximum width and approximately 120 degrees apart and shall have circumferential-type retaining springs for maintaining positive electrical contact between pin and socket. Sockets shall have an external metallic retaining sleeve or band to prevent distortion of the socket.

3.10.3 Wire Connections. Each conductor shall be mechanically and electrically bonded to the pin or socket. Each shall be closed at the end connected to the conductor to prevent moisture from entering the cable.

3.10.3.1 Strain relief. The conductors within the connector shall be arranged with adequate slack to prevent the conductors from breaking, or separating from pins or sockets, when subjected to jerks or pulls on the cable.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

TABLE I. Contact dimensions.

Type	A	B	C	D
	(inch)	(inch)	(inch)	(inch)
I	0.656 max.	0.156 max.	0.703 max.	0.158 max.
	0.594 min.	0.154 min.	0.641 min.	0.156 min.
IIS	1.109 max.	0.187 max.	1.172 max.	0.189 max.
	1.031 min.	0.185 min.	1.094 min.	0.187 min.
IIP	1.109 max.	0.250 max.	1.172 max.	0.252 max.
	1.031 min.	0.248 min.	1.094 min.	0.250 min.
IIS	1.250 max.	0.312 max.	1.312 max.	0.314 max.
	1.125 min.	0.310 min.	1.188 min.	0.312 min.
IIP	1.250 max.	0.375 max.	1.312 max.	0.377 max.
	1.125 min.	0.373 min.	1.188 min.	0.375 min.
VS	1.641 max.	0.375 max.	1.750 max.	0.377 max.
	1.562 min.	0.486 min.	1.625 min.	0.375 min.
VP	1.641 max.	0.438 max.	1.750 max.	0.440 max.
	1.562 min.	0.436 min.	1.625 min.	0.438 min.
V	1.077 max.	0.187 max.	1.125 max.	0.189 max.
	1.015 min.	0.185 min.	1.062 min.	0.187 min.
VIS	0.828 max.	0.156 max.	0.891 max.	0.158 max.
	0.750 min.	0.154 min.	0.859 min.	0.156 min.
VIP	0.828 max.	0.218 max.	0.891 max.	0.220 max.
	0.750 min.	0.216 min.	0.859 min.	0.218 min.
VIIS	0.515 max.	0.125 max.	0.562 max.	0.127 max.
	0.453 min.	0.123 min.	0.500 min.	0.125 min.
VIIP	0.515 max.	0.156 max.	0.562 max.	0.158 max.
	0.453 min.	0.154 min.	0.500 min.	0.156 min.
VIIIS	0.490 max.	0.125 max.	.....	.....
	0.360 min.	0.123 min.	.....	.....
VIIIP	0.490 max.	0.156 max.	.....	.....
	0.360 min.	0.154 min.	.....	.....
X	1.703 max.	0.312 max.	1.781 max.	0.314 max.
	1.601 min.	0.310 min.	1.703 min.	0.312 min.
XS	0.640 max.	0.125 max.	0.703 max.	0.127 max.
	0.610 min.	0.123 min.	0.641 min.	0.125 min.
XP	0.640 max.	0.156 max.	0.703 max.	0.158 max.
	0.610 min.	0.154 min.	0.641 min.	0.156 min.
XI	2.250 max.	0.625 max.	2.312 max.	0.627 max.
	2.187 min.	0.623 min.	2.250 min.	0.625 min.

3.11 Bond between connectors and cables. The bond between a connector or insert and a cable shall withstand the pull specified on the applicable specification sheet for 1 minute without mechanical or electrical damage.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

3.12 Degree of closure. Molded connectors, adapters, inserts, caps, and dummy connectors when mated with applicable mating components shall provide a watertight joint as defined in MIL-STD-108.

3.13 Connect and disconnect force. Connect and disconnect force of the connectors shall be as shown on the applicable figure and connectors shall be constructed to withstand 500 repeated connections and disconnections without damage.

3.14 Voltage drop. The voltage drop across the terminals of mating contacts shall not exceed the maximum specified on the applicable figure.

3.15 Dielectric strength. Molded components shall withstand 5 times their rated voltage for 1 minute without damage, arcing or breakdown.

3.16 Cable hangers. Cable hangers for cable assemblies and extension lights shall be molded of the same jacket material as the cable and shall be securely vulcanized to the cable jacket.

3.17 Lampholders. Lampholders shall conform to W-L-142, type III M, class C body, style 2 cap, with either a brass or steel shell. A continuous circular bead or shoulder shall be provided directly above the shadeholder thread for use as a stop for the shadeholder.

3.18 Terminal lugs. Solder type terminal lugs shall conform to MIL-T-15659; solderless terminal lugs shall conform to MIL-T-7928. Solder type terminal lugs, when used, shall be soldered to the wire in accordance with MIL-S-6872.

3.19 Bolts, washers and nuts. The bolts, washers, and nuts shall be carbon steel, zinc plated in accordance with QQ-Z-325, class 2, type II.

3.20 Temperature and humidity. The cable assembly shall not be damaged by operation, carrying rated voltage and current, or storage at ambient temperatures of plus 125 degree F. and minus 65 degree F., and at maximum humidity possible at these temperatures.

3.21 Treatment and painting. Finish or metal parts not otherwise specified on the figures shall be treated and painted in accordance with MIL-T-704, type A, except that surface blasting of steel surfaces shall not be required. Carbon steel shall be zinc plated in accordance with QQ-Z-325, class 2 type 1, prior to treatment and painting.

3.22 Identification. In addition to any marking specified in the applicable figure, the cable assemblies shall be permanently and legibly marked in accordance with MIL-STD-130 and shall include date of manufacture. On cable assemblies, the marking shall be applied at each end. Marking shall be in the

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

form of a durable band which shall encircle and adhere to the cable. Marking shall be clear and fused into the backing. Both the band and its marking shall show no indication of cracking upon repeated flexing of the cable and shall be resistant to moisture and oil.

3.23 Workmanship. The cable assemblies shall be free from defects such as molding flaws, tear through connector skirt or cork, split seam at joint between cable and connector, connectors not properly mating, or other defects that would impair use of the assembly.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract, the contractor is responsible for the performance of all inspection requirements specified herein. Except as otherwise specified in the contract, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the government. The government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.2 Classification of inspection. Inspection shall be classified as follows:

(a) Preproduction inspection (see 4.3).
(b) Quality conformance inspection (see 4.4).
(c) Inspection of packaging (see 4.7).

4.3 Preproduction inspection.

4.3.1 Examination. Each preproduction cable assembly shall be examined in accordance with table II. Presence of one or more defects in either preproduction cable assembly shall be cause for rejection of both assemblies.

4.3.2 Tests. Following successful completion of the examination, the preproduction cable assemblies shall be tested as indicated in table III. Tests shall be conducted in the order listed. Any test result not meeting the applicable requirement paragraph shall constitute failure of the test and shall be cause for rejection of the preproduction cable assemblies.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for test shall be in accordance with MIL-STD105, inspection level S-2 for lots of two to 65 shall be used. For lots of 66 and larger, inspection level S-3 shall be used.

4.4.2 Examination.

4.4.2.1 Individual. Each production cable assembly shall be examined in accordance with table II. Presence of one or more defects shall be cause for rejection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

TABLE II. Examination.

Cable assy.	Adapter	Dummy conn.	Characteristics	Requirement paragraph	Number
					MAJOR
X	X	-	Pins or socket contacts not as specified.	3.1	101
X	X	X	Dimensions not as specified.	3.1	102
X	-	-	180-degree ben at joint causing visible spearation of connector and cable.	3.1	103
X	X	X	Materials or components not as specified.	3.1	104
X	-	-	Gap between skirts exceeds 1/16 inch but less than 1/8 inch when mated.	3.1, 3.12	105
X	-	-	Bond between cable and connectors not watertight.	3.5	106
X	X	X	Attaching means for dummy connectors not as specified.	3.7.1	107
X	X	-	Rubber in socket adheres to contact area or filling slit.	3.10	108
X	X	-	Connectors not electrially or physically serviceable after mating.	3.10.2	109
X	X	-	Lampholders not as specified.	3.17	110
					MINOR
X	-	-	Treatment and painting not as specified.	3.21	201
X	X	X	Identification marking missing or incomplete.	3.22	202
X	X	X	Workmanship not as specified.	3.23	203

4.4.3 Test.

4.4.3.1 Individual. Each production cable assembly shall be tested as indicated in table III. Failure of any test shall be cause for rejection.

4.4.3.2 Sample. Samples selected in accordance with 4.4.1 and which have passed the individual test specified in 4.4.3.1 shall be tested in accordance with table III. AQL shall be 10 percent defective.

4.5 Inspection procedure.

4.5.1 Inspection schedule. Tables II and III shall be used for pre-production and quality conformance inspection as specified in 4.3 and 4.4.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

TABLE III. Test Schedule.

Pre-pro.			Quality Conformance						Test	Test Para.	Req. Para.
			Cable Assy.		Adapter		Dummy Conn.				
Cable Assy.	Adapter	Dummy Conn.	Ind.	Samp.	Ind.	Samp.	Ind.	Samp.			
X	X	-	X	-	X	-	-	-	Operating.	4.6.1	3.3
X	-	-	-	-	-	-	-	-	Cable.	4.6.2	3.4
X	X	X	-	-	-	-	-	-	Insulation and jacket.	4.6.3.1	3.5
X	-	-	-	-	-	-	-	-	Inserts.	4.6.3.2	3.5
X	-	-	-	X	-	-	-	-	Bond between connector and cable.	4.6.4	3.10.3.1
X	X	X	-	X	-	X	-	X	Degree of closure.	4.6.3.3.1	3.12
X	X	-	-	-	-	-	-	-	Connect and disconnect force.	4.6.3.3.3	3.13
X	X	-	-	-	-	-	-	-	Voltage drop.	4.6.5	3.14
X	X	-	-	X	-	X	-	-	Dielectric strength.	4.6.3.3.2	3.15
X	X	X	-	-	-	-	-	-	Temperature and humidity.	4.6.6	3.20

4.6 Test Procedures.

4.6.1 Operating. Connect the cable assembly to a power source and dummy load, and check for operation at rated voltage and current. Connect and disconnect the connectors five times. Short circuits, open circuits, arcing during operation, or failure of the connector to connect or disconnect shall constitute failure of this test.

4.6.2 Cable. Test the cable in accordance with MIL-C-3432 prior to fabrication into an assembly, or the cable manufacturer shall provide a certification that the cable meets the requirements of MIL-C-3432.

4.6.3 Molded connector, adapter, inserts, dummies and plugs.

4.6.3.1 Insulation and jacket. Test the insulation and jacket material used in fabrication of the connectors, adapters, inserts, dummies, and plugs in accordance with MIL-I-3930, or the manufacturer of the material shall provide a certification that the cable meets the requirements of MIL-C-3432.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

4.6.3.2 Hardness of insert or body material. Determine the hardness of the body material in accordance with FED-STD-601, method 3021.

4.6.3.3 Degree of closure and dielectric strength.

4.6.3.3.1 Degree of closure. Install a mating plug on not less than one accommodation of the cable-assembly terminal. The mating connector plug shall be equipped with a minimum of 3 feet of cable with bared ends. Cap all additional cable-assembly terminals with mating plugs or connector dummies. When adapters are required, use two connector plugs for mating with the adapter. Cap all other accommodations of the adapter with dummy connectors. Keeping the bared ends dry, immerse each assembly to a depth of 3 feet in tap water for a period of 8 hours. Any evidence of moisture in the interior of either the dummy connector or its mating connector at the end of 8 hours shall constitute failure of this test.

4.6.3.3.2 Dielectric strength. Apply the test volage to the adjacent conductors. Watertight assemblies shall be tested immersed in water with the voltage applied between each conductor and the grounded water bath in which the cable is immersed. Supply the test voltage from an alternating-current source with a frequency of not more than 100 cycles per second. Apply the nominal-use voltage initially, increase at an approximately uniform rate to five times the rated voltage, and hold at that value for 1 minute. The rate of voltage increase shall not be less than 100 percent in 60 seconds. Measure the test voltage by any method that gives a root-mean-square value. A crest factor of the test voltage if different by more than plus or minus 10 percent from that of a sinusoidal wave, when the source is loaded with the test specimen, shall constitute failure of this test.

4.6.3.3.3 Connect and disconnect force. Determine the force required to connect and disconnect the connector plug of the cable assembly with a mating connector as follows: Mount the test item in a manner so that a static load may be applied along the longitudinal axis of the test item, and gradually increase the static load until the mating connector is engaged to the depth required for normal operation. Determine the force required to disconnect the mating connector from the test item by applying a gradually increasing longitudinal pull on the mating connector. Conduct the test 500 times. Examine and operate the connectors at rated voltage and current. Any damage that will impair use shall constitute failure of this test.

4.6.4 Bond between connectors and cables. The connector body shall be rigidly supported and a weight or force shall be gradually applied to the cable. Apply the maximum weight or force specified on the applicable figure for 1 minute. Check the cable assembly during the test for continuity of circuit. Any evidence of tearing, breakage, or other damage that would impair use shall constitute failure of this test.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

4.6.5 Voltage drop. Determine the voltage drop between mated pins and sockets by applying a DC voltage at the current stipulated in the applicable figure and measuring between the ends of the terminals. Voltage drop exceeding the limit specified in 3.14 shall constitute failure of this test (see Figure 1).

4.6.6 Temperature and humidity. Maintain chambers used for temperature and humidity tests within plus or minus 4 degrees F. of the specified temperature throughout the test.

4.6.6.1 Low-temperature storage and operation. Install a mating plug on each end of the cable assembly that is provided with a plug. Equip each mating plug with a mininum of 3 feet of cable with bared ends. Place the cable assemblies in a test chamber and expose to an ambient temperature of minus 65 degrees F. for 24 hours. Test each assembly as specified in 4.6.1. Any defect in connectors, adapters, dummies, or plugs such as cracks or separation of connectors from the cable shall constitute failure of this test.

4.6.6.2 High-temperature and humidity storage and operation. Install a mating plug on each end of each cable assembly provided with a plug. Equip the mating plug with a mininum of 3 feet of cable. Place the cable assemblies in the test chamber and expose to an ambient temperature of plus 125 degree F. and maximum humidity for a period of 24 hours. Test each assembly as specified in 4.6.1. Any defects in connectors, adapters, dummies, or plugs such as cracks or separation of connectors from the cable shall constitute failure of this test.

4.7 Inspection of packaging.

4.7.1 Quality conformance inspection of pack.

4.7.1.1 Unit of product. For the purpose of inspection, a completed pack prepared for shipment shall be considered a unit of product.

4.7.1.2 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.7.1.3 Examination. Samples selected in accordance with 4.7.1.2 shall be examined for the characteristics listed in table IV. AQL shall be 2.5 percent defective for major defects and 4.0 percent defective for minor defects.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

TABLE IV Examination schedule-packaging.

Number	Characteristic	Requirements Paragraph
MAJOR		
111	Preservation not level A or Commercial, as specified.	5.1
112	Cable assemblies not preserved for level A as specified.	5.1.1.1
113	Reels not preserved for level A as specified	5.1.1.1.1
114	Coils not preserved for level A as specified	5.1.1.1.2
115	Extension lights not preserved for level A as specified.	5.1.1.2
116	Adapters and dummies not preserved for level A as specified.	5.1.1.3
117	Commercial preservation not in accordance with MIL-STD-1188.	5.1.2
118	Packing not level A, level B, or Commercial as specified.	5.2
119	Reels not packed for level A as specified.	5.2.1.1
120	Coiled cable assemblies, extension lights, receptacles adaptors, and dummies not packed for level A as specified.	5.2.1.2
121	The cable assemblies etc., not packed for level B as specified.	5.2.2
122	Commercial packing not in accordance with MIL-STD-1188.	5.2.3
MINOR		
204	Marking for military levels of protection not in accordance with MIL-STD-129.	5.3
205	Commercial marking not in accordance with MIL-STD-1188.	5.3

5. PACKAGING

5.1 Preservation. Preservation shall be Level A or commercial, as specified.

5.1.1 Level A.

5.1.1.1 Cable assemblies. The cable assemblies shall be preserved on reels or in coils, as specified (see 6.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

5.1.1.1.1 Reels. Complete cable assemblies of like description, consisting of components as specified on the applicable specification sheet, shall be preserved on nonreturnable reels. Cable assemblies with attached seals shall have the seals installed on the connectors. Assemblies shall not be plugged together but shall be overlapped and secured to form a continuous length on each reel. The ends of the assemblies shall be overlapped so that the rear end of the plug on one assembly is adjacent to the rear end of the plug on the next assembly. They shall be secured in this position with cotton tape capable of holding the cable without damage when the joint is subjected to a pull of 100 pounds. The cables shall be covered with a barrier material conforming to PPP-B-1055, class C-1 extending on each flange and sealed to the flange with adhesive conforming to MMM-A-260, type and class as applicable, grade B.

5.1.1.1.2 Coils. Cable assemblies shall be individually coiled to a minimum safe diameter with the connectors inside the coil and the coil secured with not less than three ties of 1/2-inch cotton tape. Coiled cable assemblies shall be individually placed in snug-fitting boxes conforming to PPP-B-636, W6c, or wrapped with barrier material conforming to PPP-B-1055, class C-1, with all folds, seams, and laps sealed with adhesive conforming to MMM-A-260, type and class as applicable, grade B. Boxes shall be closed in accordance with the appendix to box specification method V.

5.1.1.2 Extension lights. Extension lights of like description shall be hanked to an overall length of approximately 10 inches and placed together in quantities as specified on the applicable specification sheet not to exceed 40 pounds in snug-fitting boxes conforming to PPP-B-636, W6c, style optional. The boxes shall be closed and waterproof sealed with tape in accordance with method V of the appendix to the box specification.

5.1.1.3 Adapters and dummies. Complete adapters and dummies of like description shall be placed in snug-fitting boxes conforming to PPP-B-636, W6c, with components specified on the applicable specification sheet not to exceed 40 pounds gross weight. Cushioning shall be provided within the boxes. The boxes shall be closed and waterproof sealed with tape in accordance with method V of the appendix to the box specification.

5.1.2 Commercial. Commercial preservation shall be in accordance with MIL-STD-1188.

5.2 Packing. Packing shall be level A, B, or commercial, as specified.

5.2.1 Level A.

5.2.1.1 Reels. The cable assemblies shall be completely enclosed with wood lagging boards of the same thickness as the wood flanges of the reel but not thicker than nominal 2-inch lumber. The lagging shall be secured to wood flanges of the reels by nailing and strapping and to metal flanges of the reels with strapping. Not less than two flat steel straps conforming to QQ-S-781, type I, finish B, size as applicable, shall be tensioned and sealed. Straps shall be placed one-sixth the width of the drum from the flanges with an additional strap, equally spaced between these straps, when the width of the drum exceeds 24 inches. Straps shall be stapled to the lagging. Overpacking of reels will not be required.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

5.2.1.2 Coiled cable assemblies, extension lights, receptacles, adapters, and dummies. These items, preserved as specified, shall be packed together in snug-fitting boxes conforming to PPP-B-601, overseas type, style optional. Blocking, bracing, and cushioning shall be provided in accordance with MIL-STD-1186. Strapping shall conform to QQ-S-781, class I, type I or IV, size as applicable. Unless otherwise specified (see 6.2), strapping shall be finish B. When specified (see 6.2), strapping shall be finish A.

5.2.2 Level B. Packing shall be as specified for level A, except boxes shall be domestic type, style optional, or fiberboard conforming to PPP-B-636, class water resistant. Strapping shall be finish A.

5.2.3 Commercial. Commercial packing shall be in accordance with MIL-STD-1188.

5.3 Marking. Marking for military levels of protection shall be in accordance with MIL-STD-129. Commercial marking shall be in accordance with MIL-STD-1188.

6. NOTES

6.1 Intended use. The cable assemblies are intended for use in electrcal distribution systems requiring all-weather capability.

6.2 Ordering data. Procurement documents should specify the following:

(a) Title, number, and date of this specification.
(b) Applicable specification sheet (see 3.1).
(c) Time frame required for submission of the preproduction models (see 3.2.1).
(d) Degree of preservation and degree of packing required (see 5.1 and 5.2).
(e) Whether reels or coils are to be used for preservation.
(f) When finish A strapping is required (see 5.2.1.2).

6.3 Preproduction model. Any changes or deviations of production cable assemblies from the approved preproduction models during production will be subject to the approvel of the contracting officer. Approval of the preproduction models will not relieve the contractor of his obligation to furnish cable assemblies conforming to this specification.


Custodian:
Army - ME

Review Activities:
Army - CR
DLA - GS

Preparing activity:
Army - ME

Project 6150-A175

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

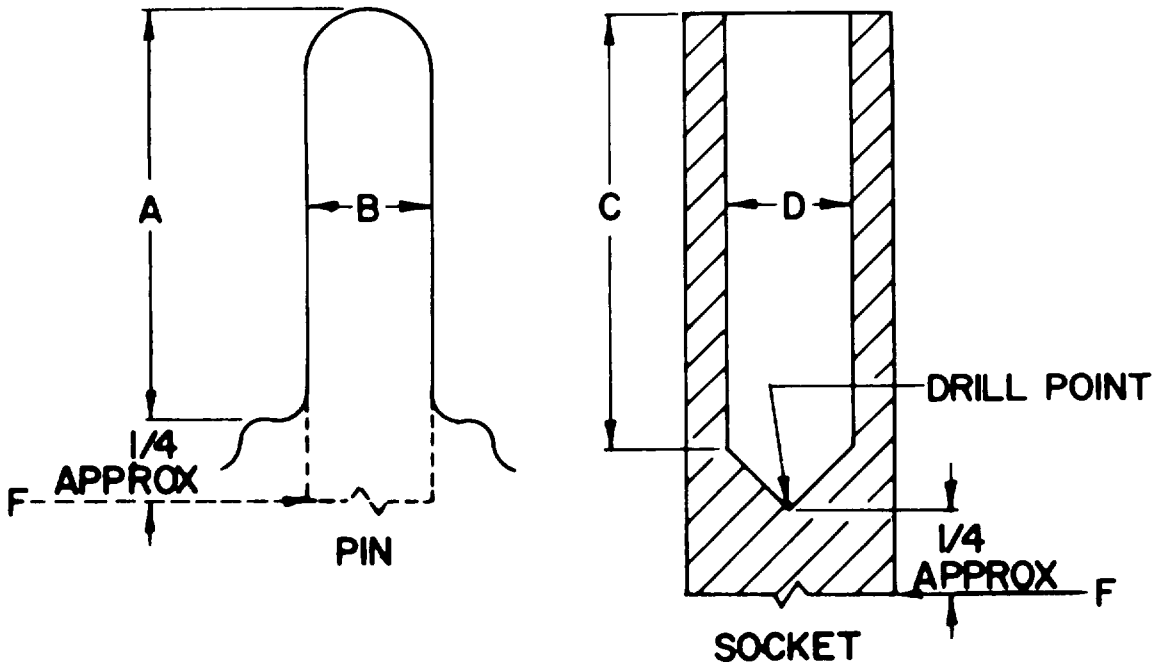



NOTE:
F - POINT FOR VOLTAGE DROP PROBE ON CONTACT.

Figure 1. CONTACTS

BX1770

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

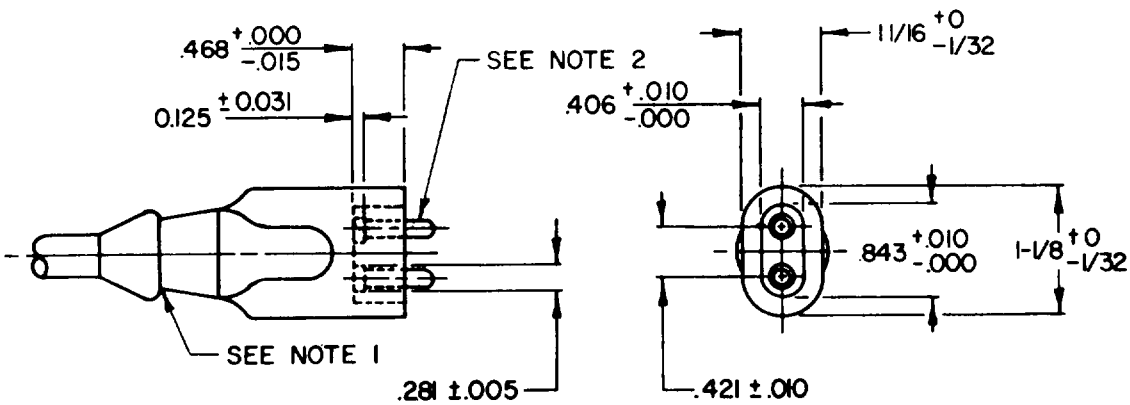

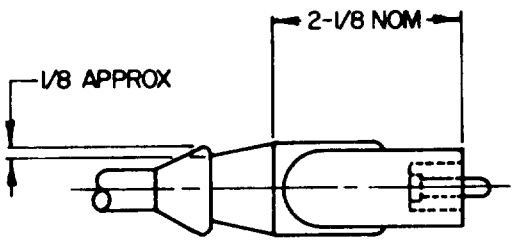


NOTES:

1. THIS GROOVE TO BE OF SUFFICIENT DEPTH, WIDTH, OR CROSS SECTION TO BE USED WITH TWINE OR CORD OF 1/8 DIAMETER, AND NEED NOT BE OF THE SHAPE SHOWN.
2. TYPE I MALE CONTACTS.
3. CONNECTION RATING: 600 VOLTS, 15 AMPERE.
4. VOLTAGE DROP: NOT MORE THAN 10 MILLIVOLTS AT 15 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE 10-35 POUNDS.
6. ALL DIMENSIONS ARE IN INCHES.

Figure 2. MOLDED PLUG (MALE).

BX1771

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

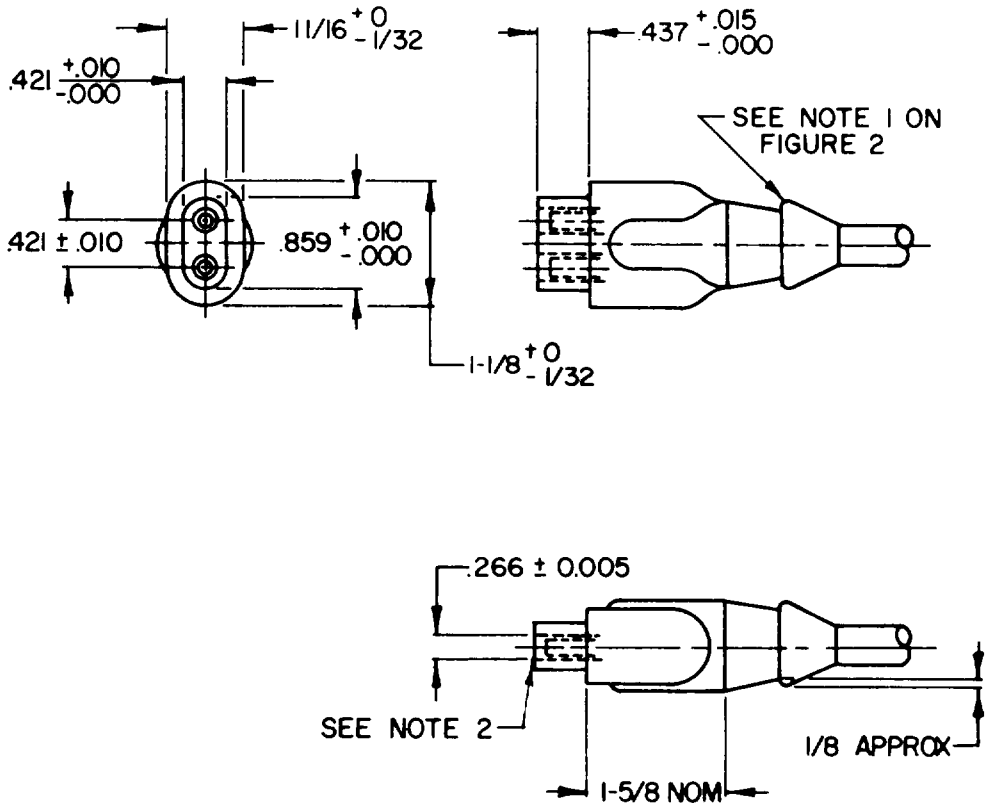


NOTES:


1. TYPE I FEMALE CONTACTS.
2. FEMALE CONTACTS SHALL BE RECESSED 0.125 ± 0.0156 BELOW FACE.
3. CONNECTOR RATING: 600 VOLTS, 15 AMPERES.
4. VOLTAGE DROP: NOT MORE THAN 10 MILLIVOLTS AT 15 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
6. ALL DIMENSIONS ARE IN INCHES.

Figure 3. MOLDED PLUG (FEMALE).

BX1772

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

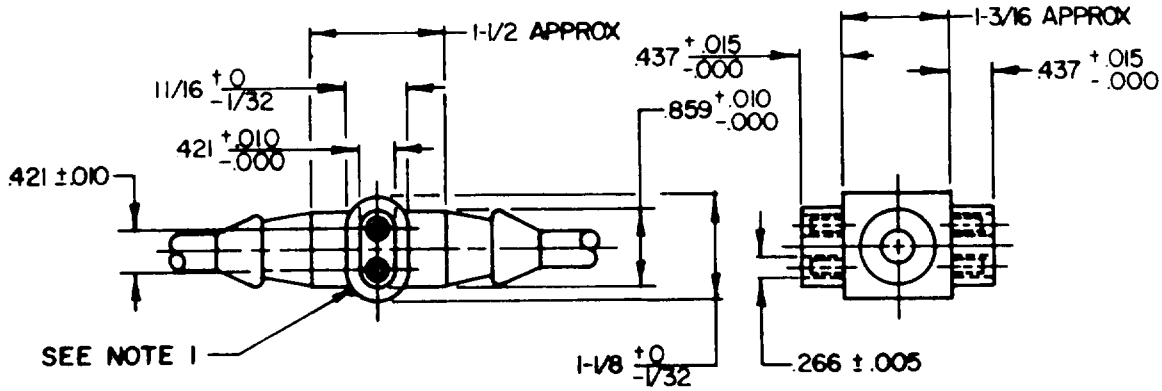

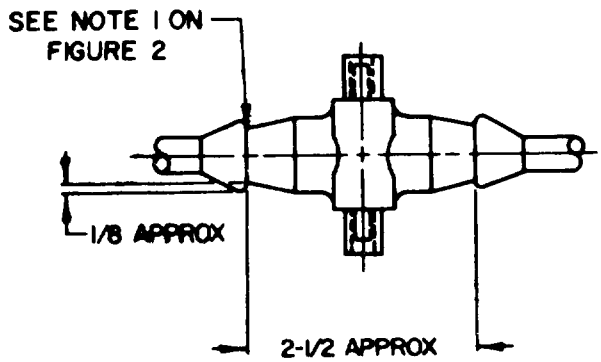


NOTES:

1. TYPE I FEMALE CONTACTS.
2. FEMALE CONTACTS SHALL BE RECESSED 0.125 ± 0.015 BELOW FACE.
3. CONNECTOR RATING: 600 VOLTS, 15 AMPERES.
4. VOLTAGE DROP: NOT MORE THAN 10 MILLIVOLTS AT 15 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
6. ALL DIMENSIONS ARE IN INCHES.

Figure 4. FEMALE MOLDED DOUBLE OUTLET.

BX1773

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

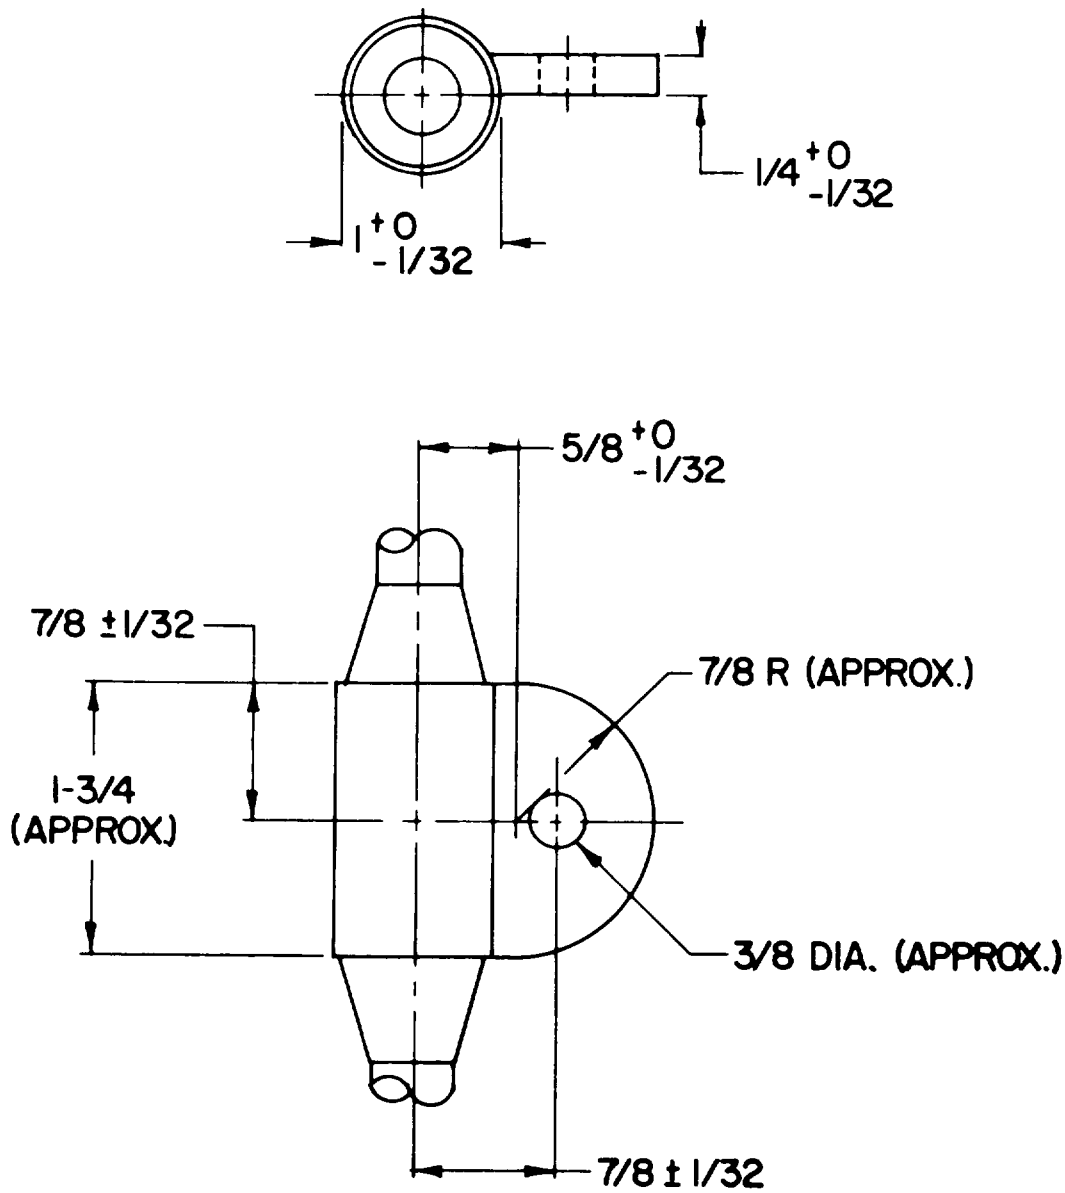


NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 5. CABLE HANGER DETAILS.

BX1774

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

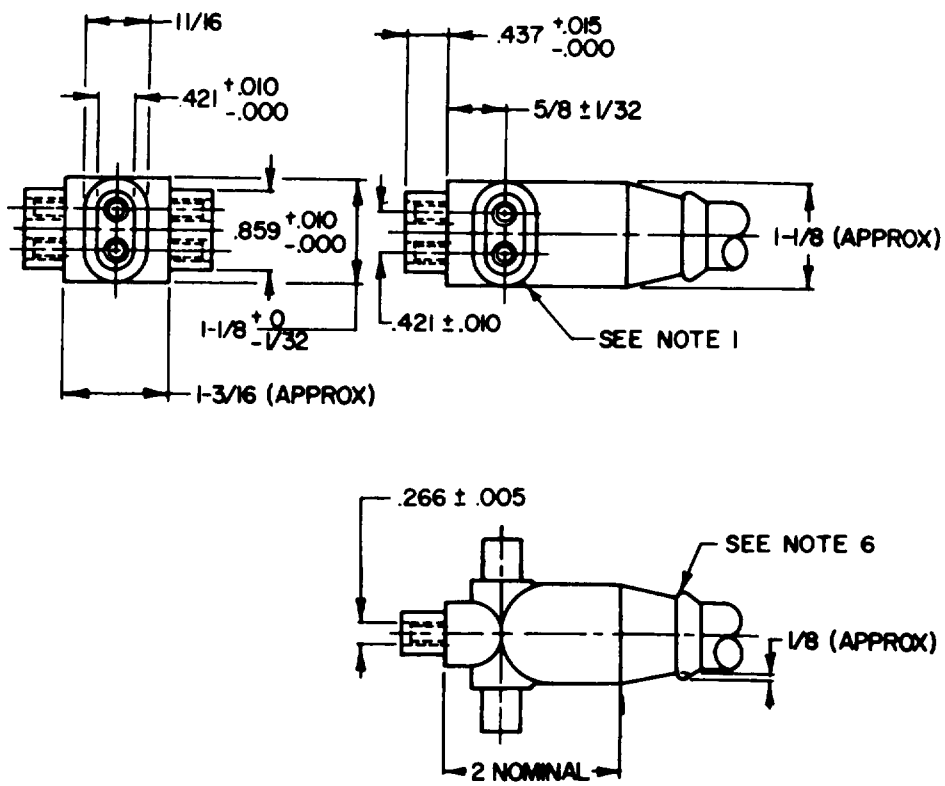


NOTES:


1. TYPE 1 FEMALE CONTACTS.
2. FEMALE CONTACTS SHALL BE RECESSED 0.125 ± 0.0156 BELOW FACE.
3. CONNECTOR RATING: 600 VOLTS, 15 AMPERES.
4. VOLTAGE DROP: NOT MORE 10 MILLIVOLTS AT 15 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
6. THIS GROOVE TO BE OF SUFFICIENT DEPTH, WIDTH, OR CROSS SECTION TO BE USED FOR SECURING THE DUMMY SHOWN IN FIGURE 8 WITH TWINE OR CORD OF 1/8 DIAMETER, AND NEED NOT BE OF THE SHAPE SHOWN.
7. ALL DIMENSIONS ARE IN INCHES.

FIGURE 6. MOLDED FEMALE THREE-WAY TERMINAL

BX1775

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

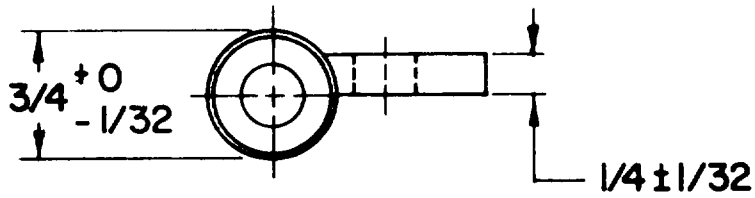

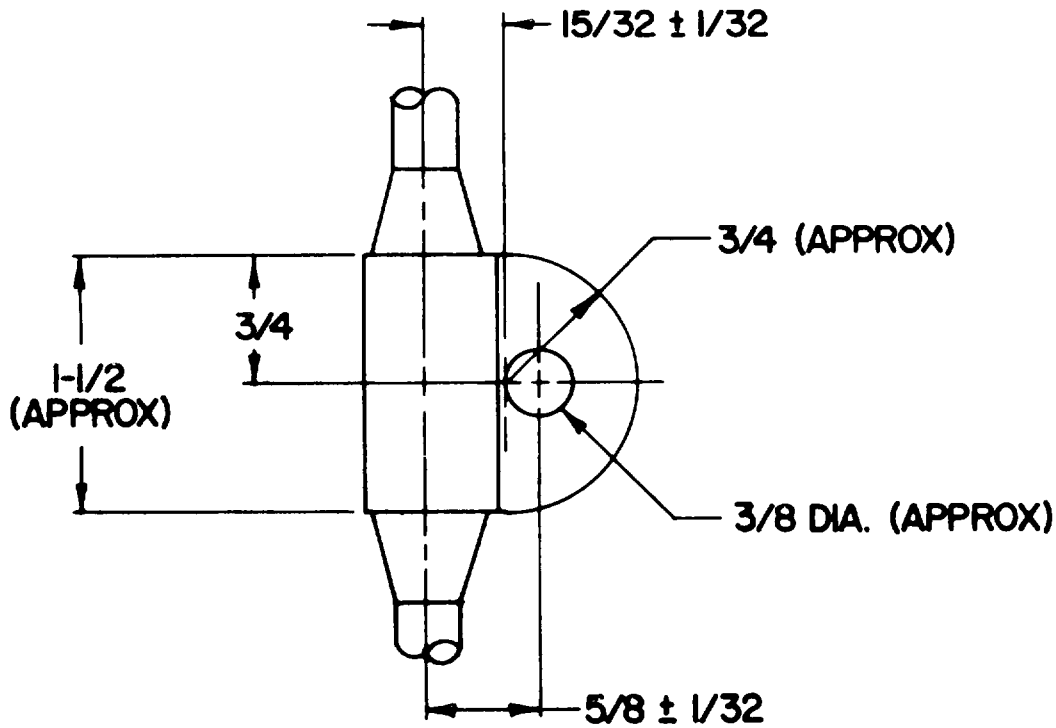


NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 7. CABLE HANGER DETAILS.

BX1776

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

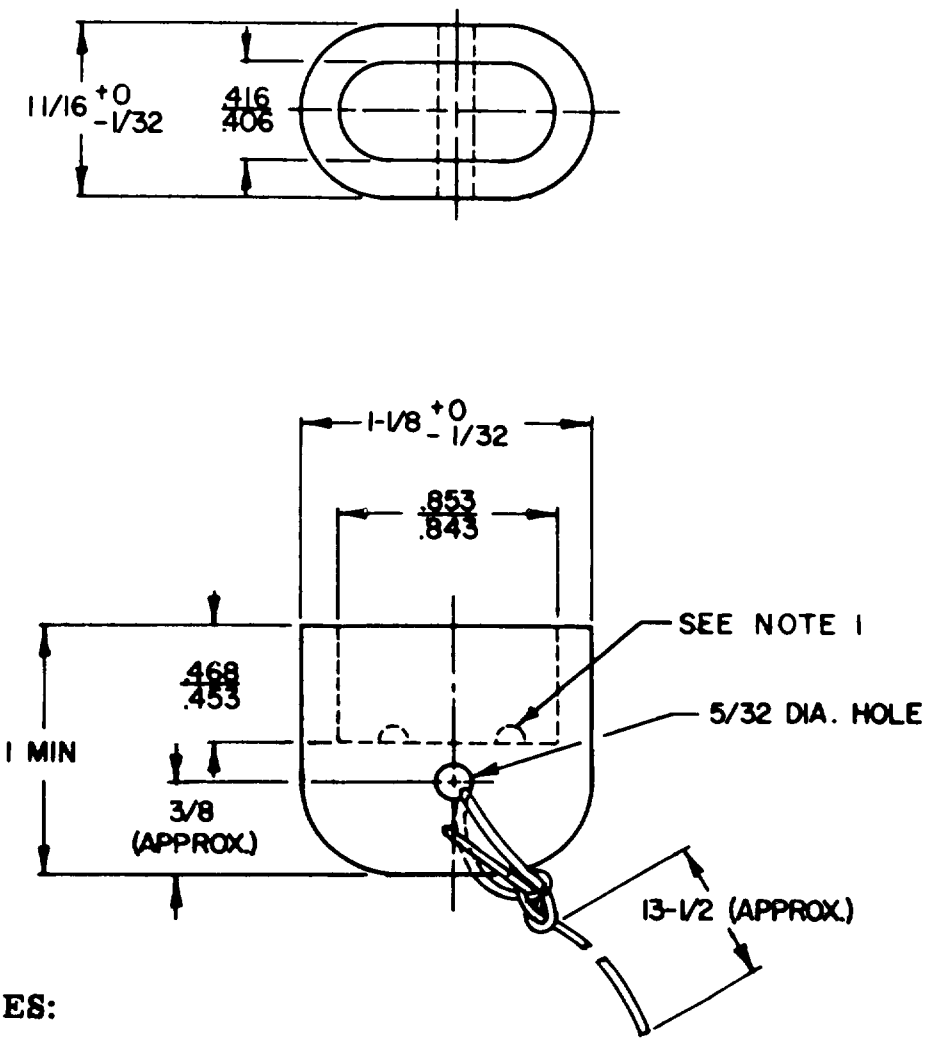


NOTES:

1. PROJECTIONS MAY BE PROVIDED IF NECESSARY TO INSURE WATER TIGHTNESS.
2. ALL DIMENSIONS ARE IN INCHES.

Figure 8. MALE DUMMY WITH COTTON TWINE, TYPE I.

BXI777

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

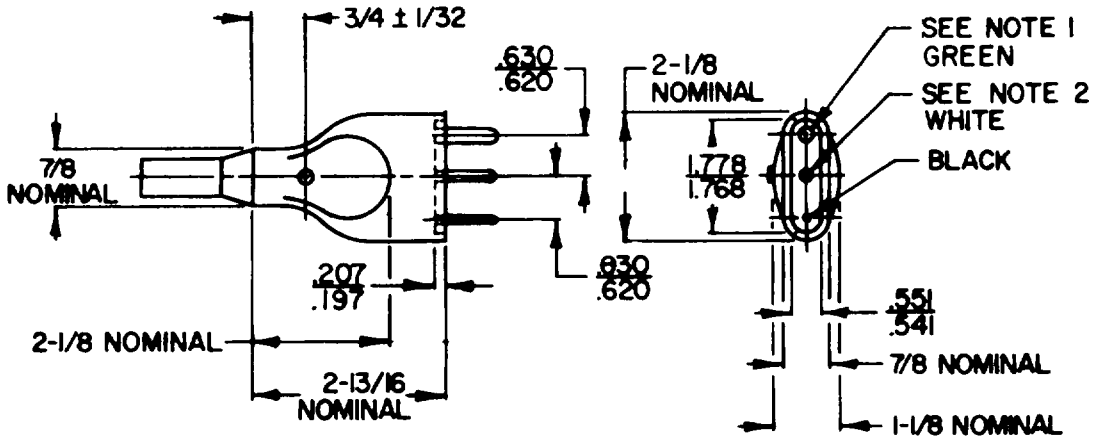


NOTES:

1. TYPE II P CONTACT.
2. TYPE II S CONTACT. 2 REQUIRED
3. CONNECTOR RATING: 600 VOLT, 20 AMPERES.
4. VOLTAGE DROP: NOT MORE THAN 20 MILLIVOLTS AT 20 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
6. ALL DIMENSIONS ARE IN INCHES.

Figure 9. THREE-POLE MALE PLUG.

BXI778

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

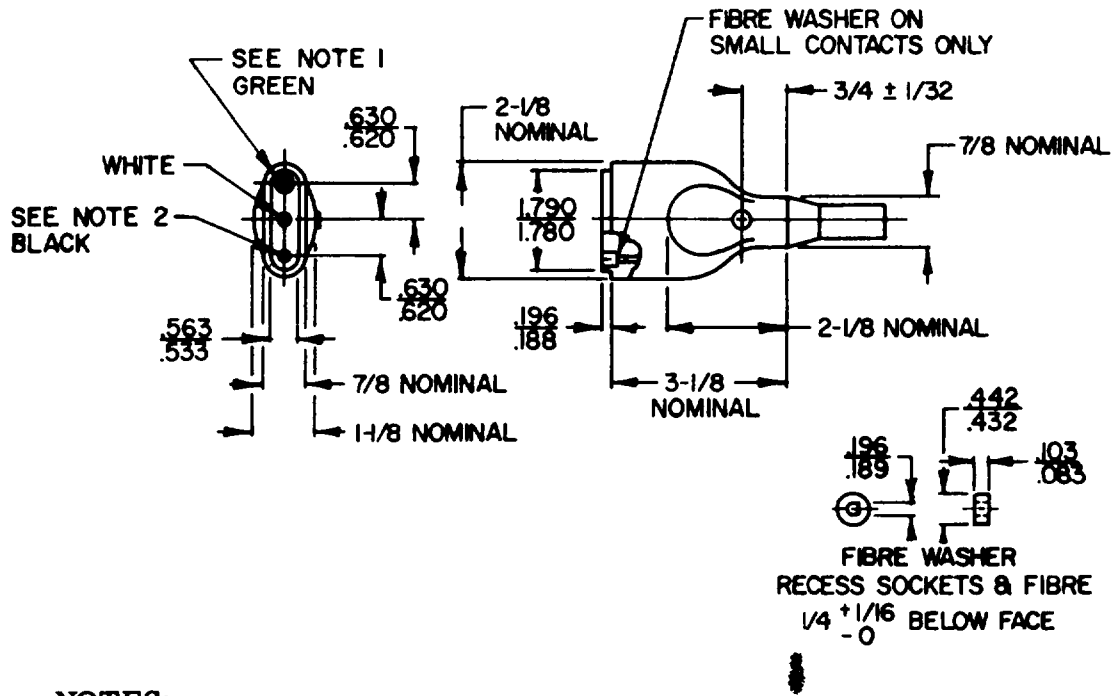


NOTES:

1. TYPE II P CONTACT.
2. TYPE II S CONTACT. 2 REQUIRED
3. CONNECTOR RATING: 600 VOLT, 20 AMPERES.
4. VOLTAGE DROP: NOT MORE THAN 20 MILLIVOLTS AT 20 AMPERES.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
6. ALL DIMENSIONS ARE IN INCHES.

Figure 10. THREE-POLE FEMALE PLUG.

BX1779

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

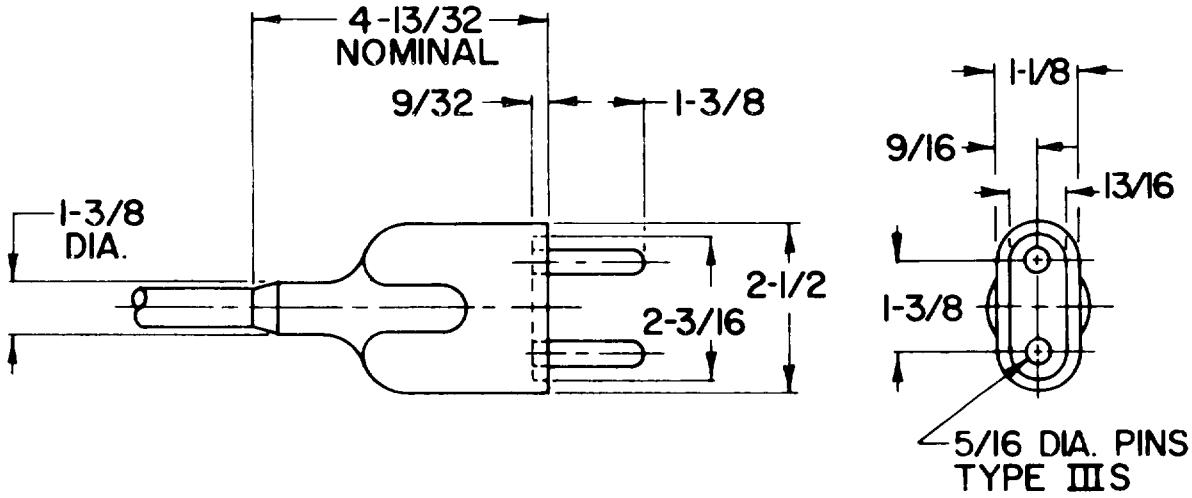


NOTES:

1. CONNECTOR RATING: 600 VOLT, 25 AMPERE.
2. VOLTAGE DROP: NOT MORE THAN 20 MILLIVOLTS AT 25 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 15-35 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 11. CONNECTOR PLUG, ELECTRICAL, (MALE), WATERPROOF.

BX1780A

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

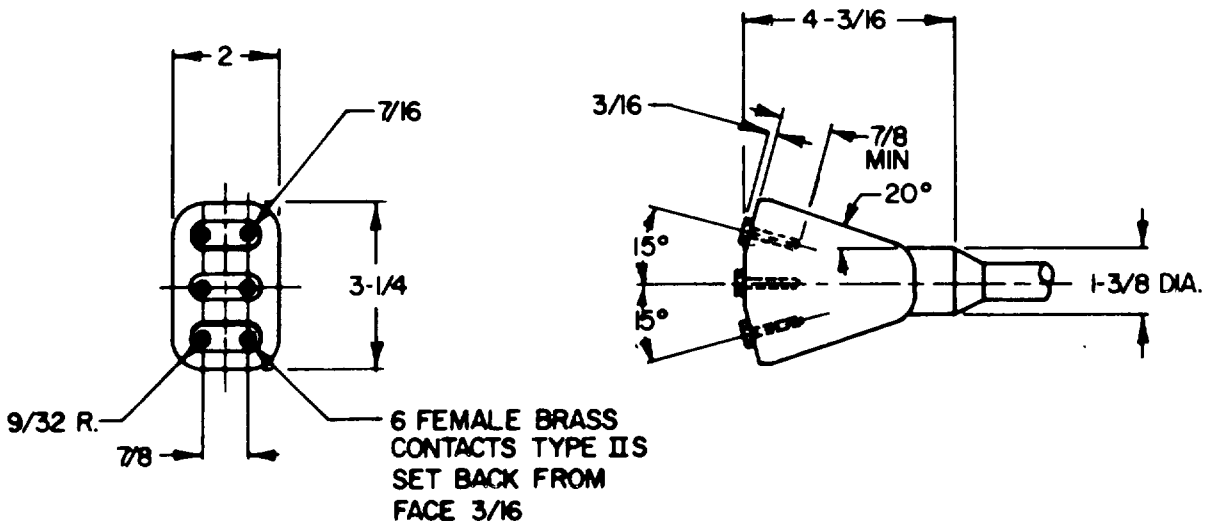


NOTES:

1. CONNECTOR RATING: 600 VOLT, 15 AMPERES.
2. VOLTAGE DROP: NOT MORE THAN 10 MILLIVOLTS AT 15 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 12. CONNECTOR, WATERPROOF.

BX1781

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

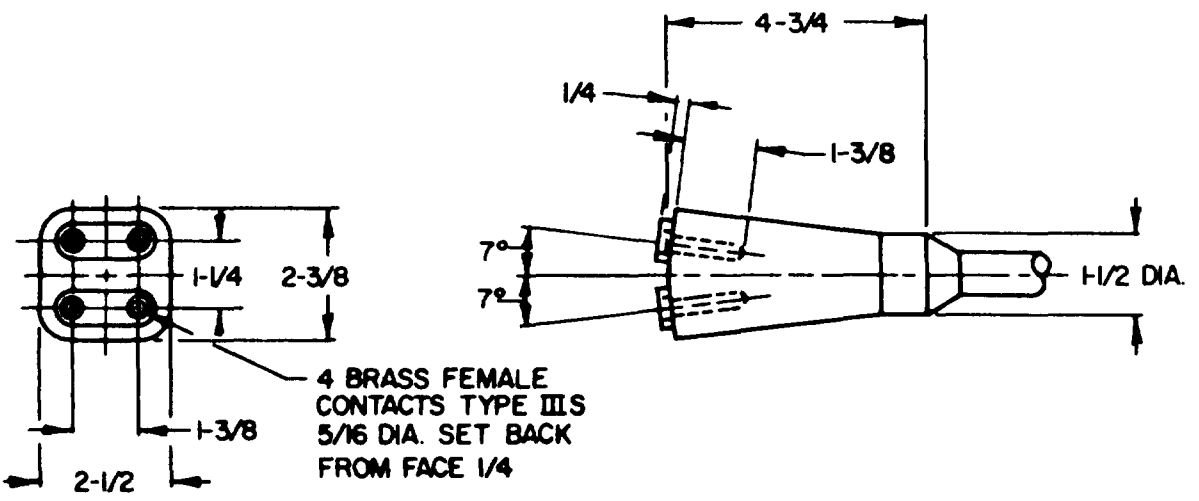


NOTES:

1. CONNECTOR RATING: 600 VOLT, 20 AMPERE.
2. VOLTAGE DROP: NOT MORE THAN 15 MILLIVOLTS AT 20 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 13. FLOODLIGHT CABLE AND PLUG, WATERPROOF.

BX1782

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

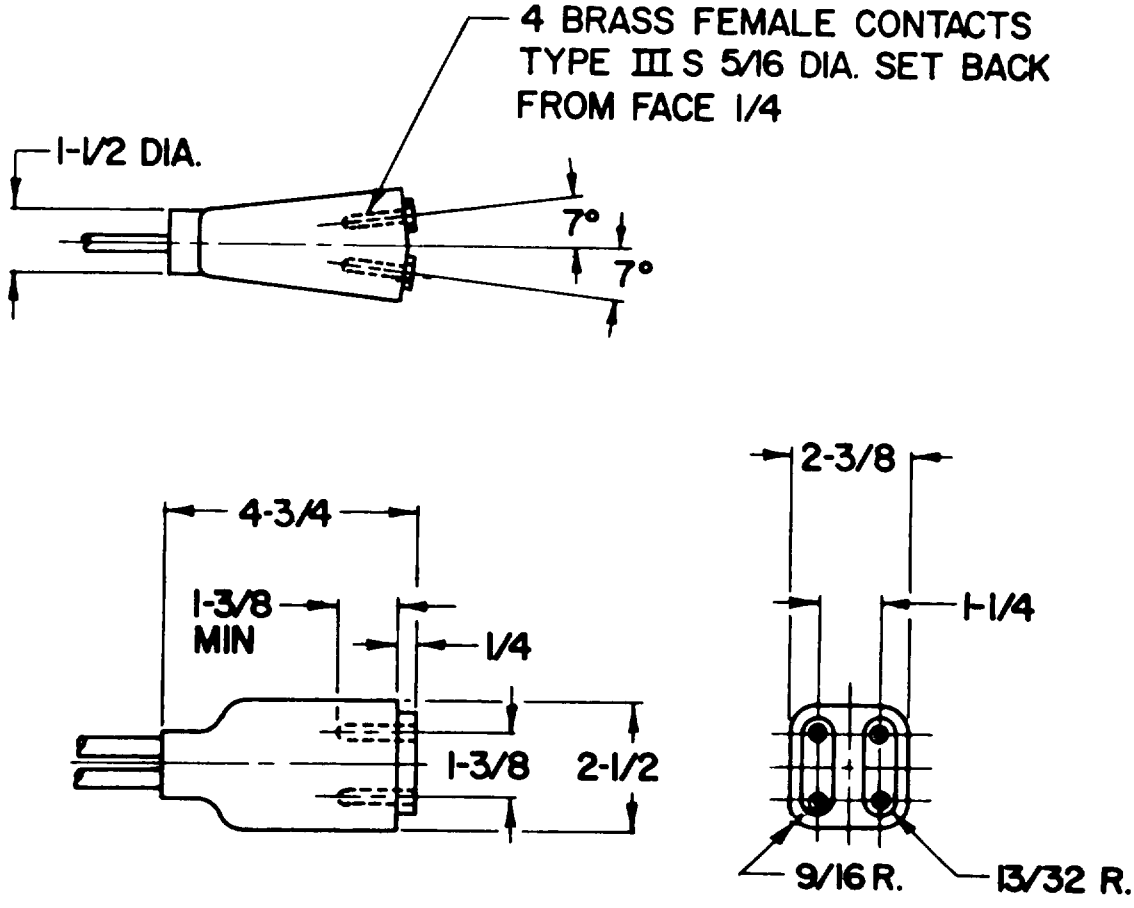


NOTES:

1. CONNECTOR RATING: 600 VOLT, 20 AMPERE.
2. VOLTAGE DROP: NOT MORE THAN 20 MILLIVOLTS AT 20 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 15-35 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 14. CONNECTOR, WATERPROOF.

BXI783

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

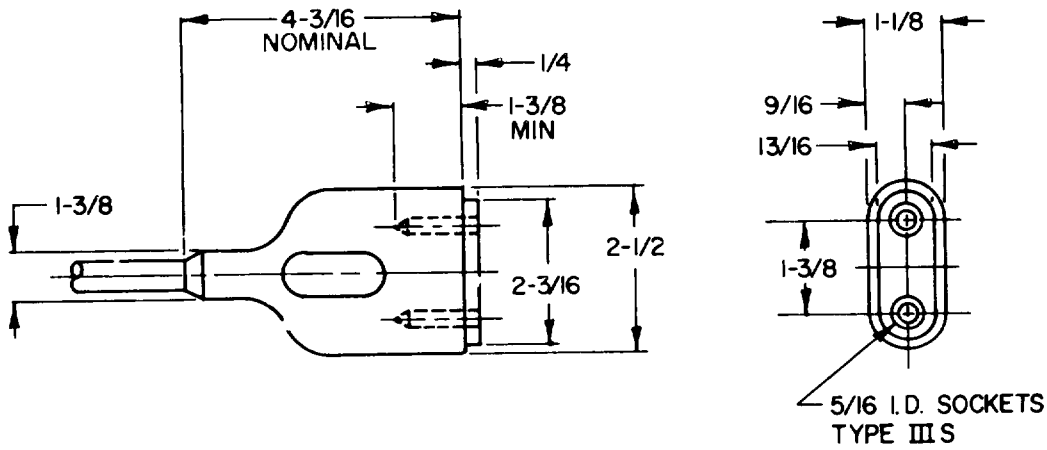


NOTES:
1. CONNECTOR RATING: 600 VOLT, 25 AMPERES.
2. VOLTAGE DROP: NOT MORE THAN 20 MILLIVOLTS AT 25 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 15-35 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 15. CONNECTOR, PLUG, ELECTRICAL (FEMALE), WATERPROOF.

BXI784A

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

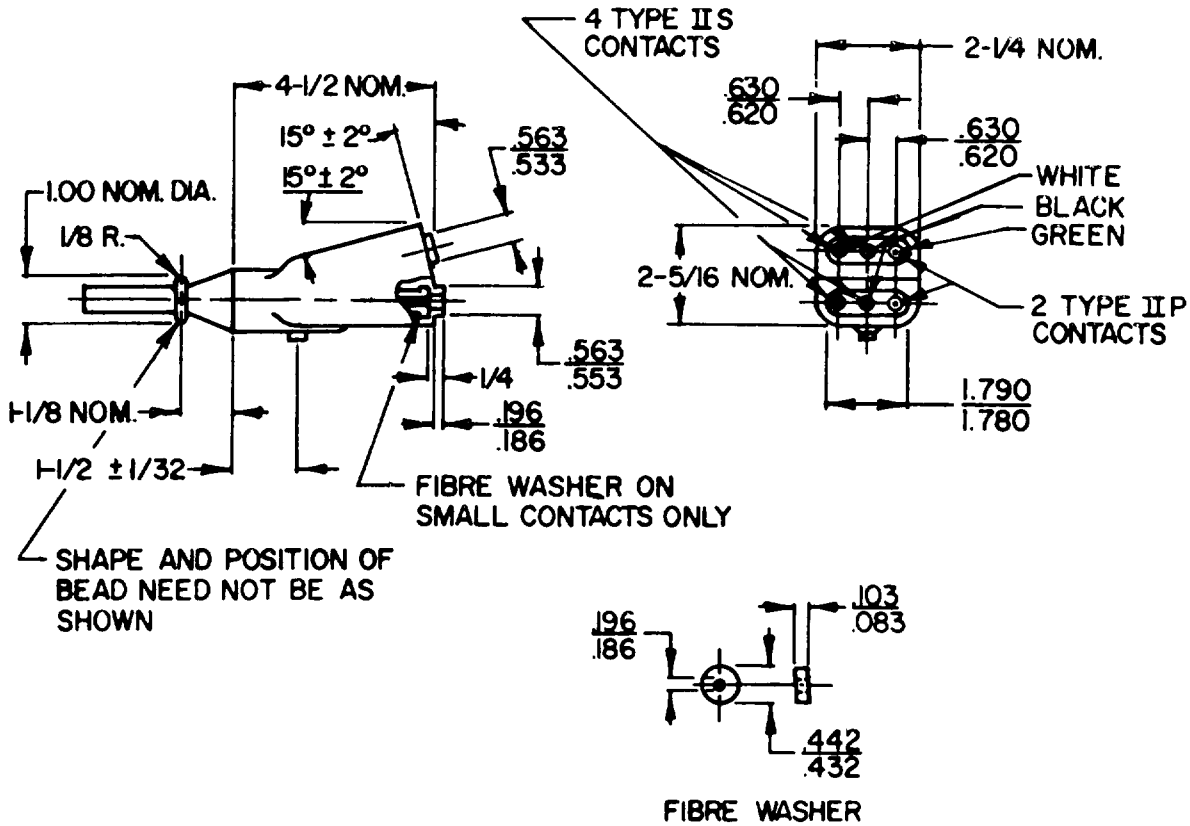


NOTES:

1. CONNECTOR RATING: 600 VOLT, 20 AMPERES.
2. VOLTAGE DROP: NOT MORE THAN 10 MILLIVOLTS AT 20 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. RECESS SOCKETS AND FIBRES 1/4 , + 1/16-0 BELOW FACE.
5. ALL DIMENSIONS ARE IN INCHES.

Figure 16. TWO-WAY, THREE-CONDUCTOR CONNECTOR.

BX1785

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

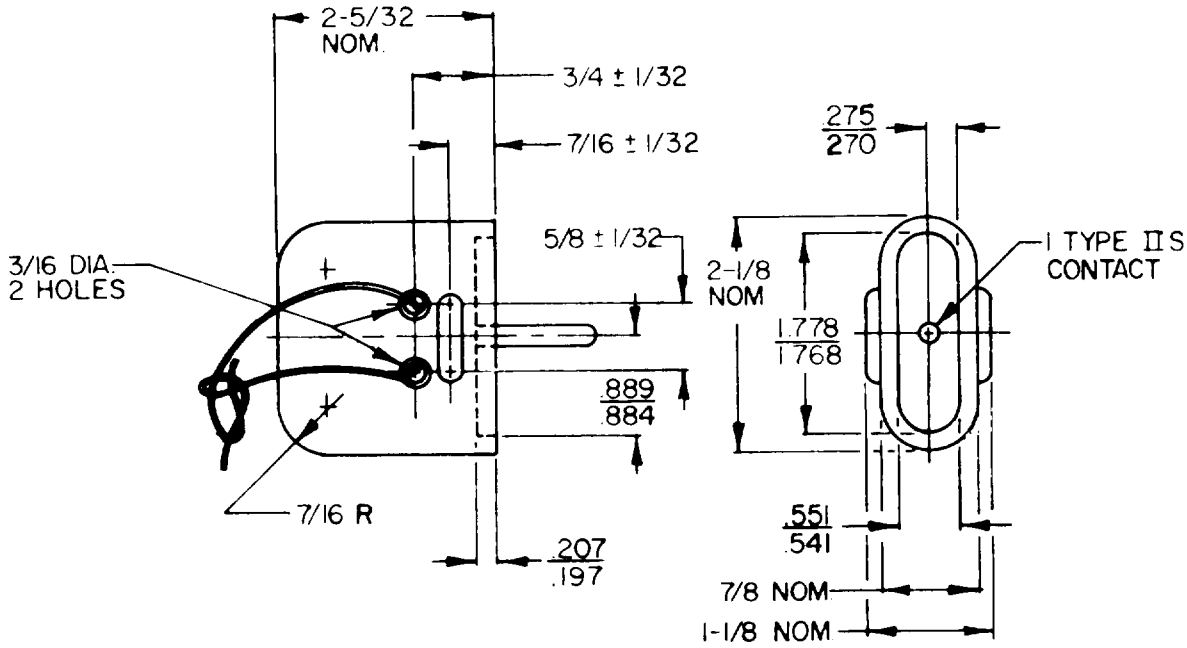


NOTES:

1. SEAL SHALL BE EQUIPPED WITH 12 COTTON TWINE 1/8 DIAMETER.
2. ALL DIMENSIONS ARE IN INCHES.

Figure 17. MALE DUMMY.

BX1786

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

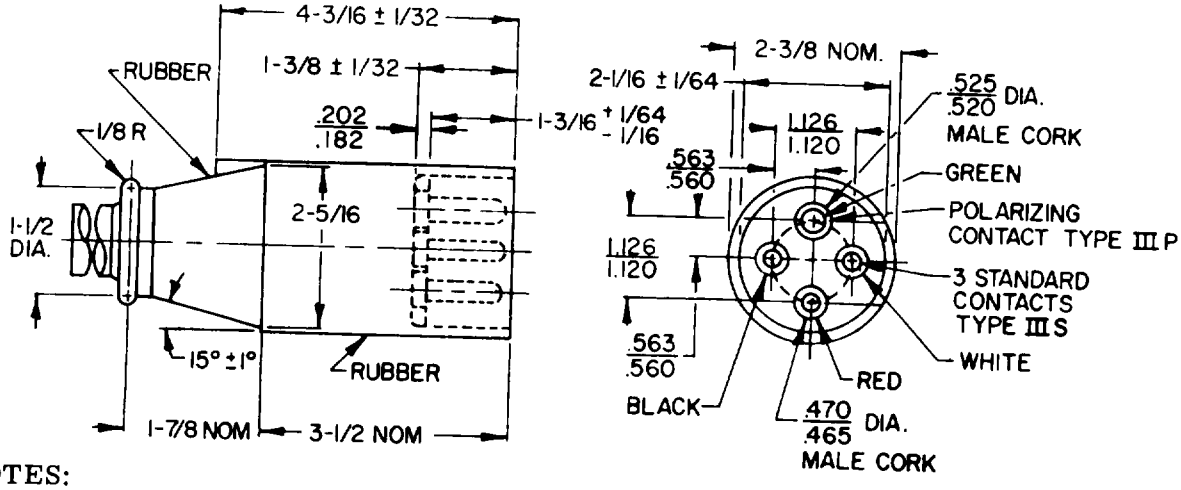


NOTES:

1. CONNECTOR RATING: 600 VOLT, 65 AMPERE.
2. VOLTAGE DROP: NOT MORE THAN 15 MILLIVOLTS AT 65 AMPERES.
3. CONNECT AND DISCONNECTING FORCE: 40-100 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 18. MOLDED PLUG (MALE).

BX1787

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

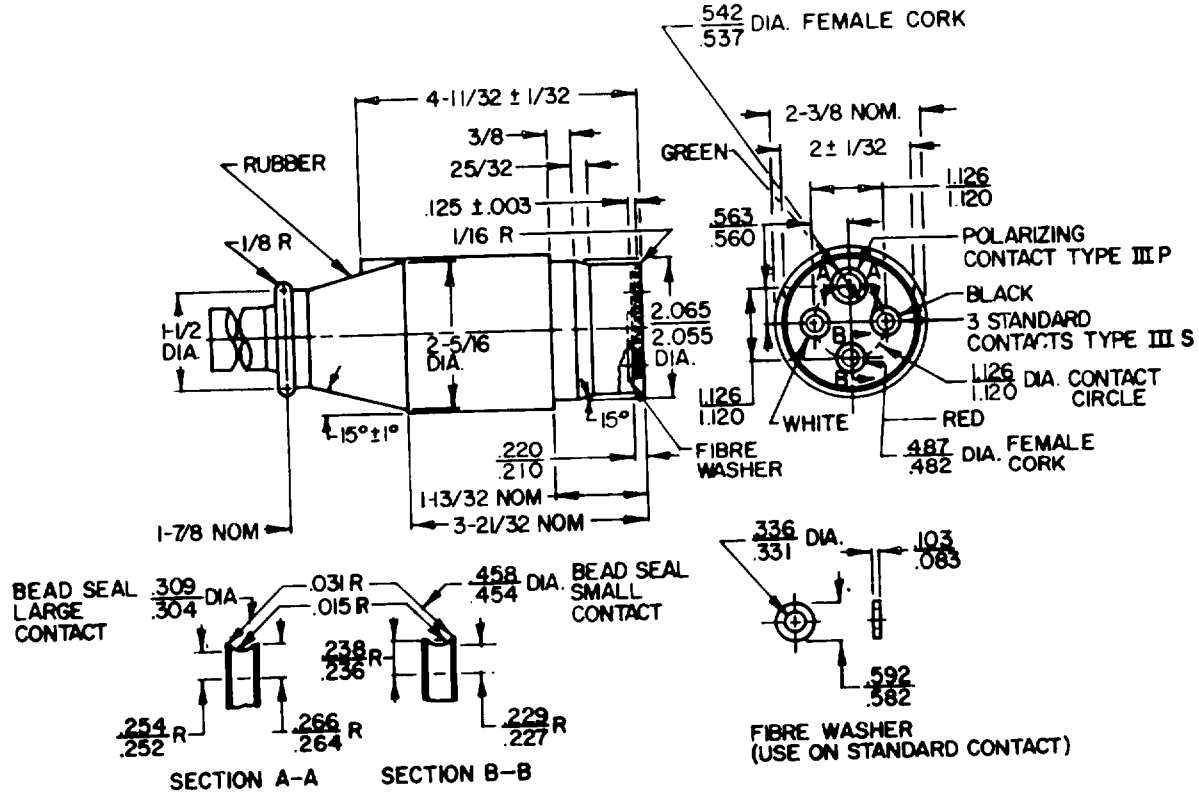


NOTES:
1. CONNECTOR RATING: 600 VOLT, 65 AMPERE.
2. VOLTAGE DROP: NOT MORE THAN 15 MILLIVOLTS AT 65 AMPS.
3. CONNECT AND DISCONNECTING FORCE: 40 TO 100 POUNDS.
4. ALL DIMENSIONS ARE IN INCHES.

Figure 19. PLUG CONNECTOR (FEMALE).

BX1788

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

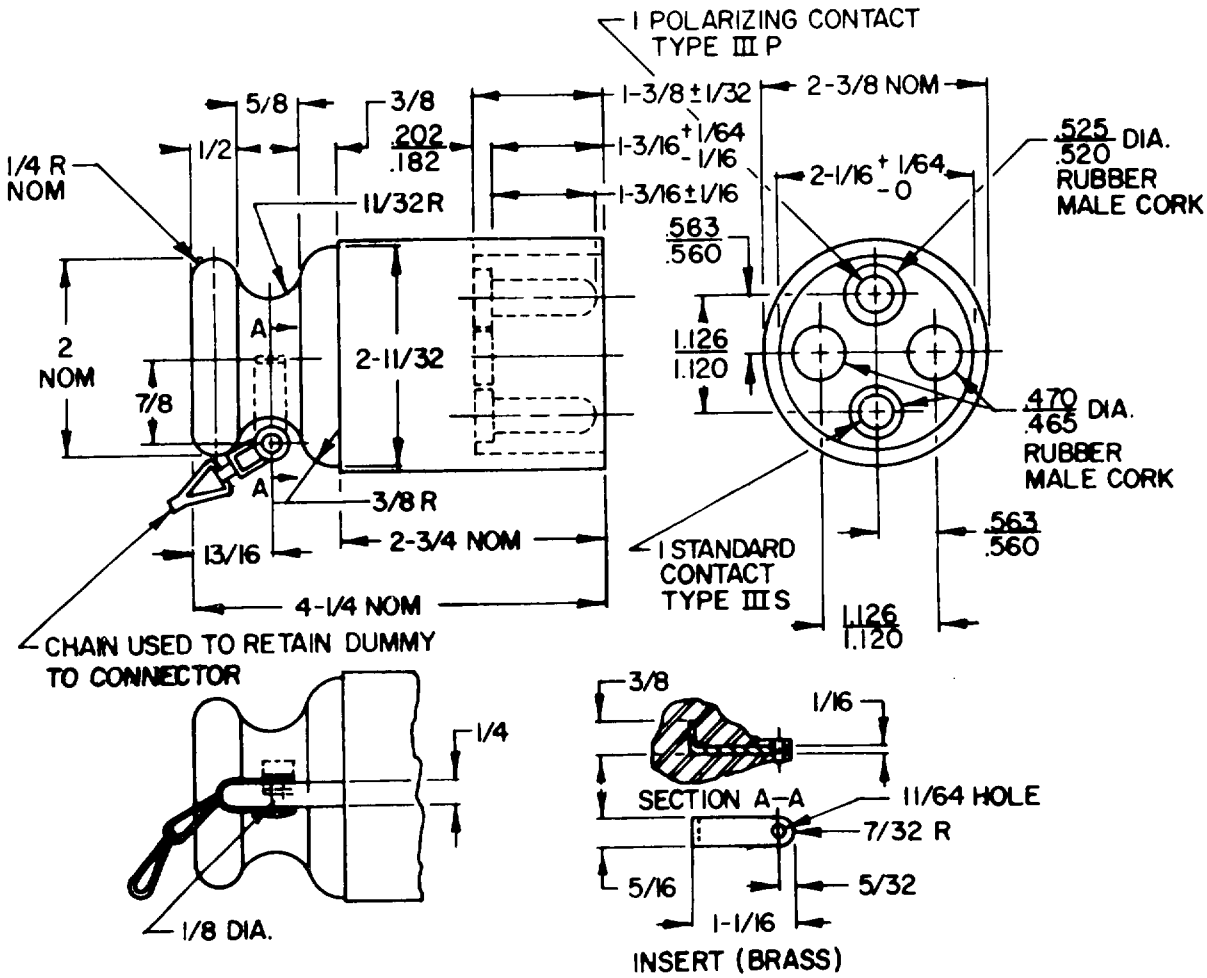

NOTE:

1. ALL DIMENSIONS ARE IN INCHES.

Figure 20. MOLDED DUMMY.

BX1789

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.


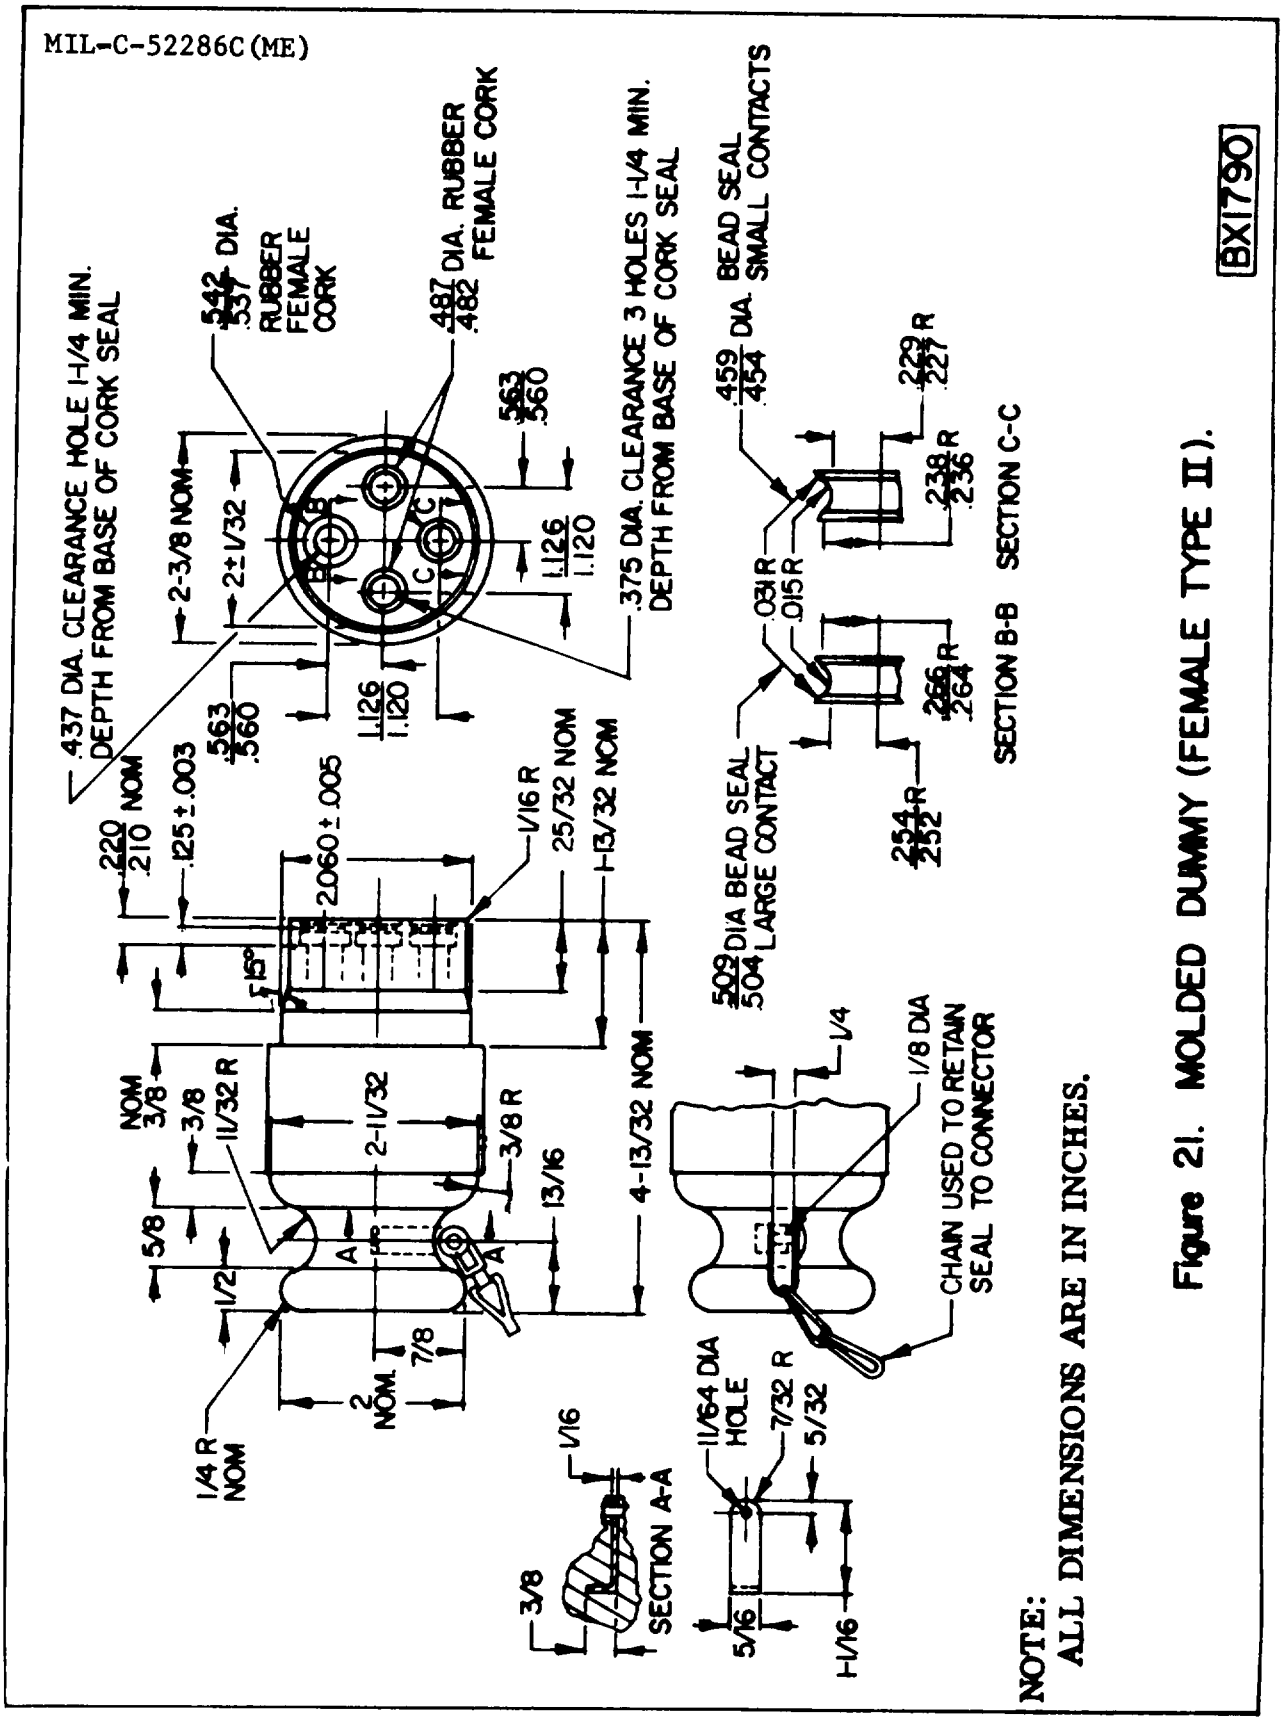


Figure 21. MOLDED DUMMY (FEMALE TYPE II).

BX1790

NOTE:
ALL DIMENSIONS ARE IN INCHES.

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

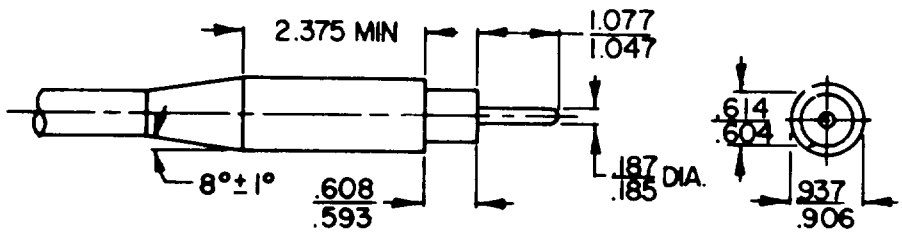


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 25 AMPERE, 1500 VOLTS TO GROUND.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 LBS.

Figure 22. CONNECTOR, PLUG, MALE, SINGLE POLE.

BX1791

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

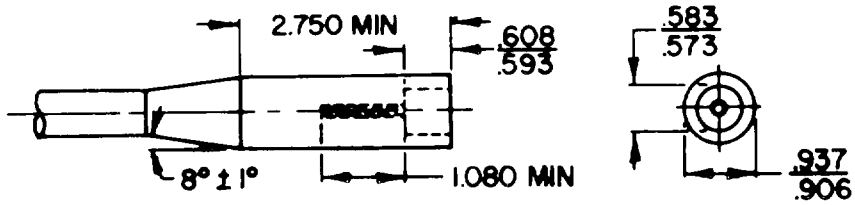


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 25 AMPERE, 1500 VOLTS TO GROUND.
3. SOCKET SHALL BE RECESSED 1/8 MAX.
4. SOCKET ID=.189/.186 BEFORE SPLITTING.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 LBS.

Figure 23. CONNECTOR, PLUG, FEMALE, SINGLE POLE.

BX1792

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

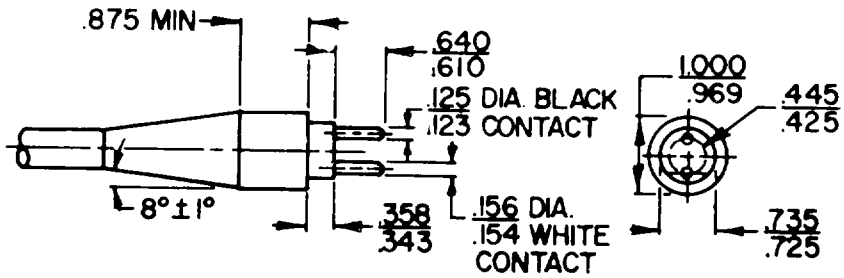


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 LBS.

Figure 24. CONNECTOR, PLUG, MALE, TWO-POLE.

BX1793

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

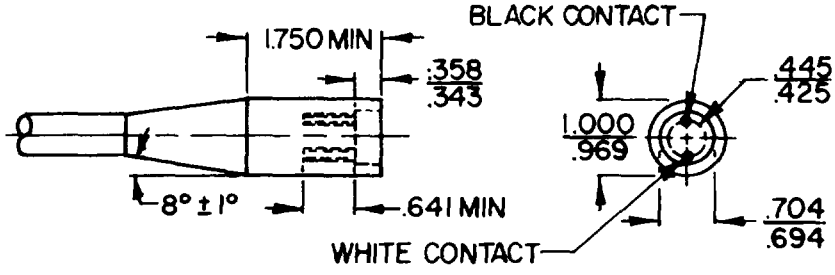


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. SOCKETS SHALL BE RECESSED 1/8 MAX.
4. BEFORE SPLITTING, LARGE SOCKET I.D. 0.158 MAX. 0.156 MIN & SMALL SOCKET I.D. 0.127 MAX. 0.125 MIN.
5. CONNECTING AND DISCONNECTING FORCE: 10-35 LBS.

Figure 25. CONNECTOR, PLUG, FEMALE, TWO-POLE.

BX1794

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

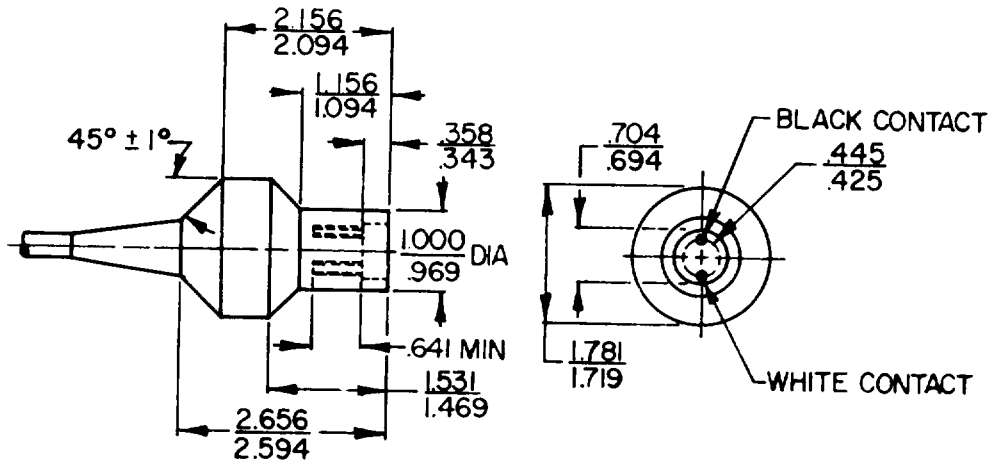


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATI NG: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. SOCKETS SHALL BE RECESSED 1/8 MAX.
4. BEFORE SPLITING, LARGE SOCKET I. D. =0. 158 MAX. /0. 156 MIN. AND SMALL SOCKET I. D. = 0. 127 MAX. /0. 125 MIN.

Figure 26. CONNECTOR, PLUG, FEMALE, TWO-POLE.

BX1795

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

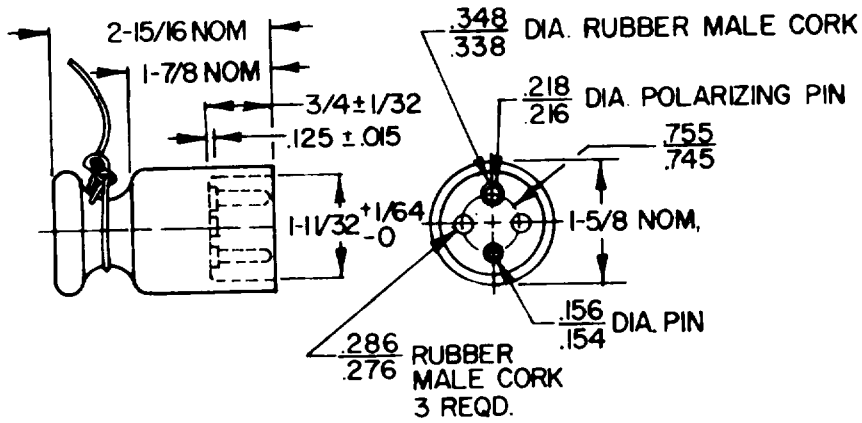


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 LBS.
4. DUMMY PLUG SHALL BE EQUIPPED WITH COTTON TWINE 14 INCHES LONG.

Figure 27. DUMMY CONNECTOR, PLUG, MALE.

BX1796A

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

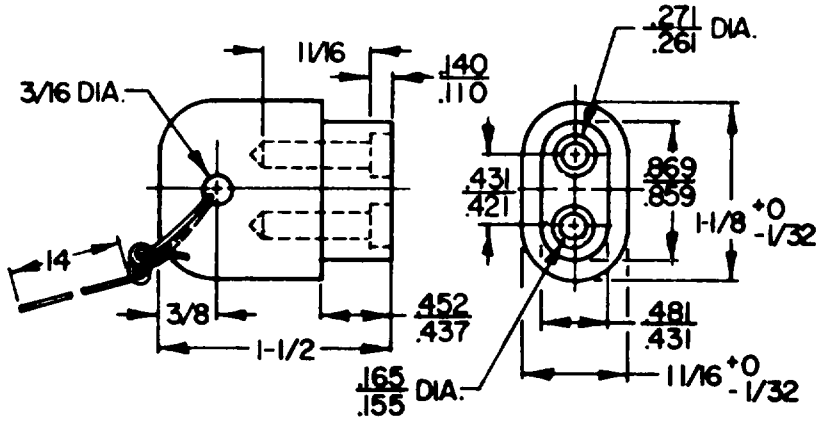


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. DUMMY PLUG SHALL BE EQUIPPED WITH COTTON TWINE.

Figure 28. DUMMY CONNECTOR, PLUG, FEMALE.

BX1797

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

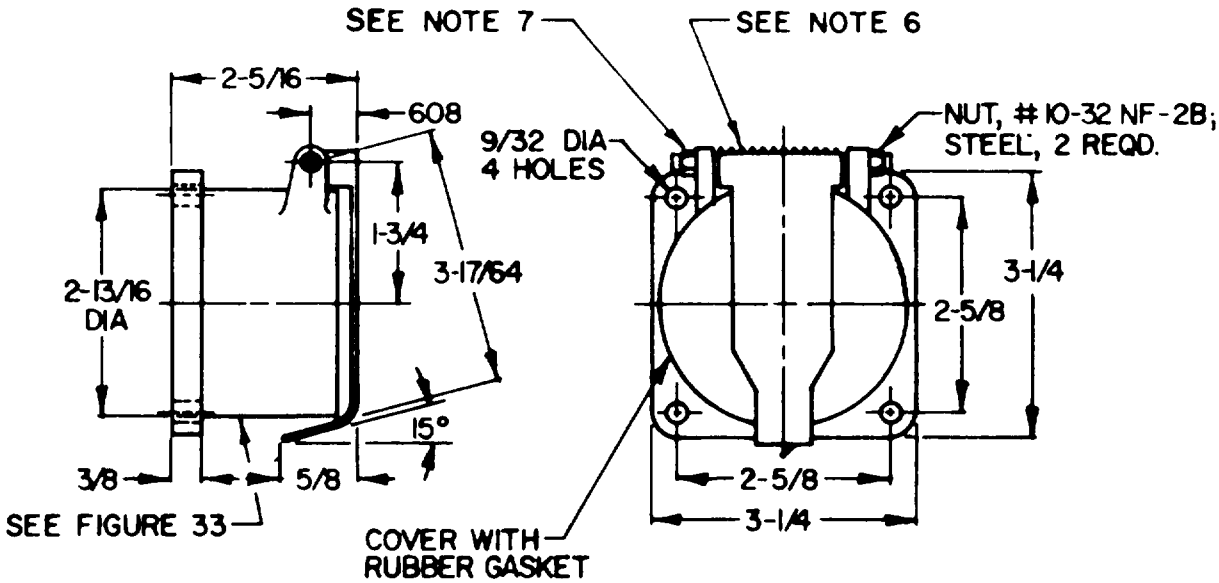


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 600 VOLTS, 65 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 40-100 POUNDS.
4. CADMIUM OR ZINC PLATE ALL STEEL PARTS.
5. USED WITH INSERTS, FIGURE 35 AND FIGURE 48.
6. SPRING DATA:
   - A. MATERIAL: STEEL
   - B. WIRE DIA: 090
   - C. INSIDE DIA: 9/32
   - D. FREE LENGTH: 1 3/16
   - E. NUMBER OF COILS: 11 7/8
7. PIN DATA:
   - A. MATERIAL: STEEL
   - B. LENGTH: 2 3/4
   - C. THREAD: #10-32 NF-2A (BOTH ENDS)

Figure 4. Shell, connector, electrical.

BX1798

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

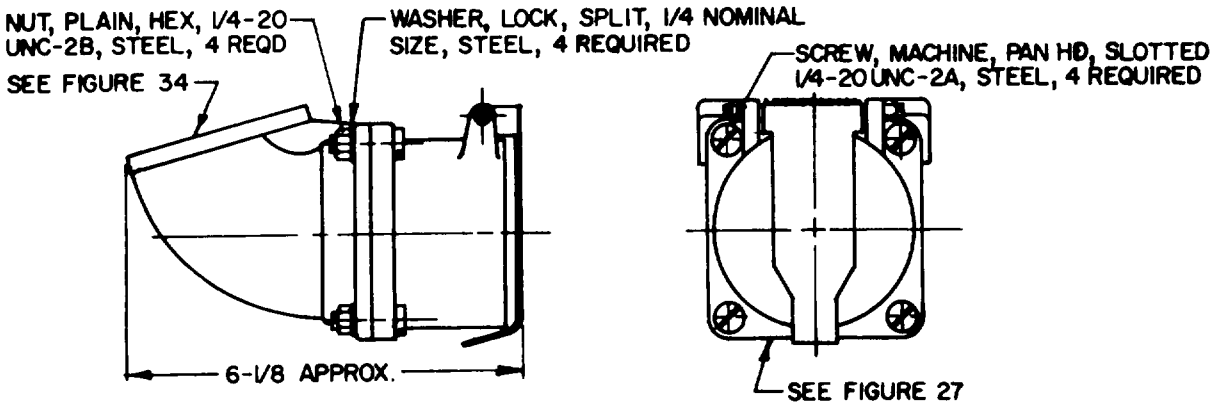


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. CAD. OR ZINC PLATE ALL STEEL PARTS.
3. USED WITH INSERT, FIGURE 43.

Figure 30. SHELL, CONNECTOR, ELECTRICAL.

BX1799

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

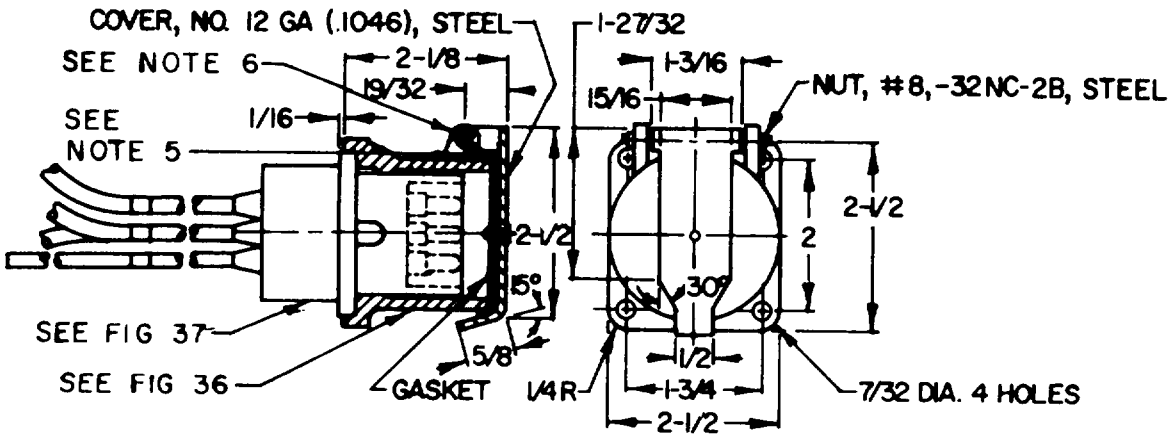


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 600 VOLTS, 20 AMPERES.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. CADMIUM OR ZINC PLATE ALL STEEL PARTS.
5. SPRING DATA:
   - A. MATL: STEEL
   - B. WIRE DIA: .063
   - C. OUTSIDE DIA: .366
   - D. LENGTH: 1 5/32
   - E. NO. OF COILS: 13 3/4
6. PIN DATA:
   - A. MATL: STEEL
   - B. DIA: 5/32
   - C. LENGTH: 2 9/32
   - D. THREAD: NO. 8-32 NC-2A (BOTH ENDS)

Figure 31. CONNECTOR, RECEPTACLE, ELECTRICAL.

BX1800

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

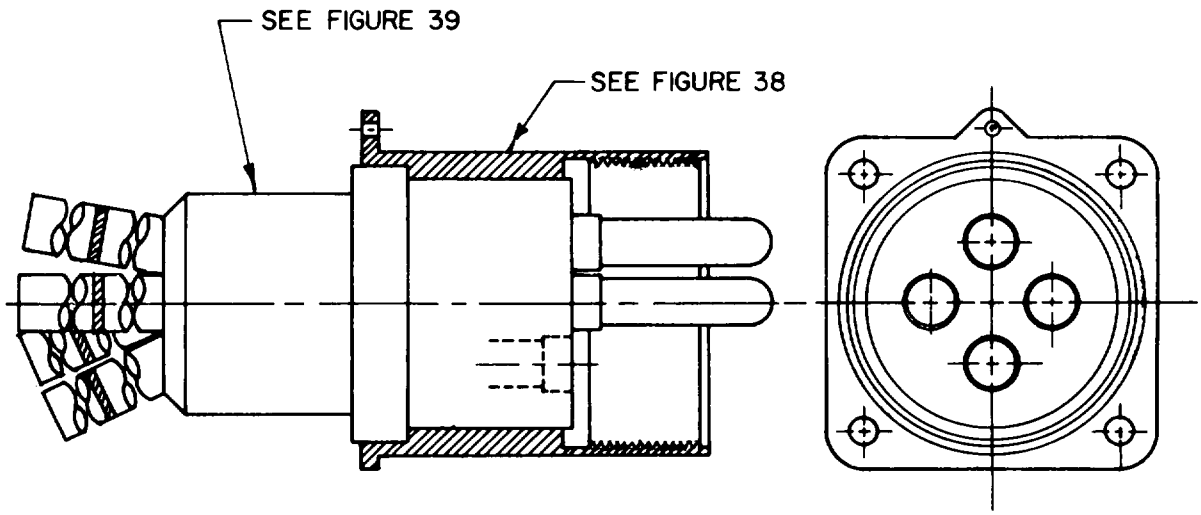


NOTES:
1. RATING: 600 VOLTS, 230 AMPERES.
2. CONNECTING AND DISCONNECTING FORCE: 15 TO 35 POUNDS.

Figure 32. CONNECTOR, RECEPTACLE, ELECTRICAL.

BX1801

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

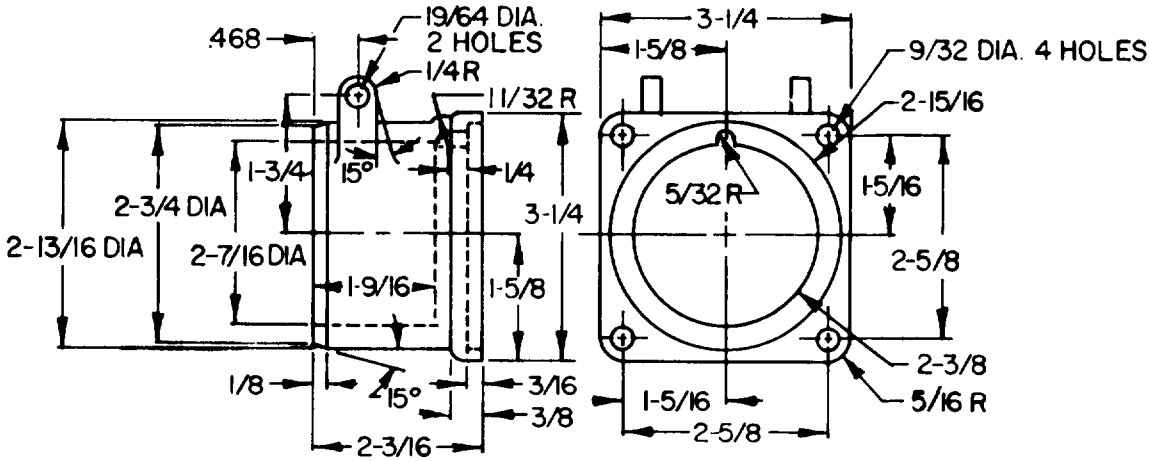


NOTE:

1. ALL DIMENSIONS ARE IN INCHES.

Figure 33. SHELL, CONNECTOR, ELECTRICAL.

BX1802

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

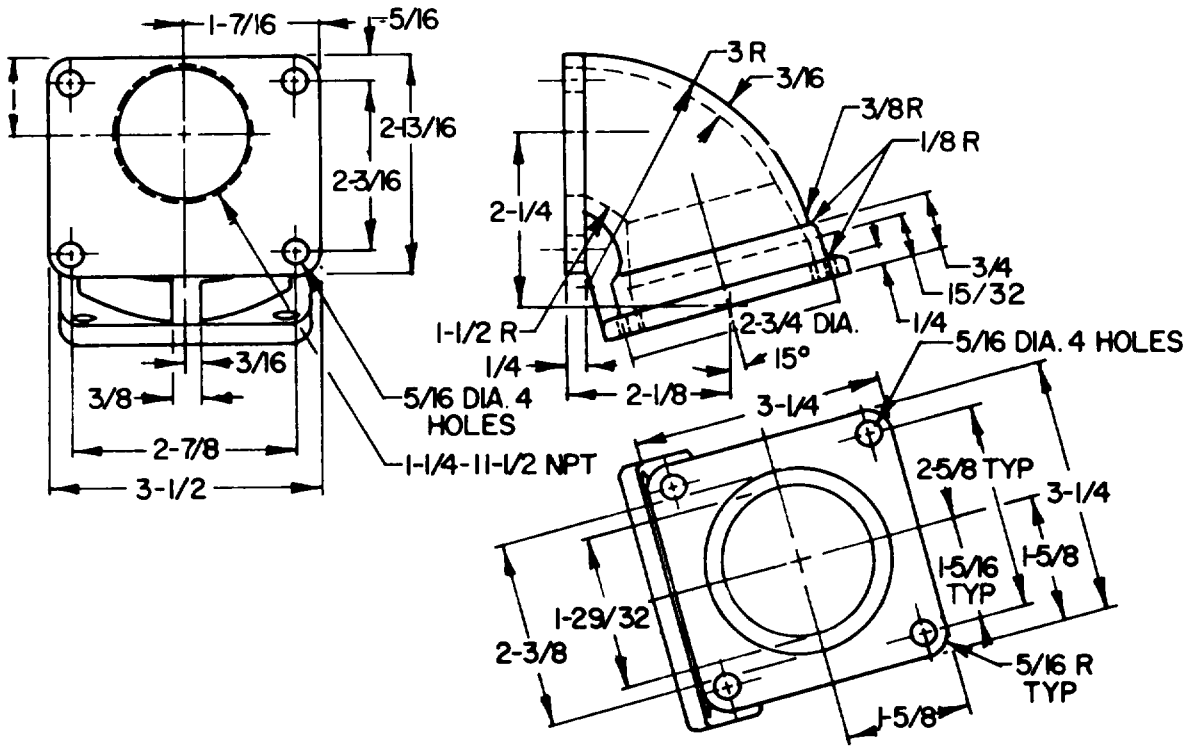


NOTE:
1. ALL DIMENSIONS ARE IN INCHES.

Figure 34. SHELL, CONNECTOR, ELECTRICAL.

BX1803A

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

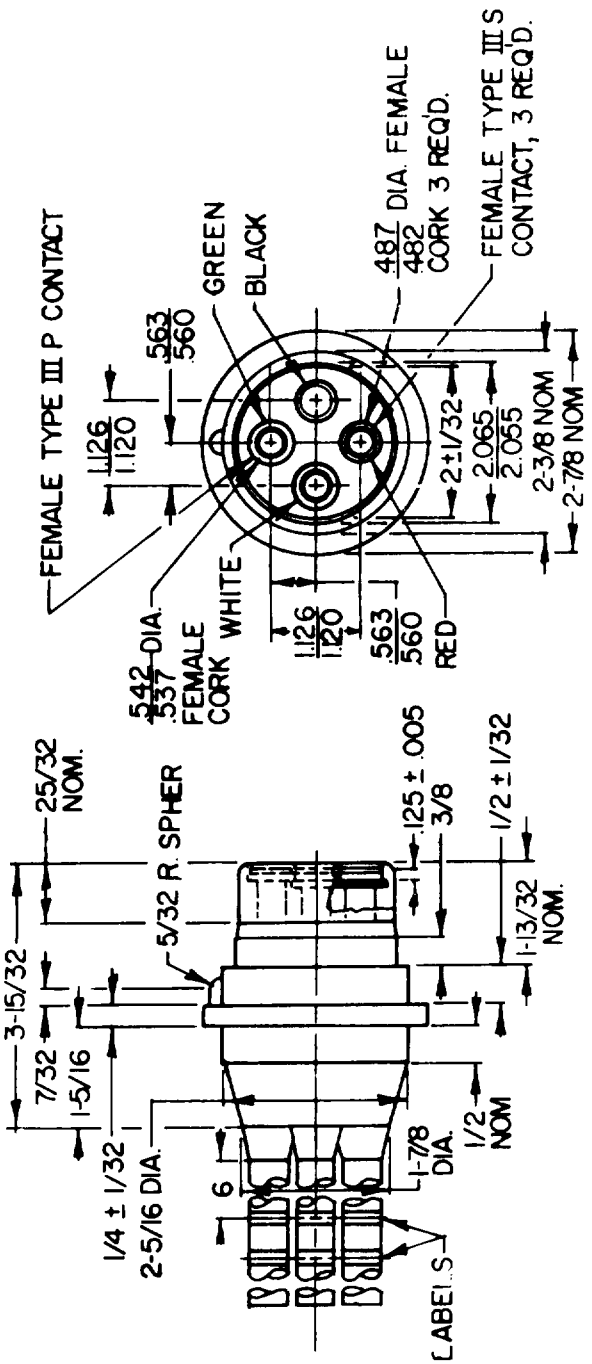


NOTE:
ALL DIMENSIONS ARE IN INCHES.

BX1804

Figure 35. INSERT, CONNECTOR, ELECTRICAL, FEMALE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

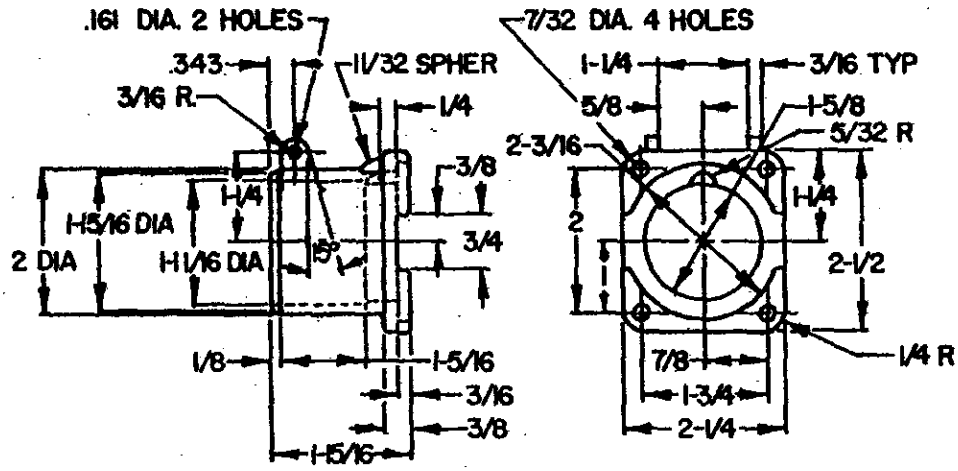


NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 36. SHELL, CONNECTOR, ELECTRICAL.

BXI805

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

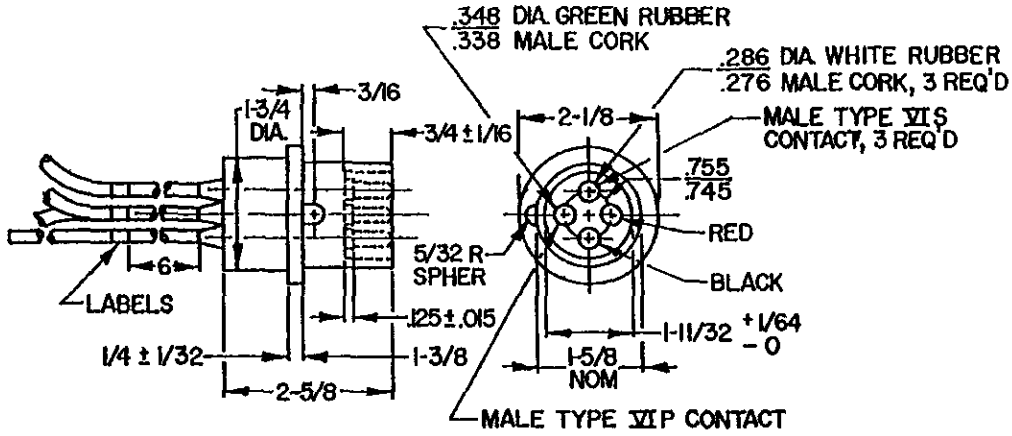


NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 37. INSERT, ELECTRICAL, CONNECTOR, MALE.

BX1806

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

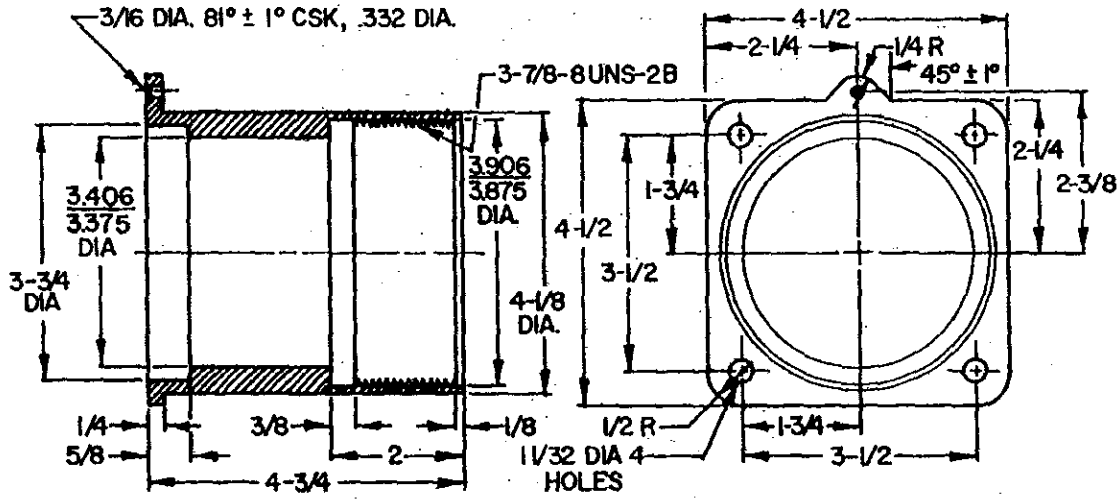


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. USED WITH INSERT FIGURE 39.

Figure 38. SHELL, CONNECTOR, ELECTRICAL.

BX1807

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

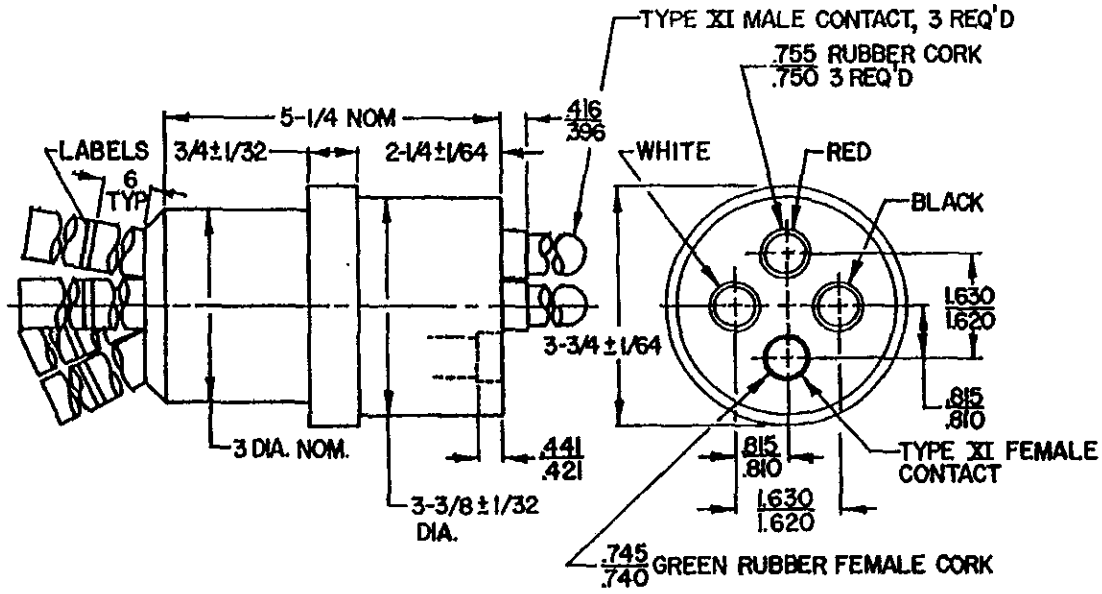


NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 39. INSERT, CONNECTOR, ELECTRICAL, MALE.

BX1808

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

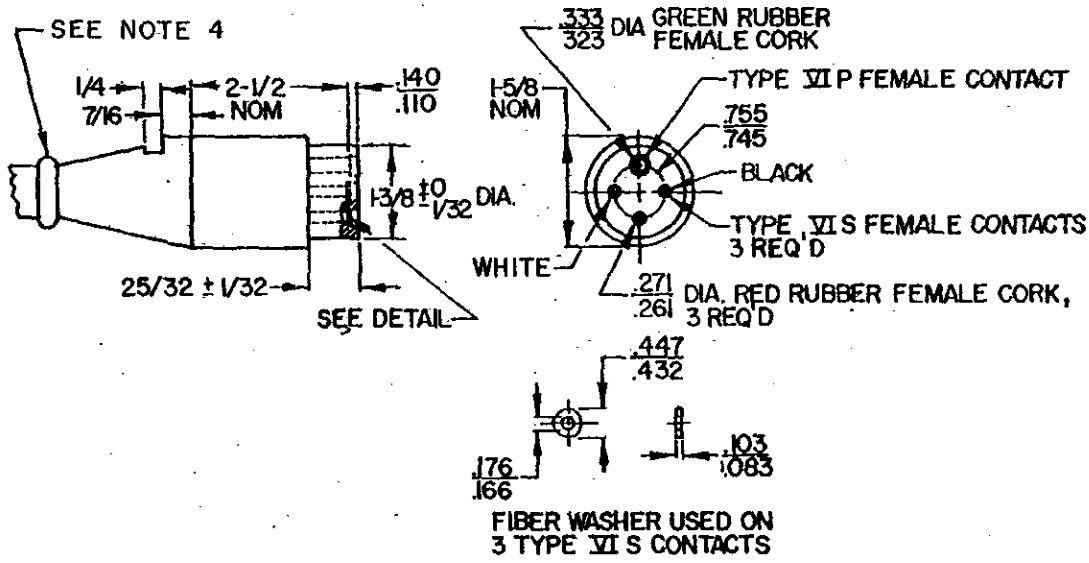


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND.
3. CONNECTING AND DISCONNECTING FORCE: 10-35 POUNDS.
4. DIMENSIONS OF GROOVE TO BE SUFFICIENT TO RETAIN A 1/8 DIA CORD OR TWINE TIED ON TO THE CONNECTOR. SHAPE AND POSITION NEED NOT BE AS SHOWN.

Figure 40. CONNECTOR, PLUG, ELECTRICAL, FEMALE.

BXI809

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

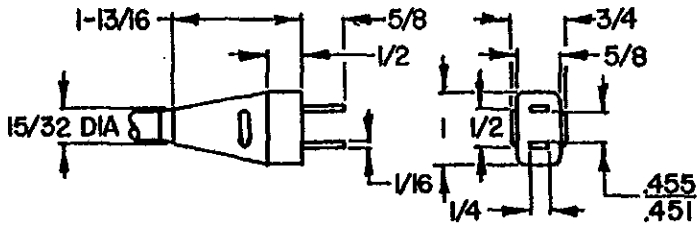


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND, 20 AMPERES.
3. CONNECT AND DISCONNECT FORCE: 10-35 POUNDS.

Figure 41. CONNECTOR, PLUG, MALE, TWO-POLE.

BX1810

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.

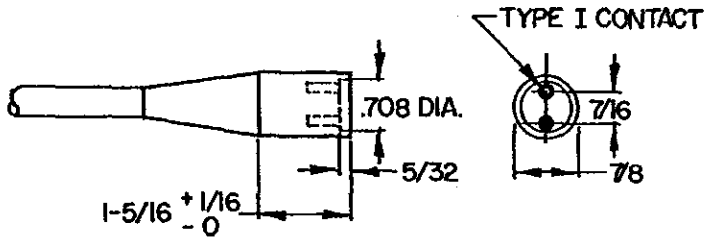


NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 600 VOLTS BETWEEN CONTACTS, 1500 VOLTS TO GROUND, 20 AMPERES.
3. CONNECT AND DISCONNECT FORCE: 10-35 POUNDS.

Figure 42. CONNECTOR, PLUG, FEMALE, TWO-POLE.

BX1811

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

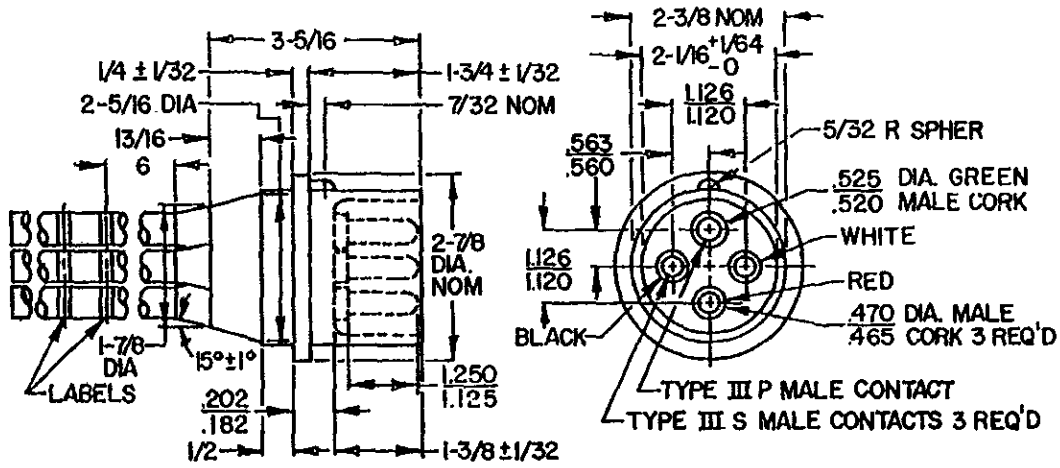

NOTE:
ALL DIMENSIONS ARE IN INCHES.

Figure 43. INSERT, CONNECTOR, ELECTRICAL, MALE.

BX1812

Source: https://assist.dla.mil -- Downloaded: 202610-26T04:07Z
Check the source to verify that this is the current version before use.

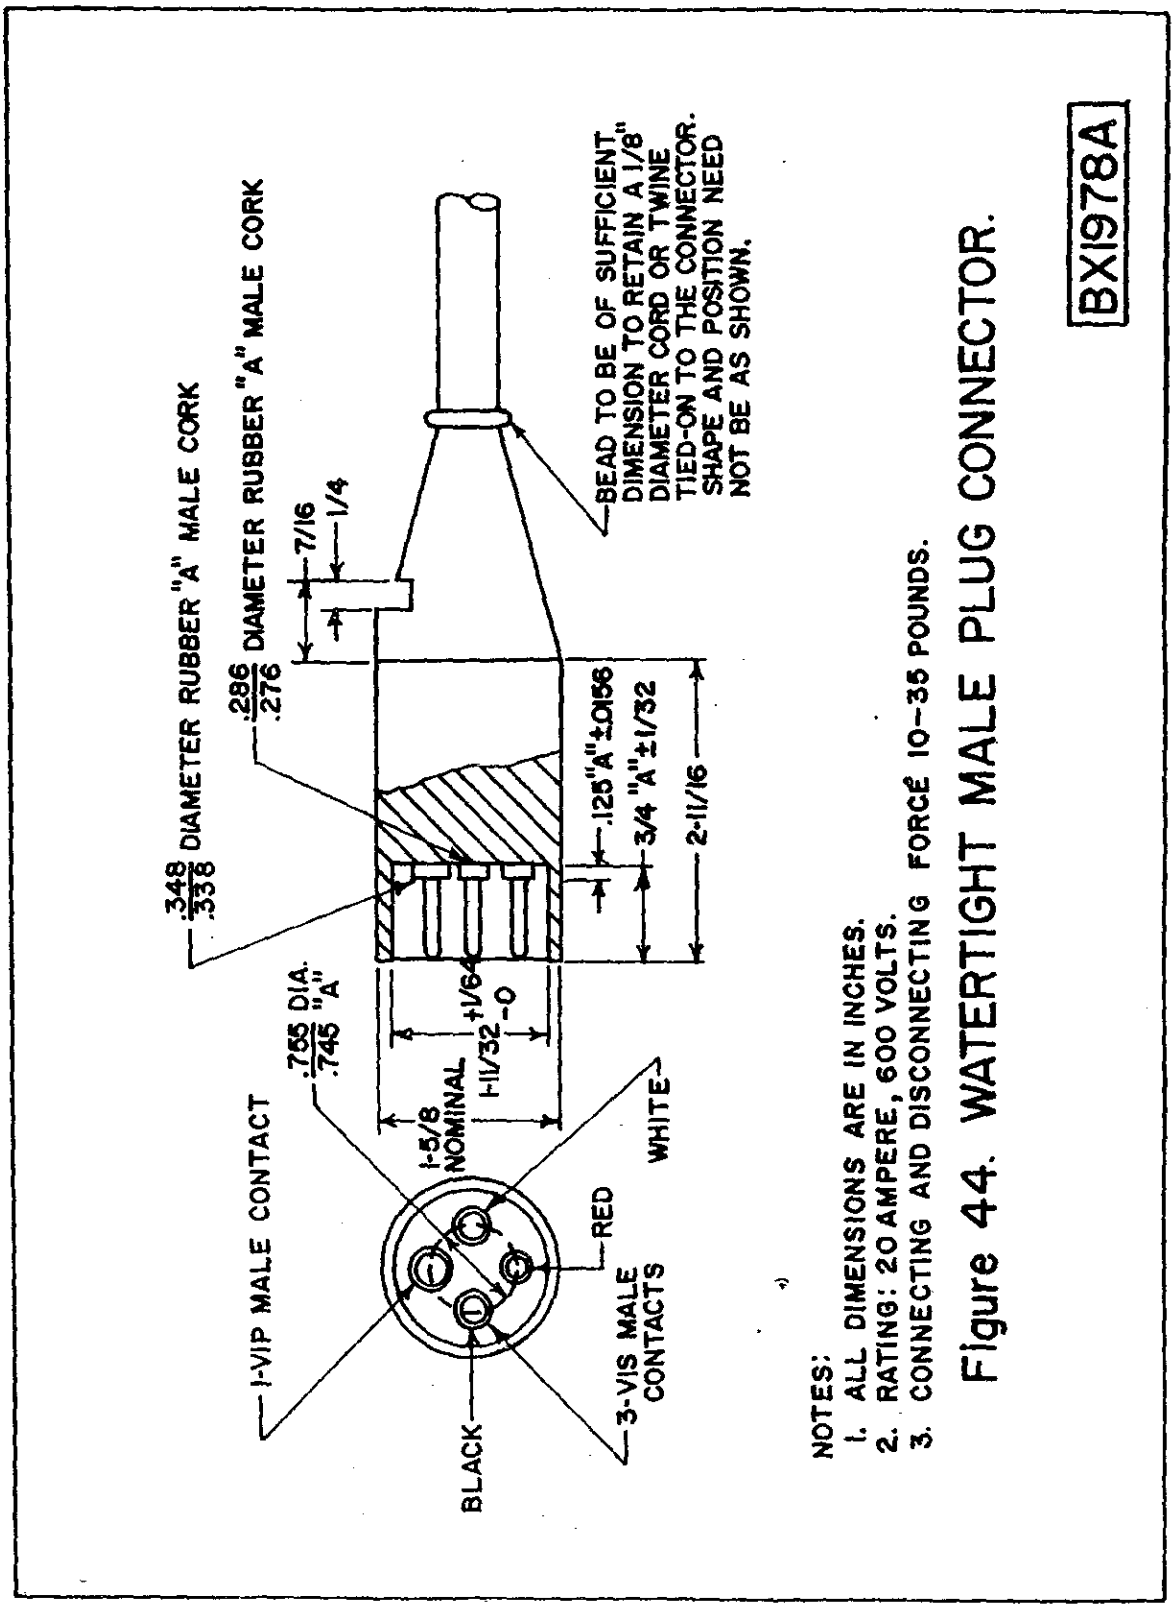


Figure 44. WATERTIGHT MALE PLUG CONNECTOR.

NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
2. RATING: 20 AMPERE, 600 VOLTS.
3. CONNECTING AND DISCONNECTING FORCE 10-35 POUNDS.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T04:07Z
Check the source to verify that this is the current version before use.