
W-F-1814/67A
February 20, 1987
SUPERSEDING
W-F-1814/67
October 21, 1982

FEDERAL SPECIFICATION SHEET

FUSES, CARTRIDGE, HIGH-INTERRUPTING CAPACITY, CLASSES RK1 AND RK5 (CURRENT-LIMITING) 600 VOLTS, 401-600 AMPERES

This specification is approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue in effect of specification W-F-1814/GEN.

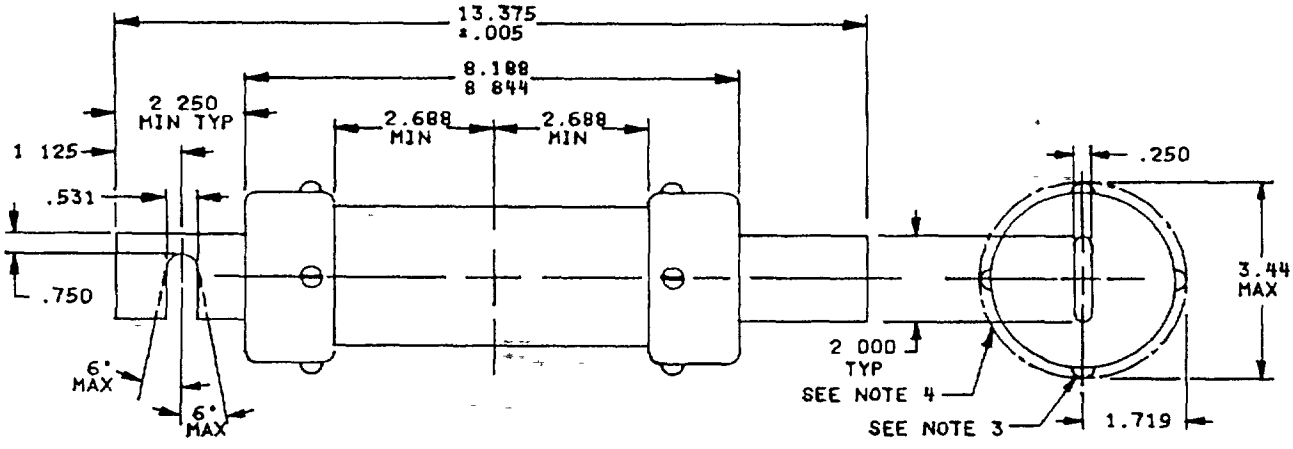

Inches	mm
.005	0.13
.250	6.35
.531	13.49
1.125	28.58
1.719	43.66
2.000	50.80
2.25	57.2
2.688	68.28
3.44	87.4
8.188	207.98
8.844	224.64
13.375	339.72

NOTES
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Use of screw, pin, or rivet is optional.
4. The dashed line represents the limit of the maximum projection of a screw, rivet head, or the like

FIGURE 1. Classes RK1 and RK5 fuses, 600 volts, 401-600 amperes.

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:37Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction See figure 1.

Physical Nonrenewable.

Terminals: Knife blade type.

Material Copper or copper alloy.

Strength. 5 inch-pound torque between body and blades.

Body.

Insulating material. Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical.

Voltage: 600 volts or less.

Frequency. 48 to 60 hertz.

Current. See table I.

Current carrying capacity. 110 percent indefinitely with temperature rise not to exceed 50°C (90°F) above ambient on the body and 75°C (135°F) on the blades.

Overload interrupt

Instantaneous. Shall interrupt within 2 hours at 135 percent of rated current and within 12 minutes at 200 percent of rated current.

Time delay. In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 10 seconds.

Interrupting capacity rating 200,000 amperes rms symmetrical at 600 volts, 48 to 60 hertz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Threshold ratio. 30 maximum for RK1, 65 maximum for RK5.

Peak let-thru current. See table II.

Maximum clearing I^2T See table II.

Applicable fuseholder Part number W-F-870/8-08 of W-F-870/8.

Government part number The government part number shall consist of the prefix "WF1814/67-" followed by the part number designation shown in table I.

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:37Z
Check the source to verify that this is the current version before use.

TABLE I. Current rating and part number designation.

Current in amperes	Part number designation			
	RK5		RK1	
	Instantaneous	Time delay	Instanta-neous	Time delay
450	F5450	D5450	F1450	D1450
500	F5500	D5500	F1500	D1500
600	F5600	D5600	F1600	D1600

TABLE II. Peak let-thru and I^2T current.

	Between threshold and 50 kA		100 kA		200 kA	
	RK1	RK5	RK1	RK5	RK1	RK5
Maximum acceptable peak let-thru current ($I_p \times 10^3$)	43	65	50	80	70	100
Maximum clearing I^2T (amperes squared seconds) ($I^2T \times 10^3$)	3000	10000	3000	10000	4000	12000

MILITARY INTERESTS

Custodians

Army - ER
Navy - YD
Air Force - 85

Review Activities

Army - AL, AT, ME
Air Force - 99
DLA - ES
NS

User Activities

Army - AR
Navy - OS

CIVIL AGENCY COORDINATING ACTIVITIES.

DOE - DOE
COMMERCE - NBS
DOT - ACO, APM
GPO - GPO
GSA - FSS
JUSTICE - FPI
NASA - JFK, LRC
USPS - POS
VA - OSS

PREPARING ACTIVITY

DLA - ES

(Project 5920-0434-12)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:37Z
Check the source to verify that this is the current version before use.