INCH-POUND
A A 55558
18 January 1995

COMMERCIAL ITEM DESCRIPTION

CONNECTOR RECEPTACLE ELECTRICAL UTILITY POWER 15 AMP 125 VOLT 50/60 HERTZ WITH COVER

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE This CID covers the general requirements for a power receptacle with a cover for wet location applications Parts covered by this CID are intended for commercial/industrial applications and military system applications that do not have stringent environmental electrical and mechanical requirements

2 CLASSIFICATION This CID uses a classification system which is included in the Part or Identification Number (PIN) (see 6 1)

3 SALIENT CHARACTERISTICS

3 1 Configuration and dimensions Configuration and dimensions shall be as specified on figure 1 and table I

3 2 Receptacle

General purpose general grade duplex 2 pole 3 wire grounding 15 ampere 125 volt 50/60 hertz NEMA configuration number 5-15R

Color shall be brown

Receptacle shall be a qualified connector to W-C-596/12 PIN WC596/12-2

3 3 Cover

Metallic or Non-metallic two door independent self closing for a standard mounting box and for horizontal mounting

Cover plate shall be for wet location applications with cover 'open in accordance with UL 514A for metallic type or in accordance with UL 514C for non metallic type

3 4 Item of supply


One item of supply shall be one receptacle one cover and any related hardware ie screws gaskets etc necessary for installation in one package

---

Beneficial comments recommendations additions deletions clarifications etc and any other data which may improve this document should be sent to Defense Electronics Supply Center ATTN DESC-ELDI 1507 Wilmington Pike Dayton OH 45444-5765 or telephone (513) 296-5391 or facsimile (FAX) (513) 296 8868

DISTRIBUTION STATEMENT A Approved for public release distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

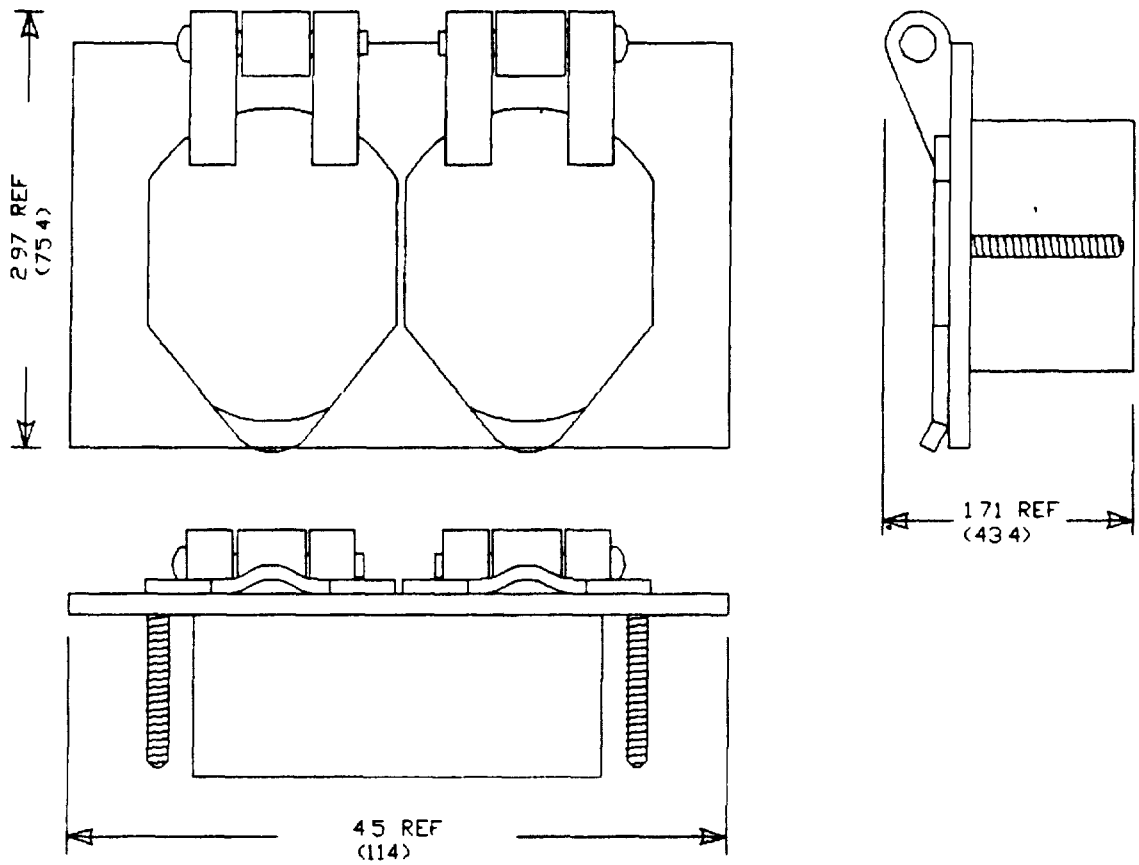

NOTES

1 Dimensions are in inches
2 Metric equivalents are given in parentheses for general information only

Figure 1 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

4 QUALITY ASSURANCE PROVISIONS

4 1 Contractor certification The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID and that the product conforms to the producer s own drawings specifications standards quality assurances practices and is the same as the product provided as a bid sample if a bid sample is requested The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract


4 2 Certificate of compliance A certificate of compliance shall be submitted to DESC in order for the contractor to be placed on this document as a suggested source of supply

5 PACKAGING

5 1 Preservation, packaging packing, labeling, and marking Preservation packaging labeling and marking shall be as specified in the contract or purchase order

6 NOTES This section contains relevant information which is useful to buyers users and suppliers in the process of procuring the item but is not mandatory

6 1 Part Identification Number (PIN) The following part identification numbering procedure is for government purposes and does not constitute a requirement for the contractor

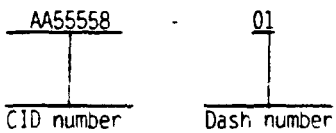

6 2 Referenced documents The following documents of the issue in effect on date of invitation for bids for request for proposal form a part of this CID to the extent specified herein

6 2 1 Federal Specification

W-C-596 - Connector Electrical Power General Specification for
W-C-596/12 - Connector Receptacle Electrical etc

(Unless otherwise indicated copies of federal specifications are available from the Defense Printing Service Detachment Office Building 4D (Customer Service) 700 Robbins Avenue Philadelphia PA 19111-5094)

6 2 2 Underwriters Laboratories, Inc , (UL) Standard

UL 514A - Box Metallic Outlet Standard for
UL 514C Box Non-metallic Outlet Flush Device Boxes and Covers

(Application for copies should be addressed to the Underwriters Laboratories Inc Publication Stock 333 Pfingsten Road Northbrook Illinois 60062)

6 2 3 National Electrical Manufacturers Association (NEMA) Publications

WD 6 - Wiring Devices - Dimensional Requirements

(Application for copies should be addressed to National Electrical Manufacturers Association 2101 L Street N W Suite 300 Washington D C 20037)

6 3 Government users To acquire information on obtaining these connectors from the Government inventory system contact Defense Electronics Supply Center ATTN DESC-EON 1507 Wilmington Pike Dayton OH 45444-5522 or telephone (513) 296-5009

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

6 4 Ordering data Acquisition documents should specify the following

a CID document number and revision and CID PIN

b Quality assurance provisions

c Packaging requirements

6 5 Suggested sources of supply Suggested sources of supply are listed in table I Additional sources will be added as they become available

TABLE I Suggested sources of supply

CID PIN AA55558	Vendor s Commercial PIN	Vendor s CAGE number	NSN
01	5262 W/5205WO	12497	5935-00-716-3297
	30501/270B	2H306	
	WR81C	84258	
	5262 W/5205WO	9A329	

Vendor CAGE number	Vendor name and address
12497	The John A Becker Co 1341 East Fourth St Dayton OH 45402-2235
2H306	Doylestown Electric 3683 Easton Rd Doylestown PA 18901
84258	Avon Electrical Supplies Inc 901 Motor Pkwy Hauppauge NY 11788
9A329	Consolidated Electric Supply Co Duellman Electric Div 131 Wayne Ave P O Box 771 Dayton OH 45401

CIVIL AGENCY COORDINATING ACTIVITY

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

(Project 5935-D527)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.