INCH-POUND

MIL-V-11583D
28 November 1989
SUPERSEDING
MIL-V-11583C
4 October 1979

MILITARY SPECIFICATION

VALVE SECTIONS, PIPELINE: FOR

PORTABLE PIPELINES

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers valve sections for use in grooved-type, portable, steel, fuel handling pipelines.

1.2 Classification. Valve sections should be of the following types, classes, and sizes, as specified (see 6.2):

Type I - 3-foot pipeline valve sections (class 2, 12-inch check valve section shall be 42 inches long).
Class 1 - Gate valve section.
Class 2 - Check valve section.
Class 3 - Plug valve section.

Type II - 20-foot pipeline valve sections.
Class 1 - Gate valve section.
Class 2 - Check valve and gate valve section.

Sizes:

4-inch.
6-inch.
8-inch.
12-inch.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: USA Belvoir Research, Development, and Engineering Center, ATTN: STRBE-TSE, Fort Belvoir, VA 22060-5606 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 3835

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

1.2.1 International standardization agreements. Certain provisions of this specification, including all dimensions of the valve sections, valves, connections, and sizes of pipe are the subject of international standardization agreements, NATO STANAG 2761 and QSTAG-240 (see 6.5).

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation (see 6.2).

SPECIFICATIONS

FEDERAL

PPP-B-601	- Boxes, Wood, Cleated-Plywood.
PPP-B-621	- Boxes, Wood, Nailed and Lock-Corner.
PPP-B-636	- Boxes, Shipping, Fiberboard.
PPP-P-40	- Preservation and Packaging of Hand Tools; Tools and Tool Accessories for Power Driven, Metal and Woodworking Machinery.
PPP-T-60	- Tape: Packaging, Waterproof.

MILITARY

MIL-V-3	- Valves, Fittings, and Flanges (Except for Systems Indicated Herein); Packaging of.
MIL-P-116	- Preservation, Methods of.
MIL-B-121	- Barrier Material, Greaseproofed, Waterproof, Flexible.
MIL-T-704	- Treatment and Painting of Materiel.
MIL-H-775	- Hose, Hose Assemblies; Rubber, Plastic, Fabric, or Metal (Including Tubing); and Associated Hardware: Packaging of.
MIL-H-8795	- Hose Assemblies, Rubber, Hydraulic, Fuel and Oil Resistant.
MIL-V-10386	- Valves, Check: Swing, Cast-Iron and Steel.
MIL-C-10387	- Couplings, Clamp, Pipe: with Bolts and Synthetic-Rubber Gaskets for Grooved-End Pipe.
MIL-P-10388	- Pipe Fittings: One or More Ends Grooved.
MIL-V-11201	- Valves, Safety Relief, Angle, Brass or Bronze, Extra-Heavy, for Gasoline Service.
MIL-V-12003	- Valves, Plug: Cast-Iron or Steel Manually Operated.
MIL-V-13803	- Valve, Gate: Double-Disk, Cast-Iron or Steel.
MIL-B-26195	- Boxes, Wood-Cleated, Skidded, Load-Bearing Base.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

STANDARDS

MILITARY

MIL-STD-105	- Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	- Marking for Shipment and Storage.
MIL-STD-130	- Identification Marking of US Military Property.
MIL-STD-889	- Dissimilar Metals.
MIL-STD-1186	- Cushioning, Anchoring, Bracing, Blocking and Waterproofing; with Appropriate Test Methods.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from the Naval Publications and Forms Center, (ATTN; NPODS), 5801 Tabor Avenue, Philadelphia, PA 19120-5099.)

2.2 Non-Government publications. The following documents form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DOD adopted are those listed in the issue of the DODISS specified in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issue of the documents cited in the solicitation (see 6.2).

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B18.2.1 - Square and Hex Bolts and Screws Inch Series.

(Application for copies should be addressed to the American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.)

(Non-Government standards and other publications are normally available from the organizations which prepare or which distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein (except for associated detail specifications, specification sheets or MS standards), the text of this specification shall take precedence. Nothing in this specification, however, shall supersede applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 Description. The valve sections shall consist of a valve or valves, flanged adapters, grooved type couplings, and coupling clamps. The valve sections shall be as shown in figure 1, and as specified herein.

3.2 First article. Unless otherwise specified (see 6.2), a sample shall be subjected to first article inspection (see 6.3) in accordance with 4.3.

3.3 Materials. Materials shall be as specified herein. Materials not specified shall be selected by the contractor and shall be subject to all provisions of this specification.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

3.3.1 Material deterioration prevention and control. The pipeline valve sections shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide protection against the various forms of corrosion and deterioration that may be encountered in any of the applicable operating and storage environments to which the pipeline valve sections may be exposed.

3.3.1.1 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion. Dissimilar metals and methods of protection are defined and detailed in MIL-STD-889.

3.3.1.2 Identification of materials and finishes. The contractor shall identify the specific material, material finish or treatment for use with component and subcomponent, and shall make information available upon request to the contracting officer or designated representative.

3.3.2 Recovered materials. For the purpose of this requirement, recovered materials are those materials which have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the pipeline valve sections may be newly fabricated from recovered materials to the maximum extent practicable, provided the pipeline valve sections produced meet all other requirements of this specification. Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the pipeline valve sections.

3.4 Type I, 3-foot pipeline valve sections. Type I pipeline valve sections shall consist of a gate, check, or plug valve, as applicable, bolted to adapters as shown in figure 1. Type I valve sections shall be furnished fully assembled and shall be 36 inches long; except that class 2, 12-inch valve sections shall be 42 inches long. Tolerance for length shall be ±.125-inch.

3.4.1 Class 1 gate valves. The gate valves for class 1 valve sections shall be in accordance with MIL-V-13803, size and class as specified (see 1.2 and 6.2).

3.4.2 Class 2 check valves. The check valves for class 2 valve sections shall be in accordance with MIL-V-10386, size and class as specified (see 1.2 and 6.2).

3.4.3 Class 3 plug valves. The plug valves for class 3 valve sections shall be in accordance with MIL-V-12003, type I, venturi pattern, size and class as specified (see 1.2 and 6.2).

3.4.4 Adapters. Flanged-to-grooved adapters shall be in accordance with MIL-P-10388, steel, pipe size as specified (see 1.2 and 6.2). The flanges of the adapter shall be the same type and class as the flanges on the valve.

3.4.4.1 Flange bolts. Flange bolts shall be hexagon head and shall be in accordance with the applicable requirements of ASME B18.2.1.

3.4.4.2 Gaskets. Flange gaskets shall be provided. When specified (see 6.2), extra gaskets shall be furnished.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

3.4.5 Pressure-relief assembly. When specified (see 6.2), a pressure-relief assembly shall be furnished for type I, class 1 and class 3 valve sections. The pressure-relief assembly shall consist of a pressure-relief valve, two .500-inch pipe half couplings welded to the adapters, a hose assembly, and the necessary fittings to complete the assembly.

3.4.5.1 Pressure-relief valve. The pressure-relief valve shall be in accordance with MIL-V-11201, class 2, .500-inch size, bronze, angle pattern. The valve shall be preset to open at 600 pounds per square inch (psi).

3.4.5.2 Hose assembly. The hose assembly shall be in accordance with MIL-H-8795, size 10, length requireed to complete the assembly.

3.5 Type II, 20-foot pipeline valve sections. Type II pipeline valve sections shall consist of one or more type I valve sections, two grooved-end couplings, and coupling clamps assembled to form a pipeline valve section as shown in figure 1. The overall length shall be 20 feet, ±.250-inch.

3.5.1 Class 1 gate valve section. The class 1 valve section shall consist of one type I, class 1 gate valve section assembled to two grooved-end couplings by two coupling clamps.

3.5.2 Class 2 gate and check valve sections. The class 2 valve section shall consist of one type I, class 1 gate valve section, one type I, class 2 check valve section, two grooved-end couplings, and three coupling clamps.

3.5.3 Couplings. The grooved-end couplings shall be in accordance with MIL-P-10388, steel, both ends grooved, pipe size as specified (see 1.2 and 6.2).

3.5.4 Coupling clamps. The coupling clamps shall be in accordance with MIL-C-10387, class B, malleable iron, ductile iron or steel, grade 1 gasket, size as specified (see 1.2 and 6.2).

3.6 Treatment and painting. The portions of the pipeline valve sections normally painted, internally and externally, shall be cleaned, treated and painted in accordance with MIL-T-704, type F or G, as applicable.

3.7 Identification marking. Each pipeline valve section shall be identified in accordance with MIL-STD-130.

3.8 Labeling. Manually operated valve controls shall be provided with double-ended arrows showing direction of operation, labeled at each end to indicate the functional result (open, close).

3.9 Workmanship. The valve sections shall not leak and shall be free of defects that could affect their serviceability.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of assuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling in quality conformance does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to acceptance of defective material.

4.1.2 Component and material inspection. The contractor is responsible for ensuring that components and materials used are manufactured, examined, and tested in accordance with referenced specifications and standards, as applicable.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.3).
b. Quality conformance inspection (see 4.4).
c. Inspection comparison (see 4.6).
d. Inspection of packaging (see 4.7).

4.3 First article inspection.

4.3.1 Examination. The first article shall be examined as specified in 4.5.1, in the order shown. The presence of one or more defects shall be cause for rejection.

4.3.2 First article tests. The first article shall be tested as specified in 4.5.2, in the order shown. Failure of any test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for examination and tests shall be in accordance with MIL-STD-105.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1. Failure of any examination shall be cause for rejection.

4.4.3 Tests. Samples selected in accordance with 4.4.1 shall be tested as specified in 4.5.2. Failure of any test shall be cause for rejection.

4.5 Inspection procedure.

4.5.1 Examination. The valve sections shall be examined as specified herein for the following defects:

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

101. Materials not as specified (see 3.3).
102. Material deterioration and control not as specified (see 3.3.1).
103. Dissimilar metals not as specified (see 3.3.1.1).
104. Identification of materials and finishes not as specified (see 3.3.1.2).
105. Used, rebuilt, or remanufactured components, pieces or parts incorporated in the valve sections (see 3.3.2).
106. Length of 3-foot valve section lengths not within the specified tolerances (see 3.4).
107. Class 1 gate valves not as specified (see 3.4.1).
108. Class 2 check valves not as specified (see 3.4.2).
109. Class 3 plug valves not as specified (see 3.4.3).
110. Adapters not as specified (see 3.4.4).
111. Flange bolts not as specified (see 3.4.4.1).
112. Gaskets not as specified (see 3.4.4.2).
113. Pressure-relief assembly not as specified (see 3.4.5).
114. Pressure-relief valve not as specified (see 3.4.5.1).
115. Hose assembly not as specified (see 3.4.5.2).
116. Length of 20-foot valve section lengths not as specified (see 3.5).
117. Class 1 gate valve section not as specified (see 3.5.1).
118. Class 2 gate and check valve sections not as specified (see 3.5.2).
119. Couplings not as specified (see 3.5.3).
120. Coupling clamps not as specified (see 3.5.4).
121. Treatment and painting not as specified (see 3.6).
122. Identification marking not as specified (see 3.7).
123. Labeling not as specified (see 3.8).
124. Workmanship not as specified (see 3.9).

4.5.2 Tests.

4.5.2.1 Valve sections. Each valve section shall be subjected to hydrostatic test pressure equal to the maximum working pressure of the valve (see 3.4.1, 3.4.2, and 3.4.3) for 30 minutes. Any evidence of leaks shall constitute failure of this test.

4.5.2.2 Pressure-relief assembly. When a pressure-relief assembly is provided, the valve in the valve section shall be closed. A pressure shall be applied on the intake side of the valve section. Failure of the pressure-relief valve to relieve the pressure at 600 psi, ±25 psi, shall constitute failure of this test.

4.6 Inspection comparison. When first article inspection is specified, the Government may select valve sections at any time during the contract production period and subject these valve sections to the examination specified in 4.5.1 and the tests specified in 4.5.2 to determine that the quality of the selected valve sections is equal to the quality standards established during first article inspection. The inspection will be performed by the Government at a site selected by the Government. Valve sections will be selected at random from those which have been accepted by the Government and will not include the previously inspected first article valve sections.

4.6.1 Inspection failure. Failure of any valve section when inspected as specified in 4.6 may be considered cause for refusal by the Government to continue acceptance of valve sections until objective evidence furnished by the

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

contractor reveals that corrective action has been taken to eliminate the condition which caused the rejection.

4.7 Inspection of packaging.

4.7.1 Quality conformance inspection of packaging.

4.7.1.1 Unit of product. For purposes of inspection, a completed pack prepared for shipment shall be considered a unit of product.

4.7.1.2 Sampling. Sampling for examination shall be in accordance with MIL-STD-105.

4.7.1.3 Examination. Samples selected in accordance with 4.7.1.2 shall be examined for the following defects. Failure of any examination shall be cause for rejection.

125.	Preservation not in accordance with the referenced documents and additional requirements specified for level A and C (see 5.2.1 and 5.2.2).
126.	Open ends of valve sections and couplings not covered as specified for level A (see 5.2.1.1).
127.	Four-inch couplers not preserved in the quantities specified for level A (see 5.2.1.2).
128.	Valve sections and components not packed in accordance with the referenced document and the exceptions specified for level A, B, or C (see 5.3.1, 5.3.2 and 5.3.3).
129.	Marking illegible, incomplete, incorrect, or missing (see 5.4).

5. PACKAGING

5.1 Disassembly. The couplings shall be disconnected from the 20-foot long valve sections prior to packaging.

5.2 Preservation. Preservation shall be level A or C as specified (see 6.2).

5.2.1 Level A.

5.2.1.1 Valve sections. The valve sections and disassembled couplings shall be cleaned and preserved in accordance with MIL-V-3, level A, except only type P-7 or P-10, grade 30 preservative shall be used for internal preservation. Open ends of the valve sections and couplings shall be covered with barrier material in accordance with MIL-B-121, type I, grade A, class 2. Couplings with exposed land-sealing surfaces shall have the barrier material extend back beyond the groove not less than 0.25-inch. The barrier material shall be sealed to the fitting with tape in accordance with PPP-T-60, type IV.

5.2.1.2 Coupling clamps. The coupling clamps shall be preserved in accordance with level A requirements of MIL-C-10387. Four-inch coupling clamps shall be preserved together in quantities required for one complete valve section.

5.2.1.3 Extra gaskets. When required, extra gaskets for each valve section shall be preserved together in accordance with MIL-P-116, method IC-3.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

5.2.1.4 Wrenches. The lubricant screw wrench or pin and the valve operating wrench shall be preserved in accordance with PPP-P-40, level A.

5.2.1.5 Lubricant sticks. Extra lubricant sticks for each valve section shall be preserved together in accordance with MIL-P-116, method IC-1.

5.2.1.6 Hoses. The hoses shall be preserved in accordance with level A requirements of MIL-P-775.

5.2.1.7 Consolidation. When required, the preserved extra gaskets, valve operating wrench, couplings, lubricant screw wrench or pin, and extra lubricant sticks as required for each valve section shall be consolidated in close-fitting boxes in accordance with PPP-B-636, class weather-resistant. The boxes shall be closed, method V of the appendix. Strapping of the boxes is not required.

5.2.2 Level C.

5.2.2.1 Valve sections. The valve sections and disassembled couplings shall be cleaned and preserved in accordance with the level C requirements of MIL-V-3.

5.2.2.2 Coupling clamps. The coupling clamps shall be preserved in accordance with the level C requirements of MIL-C-10387. Four-inch coupling clamps shall be preserved together in quantities required for one complete valve section.

5.2.2.3 Wrenches, extra gaskets and lubricant sticks. Wrenches, extra gaskets and lubricant sticks shall be preserved as specified for level A.

5.2.2.4 Hoses. The hoses shall be preserved in accordance with level C requirements of MIL-P-775.

5.2.2.5 Consolidation. Consolidation shall be as specified for level A except the boxes shall be domestic type.

5.3 Packing. Packing shall be level A, B, or C as specified (see 6.2).

5.3.1 Level A. Each valve section with the consolidated components shall be packed individually in shipping containers in accordance with MIL-V-3, level A, except that boxes shall be in accordance with PPP-B-601, overseas type, PPP-B-621, class 2, or MIL-B-26195, type II. Boxes in accordance with MIL-B-26195 with gross weights over 200 pounds shall be equipped with rubbing strips. Blocking, bracing, and anchoring of the contents shall be in accordance with MIL-STD-1186. Strapping shall be as specified by the box specification except it shall be flat, and finish B.

5.3.2 Level B. The valves and components shall be packed as specified in 5.3.1 for level A, except that the boxes shall be domestic type. Strapping may be finish A.

5.3.3 Level C. Each valve section with the consolidated components shall be packed as specified by the level C requirements of MIL-V-3. Strapping shall be finish A.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

5.4 Marking. In addition to any special marking required (see 6.2), unit packs, shipping containers, and loose valve sections shall be marked in accordance with MIL-STD-129.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. Valve sections are intended for use in portable pipelines handling liquid fuels.

6.2 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of this specification.

b. Type, class, size, and definitive specification part number of valve sections required (see 1.2 and 6.6).

c. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).

d. When a first article is not required (see 3.2).

e. Timeframe for submission of first article and number of units required (see 3.2).

f. Size and class of gate valve required (see 3.4.1).

g. Size and class of check valve required (see 3.4.2).

h. Type, pattern, size, and class of plug valve required (see 3.4.3).

i. Size of flanged-to-grooved adapter required (see 3.4.4).

j. When extra gaskets are required and the number of gaskets required (see 3.4.4.2).

k. When a pressure-relief assembly is required (see 3.4.5).

l. Size of grooved-end coupling required (see 3.5.3).

m. Size of coupling clamps required (see 3.5.4).

n. Level of preservation and packing required (see 5.2 and 5.3).

o. Any special markings (see 5.4).

6.3 First article. When a first article inspection is required, the item(s) should be a preproduction model. The first article should consist of one or more units. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examinations, approval of the first article test results and disposition of the first articles. Invitation for


Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.4 Information figures. Figures 1 and 2 show types of valve sections and pressure-relief valves which have been found acceptable; however, the figures are included for illustration only and are not intended to preclude the furnishing of other valve sections and pressure-relief devices that are in accordance with this specification.

6.5 International standardization agreements. Certain provisions of this specification are the subject of international standardization agreements NATO, STANAG No. 2761, QSTAG No. 240. When amendment, revision, or cancellation of this specification is proposed which will affect or violate the international agreement concerned, the preparing activity will take appropriate reconciliation action through international standardization channels, including departmental standardization offices, if required.

6.6 Part or identifying number (PIN). The PIN to be used for valve sections acquired to this specification are created as follows:

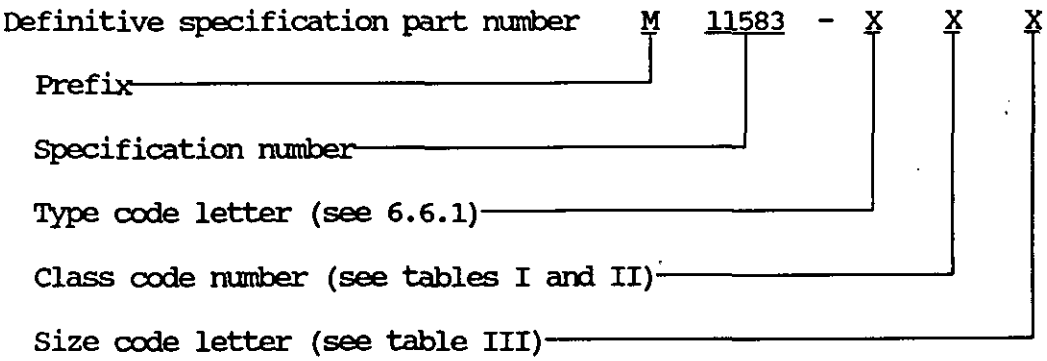

Example: M11583-A1B is the definitive part number for type I(A), class 1(1), 6-inch (B) pipeline valve sections.

6.6.1 Type code. The definitive specification part number shall have code "A" for type I and "B" for type II.

6.6.2 Type I class code. See table I.

TABLE I. Type I class code.

Code	Class
1	1
2	2
3	3

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

6.6.3 Type II class code. See table II.

TABLE II. Type II class code.

Code	Class
4	1
5	2

6.6.4 Size code. See table III.

TABLE III. Size code.

Code	Size	Description
A	4	4-inch
B	6	6-inch
C	8	8-inch
D	12	12-inch

6.7 Subject term (key word) listing.

Valve sections, check
Valve sections, gate
Valve sections, fuel-handling pipeline
Valve sections, grooved-type pipeline
Valve sections, plug

6.7 Changes from previous issue. Asterisks (or vertical lines) are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

6.8 AQL certification. This specification is certified to be in compliance with current Army Materiel Command (AMC) policy for the elimination of AQL's/LTPD's (Acceptable Quality Levels/Lot Tolerance Percent Defectives) from military specifications.

(Certified by/date: 14 Jan 87).


Custodians:
Army - ME
Navy - YD

Review activity:
DLA - CS


Preparing activity:
Army - ME

Project 3835-0081


Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.



CLASS 1.
3-FT. GATE VALVE SECTION




CLASS 2.
3-FT. CHECK VALVE SECTION




CLASS 3.
3-FT. PLUG VALVE SECTION

TYPE I

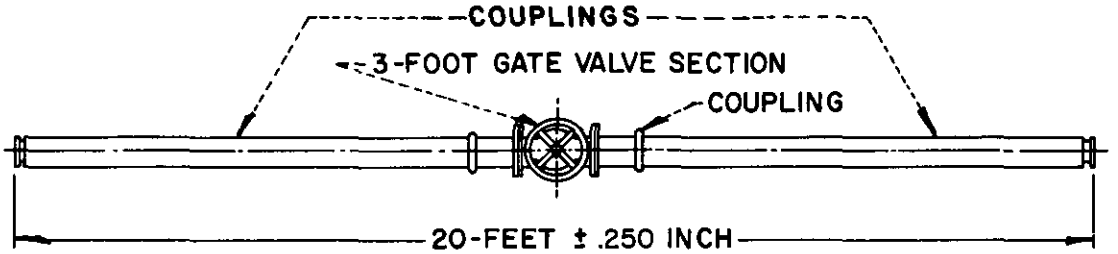

CLASS 1.
20-FT. GATE VALVE SECTION

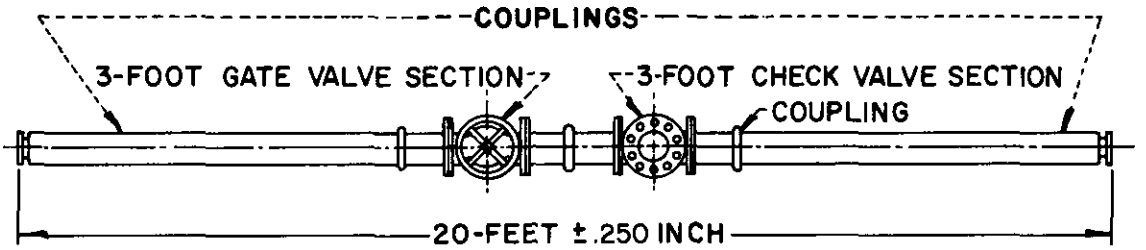

CLASS 2.
20-FT. CHECK VALVE AND GATE VALVE SECTION
TYPE II

FIGURE 1. Valve sections. X2462C

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

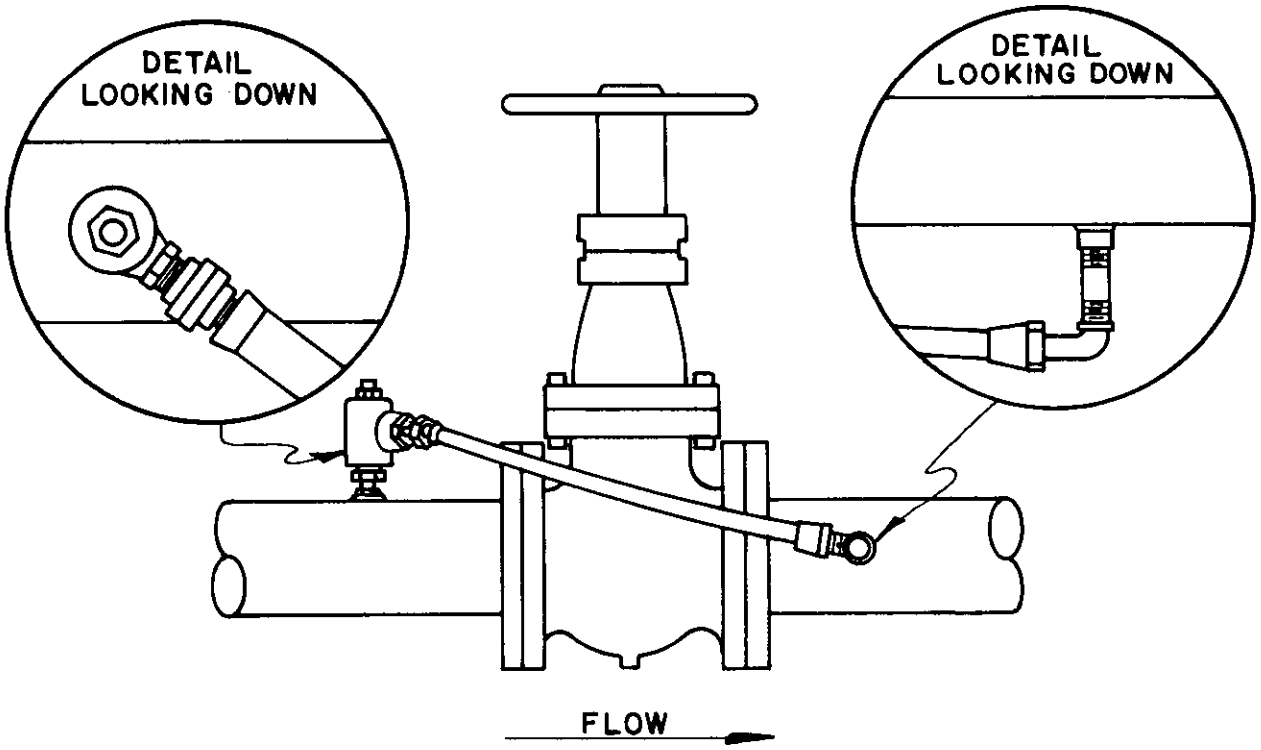


FIGURE 2. Pressure relief assembly installed on gate valve section.

X2479

☆ U.S. GOVERNMENT PRINTING OFFICE: 1990 704-034/30138

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document*(s)* or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE ARMY

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATES

OFFICIAL BUSINESS

BUSINESS REPLY MAIL

FIRST CLASS PERMIT NO. 12062 WASHINGTON D. C.

POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE ARMY

Commander
US Army Belvoir RDE Center
ATTN: STRBE-TSE
Ft. Belvoir, VA 22060-5606

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.

(TO DETACH THIS FORM, CUT ALONG THIS LINE.)

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-V-11583D	Valve Sections, Pipeline: for Portable Pipelines

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR ☐ USER ☐ MANUFACTURER ☐ OTHER *(Specify)*: _____
b. ADDRESS *(Street, City, State, ZIP Code)*	

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

DD FORM 32 MAR 1426 PREVIOUS EDITION IS OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T18:21Z
Check the source to verify that this is the current version before use.