FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE II, SERIES TRIP, THREE POLE (100 THROUGH 225 AMPERES)

This specification is approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of W-C-375.


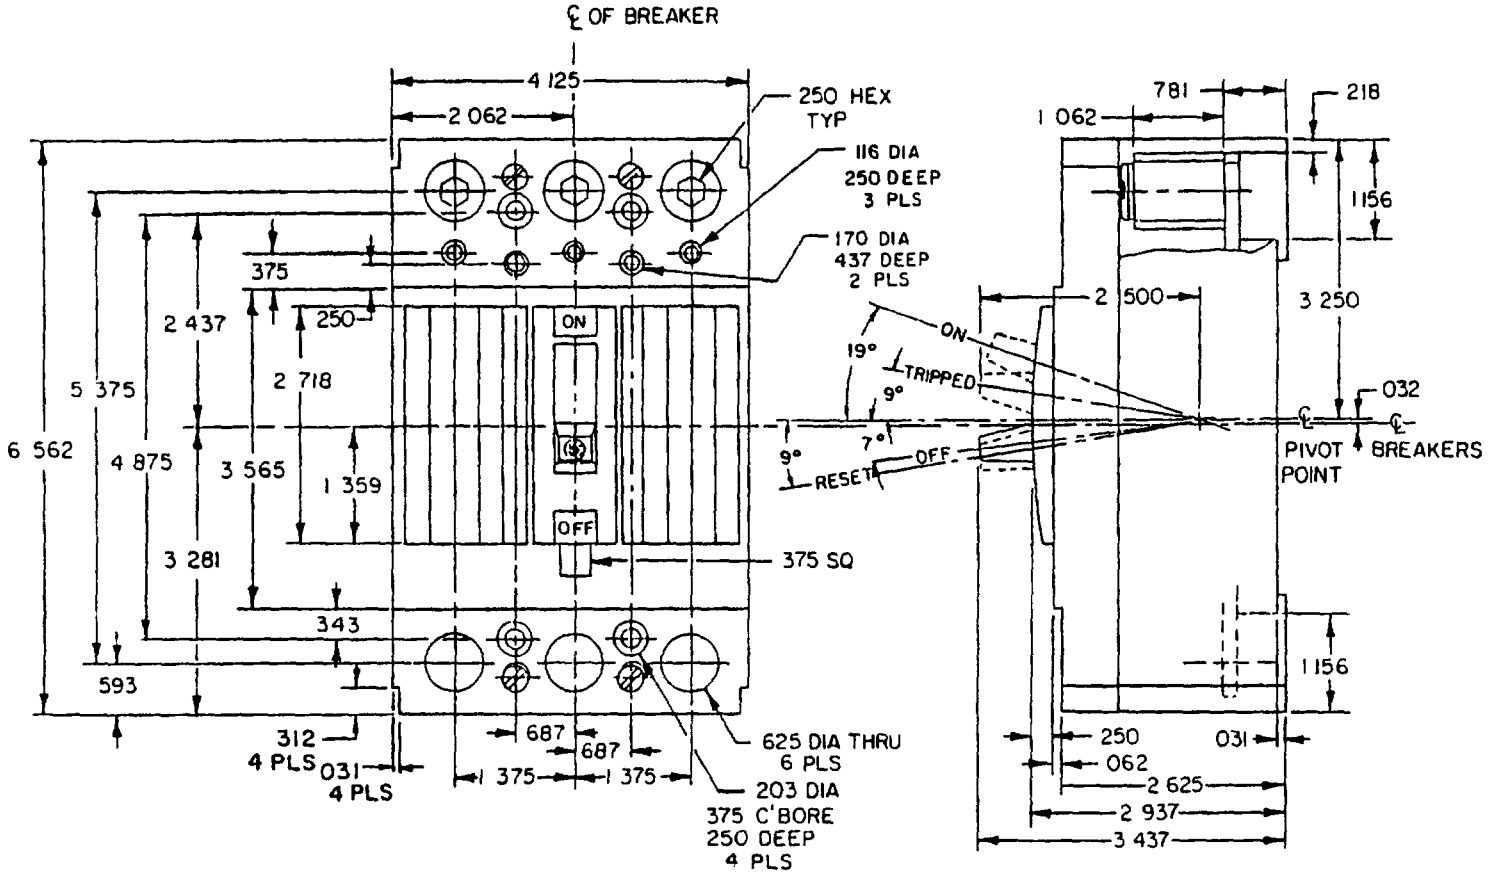


FIGURE 1. Dimensions and configuration of three pole circuit breaker.

DISTRIBUTION STATEMENT A: Approved for public release; distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 202640-26T11:26Z
Check the source to verify that this is the current version before use.

Inches	mm	Inches	mm
.031	0.79	1.000	25.40
.032	1.57	1.062	26.97
.062	2.95	1.093	27.76
.116	2.95	1.156	29.36
.156	3.96	1.375	34.93
.170	4.32	2.062	52.37
.203	5.16	2.718	69.04
.218	5.54	2.437	61.90
.250	6.35	2.500	63.50
.312	7.92	2.625	66.68
.343	8.71	2.937	74.60
.375	9.53	3.250	82.55
.437	11.10	3.281	83.34
.562	14.27	3.437	87.40
.593	15.06	3.656	92.86
.625	15.88	4.125	104.78
.687	17.45	4.875	123.83
.718	18.24	5.375	136.53
.750	19.05	6.562	166.67
.781	19.84		
.937	23.80		

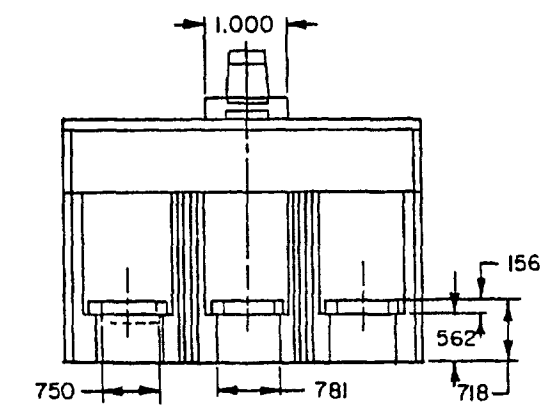

THREE POLE

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.02 (.5 mm) on decimals and ±1° on angles.
4. Line and load lugs furnished with circuit breaker.
5. Maximum wire range is 1-300 mcm (CU-AL).

FIGURE 1. Dimensions and configuration of three pole circuit breaker - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction. See figure 1.

Trip indication: See figure 1.

Common trip: All poles shall make and break simultaneously when operated manually or automatically.

Mounting: See figure 1.

Electrical:

Interrupting current rating: RMS symmetrical - 22,000 amperes.

Voltage rating: 240 V ac or less.

Current rating See table I.

Frequency: 60 hertz.

Calibration: At 40° ±3°C.

Design to be mounted in GE load centers and panel boards, or equivalent.

TABLE I. Part numbers and current rating.

Government part number	Current rating (amperes)
WC375/24 - 001	100
002	125
003	150
004	175
005	200
006	225

Military Interests:

Custodians:

Navy - YD
Air Force - 85
Army - ER

Review activities.

Air Force - 99
DLA - ES
NASA - NA
Army - MI

User activities:

Navy - MC, OS, YD

Civil Agency Coordinating Activities

DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HHS - FEC
HUD-HEP
Interior - BPA
Justice - FPI
Postal - POS
VA - OSS

Preparing activity:

DLA - ES

Project No. 5925-0196-04

Source: https://assist.dla.mil - Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.