W–L–142a
March 7, 1960
SUPERSEDING
Fed. Spec. W–L–142
April 18, 1945 and
Fed. Spec. W–L–146b
July 1, 1955

FEDERAL SPECIFICATION

LAMPHOLDER, ADAPTER, AND SHADEHOLDER, MEDIUM-SCREW-SHELL, 125, 250, AND 600 VOLTS

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

1. SCOPE AND CLASSIFICATION

1.1 Scope.—This specification covers lampholders to be used with incandescent lamps having medium screw bases; lampholder to current tap adapters; lampholder to plug adapters; and mogul-screw to medium-screw-shell adapters with ratings of 125, 250, and 600 volts; and shadeholders.

1.2 Classification.

1.2.1 *Types of lampholders and adapters.*—Lampholders and adapters shall be one of the following types, as specified:

Type I.—Standard size, press-fit attaching (see fig. 1).

Type IIm.—Standard size, thread attaching, metal (see fig. 2).

Type IIp.—Standard size, thread attaching, plastic (see fig. 3).

Type IV.—Standard size, screw attaching, porcelain (see fig. 4).

Type V.—Outlet box mounting (see fig. 5).

Type VI.—Cleat wiring (see fig. 6).

Type VII.—Ring mounting (see fig. 7).

Type VIII.—Sign (see fig. 8).

Type IX. Miscellaneous use (see fig. 9).

Type X. Weatherproof (see fig. 10).

Type XI.—Adapters (see fig. 11).

1.2.2 *Types and sizes of shadeholders.*—Shadeholders shall be one of the following types and sizes, as specified:

Type TS.—Fastening by means of threads around lampholder shell, and having ring and set screws for suspension of shade. For use with types I through IV lampholders.

Size 2¼.—To hold 2¼-inch shade.

Size 3¼.—To hold 3¼-inch shade.

Size 4.—To hold 4-inch shade.

Type TW.—Fastening by means of threads around lampholder shell, and having ring and spring wire grip device for suspension of shade. For use with types I through IV lampholders.

Size 2¼.—To hold 2¼-inch shade.

Size 3¼.—To hold 3¼-inch shade.

Type CS.—Fastening by means of clamp around groove of lampholder shell, and having ring and set screws for suspension of shade. For use with types I through VII and type X lampholders.

Size 2¼.—To hold 2¼-inch shade.

Size 3¼.—To hold 3¼-inch shade.

2. APPLICABLE SPECIFICATIONS, STANDARDS, AND OTHER PUBLICATIONS

2.1 Specifications and standards.—The following specifications and standards of the issues in effect on date of invitation for bids, form a part of this specification:

Federal Specifications:

PPP-B-566—Boxes, Folding, Paperboard.

PPP-B-585—Boxes, Wood Wirebound.

PPP-B-601—Boxes, Wood, Cleated-Plywood.

PPP-B-621—Boxes, Wood, Nailed and Lock-Corner.

PPP-B-636—Boxes, Fiber.

PPP-B-665—Boxes; Paperboard, Metal Stayed (Including Stay Material).

PPP-B-676—Boxes, Set-Up, Paperboard.

FSC 6250
5935

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

PPP-T-76—Tape, Pressure-Sensitive Adhesive, Paper, Water Resistant.
PPP-T-97—Tape, Pressure-Sensitive Adhesive, Filament Reinforced.

Federal Standards:

Fed. Std. No. 102—Preservation, Packaging, and Packing Levels.
Fed. Std. No. 123—Marking for Domestic Shipment (Civilian Agencies).

(Activities outside the Federal Government may obtain copies of Federal Specifications, Standards, and Handbooks as outlined under General Information in the Index of Federal Specifications, Standards, and *Handbooks and at the prices* indicated in the Index. The Index, which includes cumulative monthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U.S. *Government* Printing Office, Washington 25, D.C.

(Single copies of this specification and other product specifications required by activities outside the Federal Government for bidding purposes are available without *charge at the General Services* Administration Regional Offices in Boston, New York, Atlanta, Chicago, Kansas City, Mo., Dallas, Denver, San Francisco, Los Angeles, Seattle, and Washington, D.C.

(Federal Government activities may obtain copies of Federal Specifications, Standards, and Handbooks and the Index of Federal Specifications, Standards, and Handbooks from established distribution points in their *agencies.*)

Military Specifications:

MIL-P-116—Preservations, Methods of.
MIL-B-10377—Box, Wood, Cleated Veneer, paper Overlaid.
MIL-L-10547—Liners, Case, Waterproof.

Military Standards:

MIL-STD-105—Sampling Procedures and Tables for Inspection By Attributes.
MIL-STD-129—Marking for Shipment and Storage.

(Copies of Military Specifications and Standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications.—The following publications, of the issues in effect on date of invitation for bids, form *a part of this* specification:

Underwriters' Laboratories, Inc. (UL), Standards:

496—Standard for Edison Base Lampholders.
498—Standard for Attachment Plugs and Receptacles.

(Copies of the UL publications may be obtained from the Underwriters' Laboratories, Inc., 161 Sixth Avenue, New York 13, N.Y.; 207 *East Ohio Street*, Chicago 11, Ill.; or 1655 Scott Lane, Santa Clara, California.)

3. REQUIREMENTS

3.1 Material.—Materials shall be as specified herein. Materials not specified herein shall be of good quality, and suitable for the intended use.

3.1.1 *Rubber.*—Rubber shall be natural or synthetic elastomeric *material* or a combination of both. The rubber shall be of a soft molded type with a tensile strength of not less than 850 pounds per square inch (p.s.i.) and an elongation of not less than 250 percent.

3.1.2 *Thermosetting plastic.*—Thermosetting plastic shall be of a fire-resistant, nonabsorptive, thermosetting, resinous material.

3.1.3 *Porcelain.*—Porcelain shall be of a processed vitrified ceramic *mineral material*.

3.1.4 *Composition.*—Composition shall be a *suitable combination* of rubber, thermosetting plastic, thermoplastic, or porcelain with suitable binders.

3.1.5 *Sealing material.*—Sealing material shall not chip, crack, or flow after air hardening, shall not have any injurious effect upon the insulation or part which the sealing material is intended to protect, and shall not cause corrosion or deterioration of any adjacent part.

3.2 Fire and casualty design.—Lampholders and adapters shall be of sturdy construction, reliable in operation, and designed for rapid and simple installation. Lampholders and adapters shall conform to UL Standard No. 496 for Edison Base Lampholders and UL Standard No. 498 for Attachment Plugs and Receptacles, except where such requirements are modified by this specification. Compliance with UL requirements regarding fire and casualty hazards does not absolve the contractor from compliance with the requirements of this specification.

3.3 Electrical contacts.—Positive contact shall be reliably maintained at any point where an electrical connection is made between parts. When tested in accordance with 4.4.1, the adap-

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

ter female connector shall have no mechanical or electrical failures and shall show no increase in electrical resistance such as is caused by burning or pitting of contacts. When tested in accordance with 4.4.2, no connector part shall have a rise in temperature greater than 30 degrees centigrade (°C). Female contacts shall contact both sides of the mating inserted blade. Female adapters, when tested in accordance with 4.4.3, shall require a force of not less than 3 nor more than 15 pounds. The center contact shall be of spring copper alloy. It shall be of such quality and design that it will not become distorted by frequent insertion and removal of lamps. The center contact shall be firmly held in place and shall be prevented from turning relative to the surface upon which it is mounted. An insulating washer under the center contact of screw plug or lampholder shall be at least 1/16-inch thick.

3.4 **Terminals.**—Each lampholder, except those furnished with installed lead-in wires, shall have suitable wiring terminals of the screw type conveniently accessible for the connection of conductors. Screw terminals shall have upturned lugs or other similar arrangement to hold the wires in position. Screw terminals shall be of substantial construction, shall be of such size and form that the threads will not strip when set up tight, and shall be designed to provide a good electrical connection. Set-screw form of terminals is not acceptable.

3.4.1 *Binding screws.*—Binding screws shall not be smaller than American Standard Screw size 6 and shall have a maximum of 36 threads per inch.

3.4.2 *Terminal plates.*—Terminal plates for wire-binding screws shall be of metal. The tapped hole for the screw shall have at least two threads in the metal; the thread shall extend through a metal thickness of not less than 0.060 inch. The required metal thickness may be in part obtained by extrusion of the tapped hole, but the plate proper shall be not less than 0.030 inch thick. The terminal connected to the screw shell shall have a metallic plated coating substantially white in color, or the terminal may be made of metal substantially white in color. The terminal connected to the center contact shall be of a different color, easily distinguishable.

3.4.3 *Lead-in wires.*—The lead connected to the screw shell shall be white or natural gray with a readily distinguishable different colored lead to the center contact.

3.5 **Current-carrying parts.**—There shall be a spacing through air of at least 3/64 inch for a lampholder rated at 250 volts or less and at least 1/8 inch for a lampholder rated at 600 volts, between uninsulated current-carrying parts of opposite polarity and between current-carrying parts and noncurrent-carrying metal parts. Nonferrous metal shall be used for all current-carrying parts.

3.6 **Lamp cavity.**—Lampholders shall have a lamp cavity 15/16 inch to 1 inch deep as measured vertically from the plane of the depressed center contact to the plane of the rim of the insulating lining, or to the rim of the outer shell when a lining is not used.

3.7 **Insulating bases.**—Except where specifically specified herein, bases mounting current-carrying parts shall be of porcelain, thermosetting plastic, composition or rubber. Insulating washers, separators, and barriers, not used as the sole support of metal parts, may be made of vulcanized fiber. Hard rubber shall not be used. Assembly screws and bolts threaded into metal shall be firmly set and shall be prevented from loosening or displacement by sealing, staking, or equivalent means. Metal screws shall be used with threaded metal inserts. Drive screws may be used in plastic shells or bodies when the thickness of the material at all points surrounding the drive screw is not less than 3/32 inch. Drive screws shall not be used in rubber. All assembly screws, rivets, or other fasteners, which are accessible to outside contact and which contact any current-carrying part, shall be located in holes not greater than 9/32 inch in diameter and recessed not less than 3/16 inch from the outside surface of the base or body. The wall thickness of material insulating current-carrying metal shall be not less than 1/16 inch. Concealed current-carrying parts shall be insulated from metal covers by sealing material. There shall be no damage, arcing, or breakdown, when the lampholder or adapter is tested in accordance with 4.4.4.

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

When tested in accordance with 4.4.5, the insulation resistance of mutually insulated parts shall be not less than 50 megohms. When tested in accordance with 4.4.6, the adapter shall have no mechanical or electrical failure, flow, or critical softening of sealing material, or softening or distortion of parts. Cord holes of metal-covered lampholders shall be provided with an insulating bushing except where the diameter of the hole in the metal cover exceeds the diameter of a smooth and well rounded cord hole in the body by ⅛ inch. Hard-fiber bushings will be acceptable if not less than 3/64 inch in thickness and of a type unaffected by ordinary atmospheric conditions. Bushings shall be so formed and secured in place that they will not be distorted or dislodged by ordinary handling of the lampholder.

3.8 **Switches.**—Switching mechanisms of lampholders rated at 660 watts shall be of the quick-make, quick-break type. Switching mechanisms of lampholders rated at 250 watts shall be of the quick-break type. Actuating members shall be made of insulating material and shall not soften or be injured when tested in accordance with 4.4.6. Lampholders with switching mechanism shall perform without electrical or mechanical failure nor show any increase in resistance caused by burning or pitting of contacts when tested for overload and endurance in accordance with 4.4.7 and 4.4.8.

3.9 **Pull chains.**—The chain in a pull-chain switch lampholder shall not become alive nor cause the mechanism to jam when suddenly released after having been pulled sharply to the "on" or "off" position. Means shall be provided within the lampholder to prevent the spring mechanism from being pulled out of position during a pull on the chain. The exterior part of the chain shall have a large bead properly spaced on the chain, or other means to prevent the chain from snapping into the interior of the lampholder when suddenly released. Unless otherwise specified, all lampholders having pull-type switches shall be furnished with a Pull 6 (six inches of metal chain with tassel). When specified, Pull 6/I (six inches of metal chain with insulating link and tassel) or Pull 3/C (three inches of metal chain with splicing link plus 4 feet of cord, and tassel shall be furnished). The chain, pulls, and links, when assembled, shall withstand a force of 25 pounds when tested in accordance with 4.4.9. When specified, insulating links designed to be attached readily to metal pull chains by splicing links or other suitable means or be made as an integral part of the chain shall be furnished. When insulating links are inserted in a metal chain, the length of insulating material between metal parts shall be a minimum of ½ inch. Insulating links shall withstand a force of 25 pounds when tested in accordance with 4.4.10. Voltage shall not puncture the insulation, arc-over, or cause burning, charring, or distortion of the insulation when tested in accordance with 4.4.11.

3.10 **Lampholders.** — Noncurrent-carrying metal parts used in lampholders shall be treated, plated, or coated to eliminate corrosion under normal use conditions. Lampholders with metal outer shells and caps shall be provided with insulating linings which shall not extend beyond the shell by more than ⅛ inch. The outer shell shall extend beyond the screw shell sufficiently to avoid accidental contact between the screw shell and external objects. The screw shell shall not turn in the lampholder nor shall it pull out, become loose, or distorted when tested in accordance with 4.4.12.

3.10.1 *Lampholder screw shells.*—Lampholder screw shells shall be of copper or copper alloy for type X lampholders and of aluminum, copper, or copper alloy for other type lampholders. The screw shell shall be the Edison Medium Base Design of not less than 0.012 inch for copper and copper alloy and not less than 0.015 inch for aluminum and aluminum alloy when measured on the flat surface of the bottom of the shell.

3.10.2 *Caps with threaded pipe fittings.*—When caps are provided with threaded pipe fittings, there shall be not less than five clean-cut threads of ⅛-, ⅜-, or ½-inch iron-pipe size, as applicable. The fittings shall have size 8–40 set screws except for the ½-inch size when designed to be tightened with a wrench.

3.10.3 *Outer shell provisions for shadeholders.*—Types I through IV lampholders, which have provisions for threaded shadeholders, shall

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

have at least two full threads on the outer shell. Any lampholder having provisions for grooved-type shadeholders shall have a groove at least 19/64 inch in width and at least 1/16 inch in depth for attachment of the shadeholder except that the upper lip of the groove need not be provided. The diameter of the groove seat shall not exceed 1½ inches.

3.11 **Interchangeable type lampholders.**—Types I, IIIm, IIIp, and IV lampholders shall have all similar parts of the same type interchangeable. When assembled, the cap shall not turn relative to the body. Type I lampholder shall be assembled by pressing the cap and outer shell together and, when so assembled, shall interlock firmly and tightly. The upper end of types IIIm and IIIp lampholder's outside shell shall have outside threads and the cap shall have a shoulder around the outside bottom rim. The shell and cap shall be joined by an internally threaded ring. When assembled, a snug fit shall result. In addition, type IIIp lampholder shall be keyed. Type IV lampholder shall be assembled by one or two screws inserted through the bottom of the lampholder cavity. The screwheads shall be recessed in conformance to 3.7.

3.11.1 *Caps and outer shells.*—Sheet-brass caps and outer shells shall be not less than 0.013 inch thick and sheet-aluminum caps and outer shells shall be not less than 0.018 inch thick when measured in accordance with 4.4.13. The finish of brass and aluminum caps and outer shells shall be bright dip. Metal caps and outer shells, other than sheet brass or sheet aluminum, shall have mechanical strength and rigidity not less than that provided by sheet brass caps and outer shells.

3.11.2 *Insulating linings.*—The lining shall be one piece and shall be not cut, slitted, or notched, except where necessary for assembly and operation of the lampholder. The lining of the metal cap shall be secured in place. Linings shall be not less than 1/32 inch thick. The lining shall not tear or break when a steady pull of 18 pounds is applied for one minute when tested in accordance with 4.4.14. The linings shall withstand 4,000 volt, 60 cycle, alternating current (a.c.) potential for one minute without breakdown when tested in accordance with 4.4.15. Linings shall not char, crack, crumble, nor become brittle when tested in accordance with 4.4.16.

3.11.3 *Pendants.*—Strain relief shall be provided in pendant style lampholder caps so that mechanical strain on the flexible cord will not be transmitted to the wiring terminals. When strain relief is provided for by space within the cap for a knot in the flexible cord, all parts of the cap on which the knot may bear shall be smooth and well insulated. When cord grip is specified, the grip shall accommodate the sizes of the cord required. No strain shall be placed on the electrical connections when the cord is subjected to a pull of 30 pounds, when tested in accordance with 4.4.17.

3.12 **Type X lampholders.**—Weatherproof lampholders shall be switchless. When shadeholders are required, they shall be type CS. Lampholders with composition outer shells shall perform without electrical or mechanical failure when tested in accordance with UL Standard No. 496 for Edison Base Lampholders. This test need not be made for cold-molded material which does not soften under heat. Rubber outer-shell lampholders shall have a wall thickness of not less than 3/16 inch. The lampholders shall be suitable for use continuously at a temperature of 60 degrees C. and shall withstand the temperature and accelerated aging tests when tested in accordance with UL Standard No. 496 for Edison Base Lampholders.

3.12.1 *Pigtail lampholders.*—The outer shell of pigtail weatherproof lampholders shall be one piece with two openings for the lead-in wires. The lead-in wires shall be made raintight at the opening to the shell. When specified, pigtail lampholders shall be resistant to severe heat and moisture conditions, shall have no mechanical or electrical failures when tested in accordance with 4.4.18, and shall be marked "H-R". Lampholders with plastic outer shells shall withstand a crushing force of 175 pounds and with composition shells, a force of 125 pounds when tested in accordance with 4.4.19.

3.12.2 *Pin terminal lampholders.*—The outer shell of pin terminal lampholders shall consist of two parts: A detachable cap and a body. The body shall have two parallel channels of suitable dimensions to accommodate the wire.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

There shall be a pin terminal extending perpendicularly into each of the slot passages of the lampholder body. The pin terminals shall be of sturdy construction, pointed, and of sufficient length and sharpness to penetrate the insulation of an inserted wire and provide good electrical contact with the conductors when the cap is screwed on or otherwise fastened on the body. Suspension hooks for pin-terminal lampholders shall be of metal inherently corrosion resistant or treated to resist corrosion. They shall be designed to permit suspension from ropes or cable and shall be able to withstand a straight pull of 20 pounds when suspended vertically. There shall be at least 3/64-inch clearance between any part of the hook and any current-carrying part of the lampholder. Lampholders with plastic outer shells shall withstand a crushing force of 100 pounds when tested in accordance with 4.4.19.

3.12.3 *Conduit lampholder.*—Weatherproof conduit lampholders shall consist of a lampholder with porcelain outer shell enclosed by a hood to provide the lampholder with overall protection from the weather. The screws holding the lampholder within the enclosure shall be of sufficient size and length to secure a tight and permanent fit after the lampholder is wired. The hood shall be of smooth finish; if made of more than one part, all junctures shall be raintight. The hood shall be inherently corrosion resistant, or treated to resist corrosion. Integral with the hood there shall be a female pipe fitting having standard pipe threads and a 2¼-inch shadeholder.

3.13 **Adapters.**—The insulating body shall join the metal parts such as screw shells and female contacts in a compact assembly. When shadeholder threads are required, at least two full threads shall be provided. A current tap shall accommodate not more than three devices, whether bladed, screw plug, or a combination thereof. Male screw shells shall have not less than two threads for engagement with a lampholder screw shell, shall be of copper or copper alloy not less than 0.008 inch in thickness or of aluminum 0.011 inch in thickness, and shall be reliably secured in place so that the shell will be prevented from turning with respect to the body. Screw shells of the so-called "skeleton type" shall not be used. Male screw shells shall withstand the torsion test described in 4.4.12.2.

3.14 **Shadeholders.**—Types TS and TW shadeholders shall have at least two full threads to fasten on the lampholder's shell and shall hold securely when screwed on. Type CS shadeholders shall have a clamp grip of sufficient flexibility to firmly fasten around the shadeholder groove of the lampholder. The clamp groove shall be ¼ inch in width with a minus tolerance of 1/32 inch. Clamping devices, when tightly clamped on a shadeholder, shall not penetrate the lampholder at any point. Shadeholders shall be of metal which is inherently corrosion resistant.

3.15 **Color.**—Unless otherwise specified, lampholders, pulls, and adapters may be furnished in any color.

3.16 **Marking.**—The lampholders and adapters shall be marked in accordance with UL Standards 496 and 498 for Edison Base Lampholders and Attachment Plugs and Receptacles.

4. SAMPLING, INSPECTION, AND TEST PROCEDURES

4.1 Unless otherwise specified herein, the supplier is responsible for the performance of all inspection requirements prior to submission for Government inspection and acceptance. Except as otherwise specified, the supplier may utilize his own facilities or any commercial laboratory acceptable to the Government. Inspection records of the examinations and tests shall be kept complete and available to the Government for the length of time specified in the contract or order.

4.2 **Inspection lot.**—The inspection lot shall consist of all items of the same classification submitted for acceptance at the same time.

4.3 **Examination.**—The sample for visual and dimensional examination shall be in accordance with Military Standard MIL–STD–105. Each sample [illegible] inspection [illegible] design essential [illegible] section, operation [illegible] mension where applicable [illegible] marking with [illegible] acceptable Quality [illegible] defective.

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:25Z
Check the source to verify that this is the current version before use.

4.4 **Tests.**—The sample for tests shall be in accordance with Inspection Level I.5 of Military Standard MIL-STD-105 with reduced inspection procedure R-1. The AQL shall be 4.0 percent defective. The samples shall be tested to determine conformance to UL Standards 496 and 498 for Edison Base Lampholders and Attachment Plugs and Receptacles. Where requirements specified herein differ from, or duplicate those of the UL standards, the applicable test of UL need not be performed or duplicated. The label or listing of UL will be accepted as evidence of meeting the UL requirements.

4.4.1 *Current overload (female adapters only).*—The slotted adapter and a plug shall be coupled and wired as for actual service with suitable conductors, and shall be connected to an a.c. source to draw 150 percent of its rated current plus or minus 5 percent. The power factor of the load shall be within the limits of 0.75 and 0.80. The plug shall be alternately coupled and uncoupled from the adapter for 50 complete cycles of operation, at a rate not exceeding 10 cycles per minute. At the completion of the last cycle, the adapter shall be examined for conformance to 3.3.

4.4.2 *Temperature rise test.*—The lampholder or adapter shall carry its maximum rated current with no parts showing a temperature rise in excess of that specified in 3.3. The test current shall be applied until a stable temperature is obtained; temperature is considered stable when three successive readings, taken at 5-minute intervals, show no change. The temperature rise is the difference between the stable temperature and the average ambient temperature during the last quarter of the test. Temperature readings may be obtained by thermocouples or by other standard method.

4.4.3 *Gripping test (female adapters only).*—Slotted adapters shall be rigidly mounted to permit coupling and uncoupling of a plug without movement. The plug shall be coupled and uncoupled ten times prior to measurement. Test measurements shall employ gradually applied force to couple and uncouple, and measurement of force shall be by any suitable method to determine conformance to 3.3.

4.4.4 *Dielectric strength.*—An a.c. root-mean-square voltage of commercial-line frequency, equal to 1,000 volts plus twice the rated voltage, shall be applied between mutually insulated terminals and, if applicable, between each terminal and the metal shell of the connector. The test voltage shall be increased from zero at a rate not exceeding 500 volts per second until the specified potential is reached, and shall be maintained at that value for one minute. The test voltage may be applied instantaneously for acceptance tests at the option of the manufacturer. The testing apparatus shall have a capacity of not less than 2 kilovolt amperes. The lampholder or adapter shall be examined to determine conformance to 3.7.

4.4.5 *Insulation resistance.*—The insulation resistance shall be measured between mutually insulated terminals and, if applicable, between each terminal and the metal shell of the lampholder. Measurements shall be made by means of a megohm bridge or other approved method, at a direct current (d.c.) potential of approximately 500 volts to determine conformance to 3.7.

4.4.6 *Heat resistance.*—The adapter shall be placed in an oven and subjected to a temperature of 65 degrees C. plus or minus 2 degrees C. for a period of 2 hours and then examined for conformance to 3.7. The lampholder shall be placed in an oven and subjected to a temperature of 93 degrees C. plus or minus 3 degrees C. for a period of 2 hours and then examined for conformance to 3.7. When provided with a switching mechanism, the actuating member shall operate the switching mechanism in normal fashion for 25 cycles of make and break to determine conformance to 3.8.

4.4.7 *Overload test for switching mechanism.*—The lampholder shall be connected to a three-wire, d.c. circuit with grounded neutral. The three wires of the supply circuit shall be connected to the lampholder as follows: The negative wire to that terminal which leads to the switch; the positive wire to the other terminal; the grounded neutral wire to all exposed noncurrent-carrying metal parts, or instead, these parts may be merely grounded. Line connection shall be made to the wiring terminals as in actual service. The load shall be connected

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

to the screw shell and center contact of the lampholder by means of a suitable plug which is screwed into the lamp cavity. Test load shall be a noninductive resistance; tungsten-filament lamps shall not be used as a test load unless agreeable to the contractor. The lampholder shall be operated manually by its actuating member, at a speed of not more than 10 cycles per minute, for 50 cycles of operation making and breaking a circuit with rated current.

4.4.8 *Endurance test for switching mechanism.*—The lampholder shall be subjected to 12,000 cycles of operation. Speed of cycling shall be at the rate of 10 cycles per minute, except that a faster rate may be employed if agreeable to the contractor. The lampholder shall be operated by its actuating member, either manually or by machine, making and breaking a circuit at rated current.

4.4.9 *Strength of pulls.*—To determine conformance to 3.9, the lampholder shall be rigidly mounted in normal use position and a weight equal to the specified force shall be gently applied in suspension and maintained for one minute.

4.4.10 *Strength of insulating links.*—To determine conformance to 3.9, a weight equal to the specified force shall be gently applied in suspension and maintained for one minute from a chain in which the insulating link has been incorporated.

4.4.11 *Dielectric test of insulating links.*—The insulating link shall be exposed to saturated moist air at 31 degrees C. plus or minus ½ degree C. for 48 hours prior to the test. A 1500-volt, 60-cycle a.c. potential shall be applied for one minute between the ends of the link. The link shall be examined for conformance to 3.9.

4.4.12 *Mechanical strength test.*—The screw shell shall be subjected to the following stresses for 1 minute:

4.4.12.1 *A straight pull of 20 pounds.*—The lampholder to be tested shall be fastened in a vertical position and a suitable plug shall be threaded into the screw shell. A 20-pound weight shall be suspended vertically from the plug.

4.4.12.2 *A torque of 20 pound-inches.*—The lampholder to be tested shall be fastened in a horizontal position. A suitable plug shall be threaded into the screw shell, the exposed end of the plug having a drum of 4-inch diameter attached thereto. A rope or wire, one end being fixed to the drum, shall be wound around the drum. To the loose end of the rope or wire shall be attached gently a weight of ten pounds, thus creating a torque of 20 pound-inches. A male screw shell shall be tested in the same manner using a suitable plug threaded onto the screw shell.

4.4.13 *Brass and aluminum outer shell and cap measurements.*—To check for conformance to 3.11.1, the thickness of brass and aluminum shells shall be measured around the shell where the diameter is greatest and the surface cylindrical. The thickness of brass and aluminum caps shall be measured around the crown. Four measurements, 90 degrees apart, shall be taken with round-nose micrometer calipers and the average shall be not less than that specified.

4.4.14 *Mechanical strength test for linings.*—Two ¼-inch-diameter holes shall be punched through the lining near one end, diametrically opposed, the hole centers being located ⅜ inch from the end of the lining. At the other end of the lining shall be punched a like pair of holes, similarly located except that circumferentially this pair shall be 90 degrees from the first pair. For linings which are slotted, hole centers shall be placed at least ⅜ inch from the edge of the slot. Two metal plugs of suitable size shall be provided, one to fit closely within the top and the other within the bottom of the test lining. The plugs shall have ¼-inch-diameter holes so located as to line up with the ¼-inch holes made in the lining. Metal rods of about 0.23-inch diameter by 3 inches long shall be inserted through the holes of the assembled lining and plugs. The plugs shall have a means whereby one of them may be suspended from a support and the other shall have a means for attaching a weight thereto. The test assembly, with the lining, plugs, and rods in place, shall be erected in a vertical position and the weight specified in 3.11.2 shall be suspended from the bottom plug for one minute.

4.4.15 *Dielectric strength test for linings.*—The test lining shall be placed in a dry calcium-

Source: https://assist.dla.mil -- Downloaded: 2026l0-26T11:25Z
Check the source to verify that this is the currentversion before use.

chloride desiccator at room temperature for 24 hours immediately prior to test. A solid electrode of shape and size to snugly fit the interior of the lining, and a hollow electrode to snugly fit the exterior of the lining but which allows ¼ inch of the lining to be exposed at each end shall be used. The specified potential shall be applied, after which the lining shall be examined for conformance to 3.11.2.

4.4.16 *Heat test for linings.*—The lining shall be placed upon a dummy lampholder interior made of material which will not be affected by the heat. The dummy shall be made of size and shape similar to a lampholder interior but long enough to support the entire lining. The test assembly shall be placed for 72 hours in an oven maintained at 150 degrees plus or minus 5 degrees C. After removal, the lining shall pass successfully the mechanical strength test of 4.4.14 except that the pull applied for one minute shall be 14 pounds.

4.4.17 *Strain relief (cord grip lampholders only).*—Conductors employed in the strain-relief test shall be of the minimum nominal diameter the lampholder is designed to utilize and shall be connected to the terminals of the lampholder. The conductor leads shall have adequate slack between the grip and the terminals, and the cable shall be secured to the lampholder. With the lampholder rigidly held in place, a mechanical force shall be applied to the cable in a direction tending to withdraw the cable from the lampholder. The force shall be increased gradually to the magnitude specified in 3.11.3 and held at that value for one minute. Reduction of slack of any conductor within the lampholder shall be considered as evidence of transmission of strain to the lampholder terminals.

4.4.18 *Heat and moisture-resistant test for "H-R" lampholders.*—"H-R" lampholders shall be tested to conform to following tests, immediately following exposure to each of the following heat and moisture conditions:

(*a*) Six hours immersion in water at 20 degrees C. plus or minus ½ degree C. followed by 18 hours drying in air at 65 degrees C.

(*b*) Six hours in water vapor at 90 degrees C. plus or minus 3 degrees C., 95 percent relative humidity followed by 18 hours drying in air at 65 degrees C.

(*c*) Six hours immersion in water at 90 degrees C. plus or minus 3 degrees C., followed by 18 hours drying in air at 65 degrees C.

4.4.18.1 *Mechanical defects.*—After exposure to each of the heat and moisture conditions, the lampholder shall not show softening, warping, or other mechanical defects which might affect their serviceability.

4.4.18.2 *Insulation resistance.*—Insulation resistance between terminals shall be not less than 50 megohms when tested dry (as received). After exposure to each of the three heat and moisture conditions, the insulation resistance shall average not less than 0.5 megohm, and not more than 20 percent of the samples tested shall show an individual resistance of less than 0.5 megohm. The insulation resistance shall be measured between leads using 500 volts d.c. When tested with 1,000 volts, 60 cycle a.c. the lampholder shall not break down. The lampholder shall be examined for conformance to 3.12.1.

4.4.19 *Crushing strength.*—A suitable testing machine capable of applying a steady crushing force shall be employed. The lampholder under test shall be placed between two parallel, flat, maple slabs, each not less than ½ inch thick, to which the force is applied. Sudden application of the crushing force shall be avoided. The force shall be applied perpendicular to the major axis for a period of 1 minute.

4.5 Disposition of rejected product.

4.5.1 *Defective units.*—The Government reserves the right to return to the supplier any units found defective in the course of inspection, whether or not the lot as a whole is accepted.

4.5.2 *Resubmission of lots.*—If the lot is not accepted on first examination and tests it may be resubmitted after the manufacturer has given the remaining units remedial treatment or has removed all defectives. Before resubmission, full particulars concerning previous rejection and corrective action shall be furnished the Government.

4.6 Inspection of preparation for delivery.—The preservation, packaging, packing,

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:25Z
Check the source to verify that this is the currentversion before use.

and marking of the items shall be examined and tested to determine compliance with section 5.

5. PREPARATION FOR DELIVERY

(For civil agency procurement the levels of preservation, packaging, and packing protection used are defined in Federal Standard No. 102.)

5.1 Preservation and packaging.—The preservation and packaging shall be level A or C, as specified.

5.1.1 *Level A.*—Items of identical description shall be preserved in the quantity specified in accordance with Military Specification MIL–P–116, method III.

5.1.1.1 *Intermediate packaging.*—Preserved items of identical description shall be intermediate packaged in either paperboard or fiberboard boxes conforming to Federal Specification PPP–B–566, PPP–B–636, PPP–B–665, or PPP–B–676. Box closures shall conform to the applicable box specification and the appendix thereto. The gross weight shall not exceed the limitations of the applicable box specification.

5.1.2 *Level C.*—The items shall be preserved and packaged in accordance with the supplier's standard practice.

5.2 Packing.—The packing shall be level A, B, or C, as specified.

5.2.1 *Level A.*—The packaged items shall be packed in close-fitting boxes conforming to Federal Specification PPP–B–585 (class 2 or 3), PPP–B–601 (overseas type), PPP–B–621 (class 2), PPP–B–636 (class 2, compliance symbol V3S or V3C), or Military Specification MIL–B–10377 (overseas type). The boxes shall be fitted with waterproof case liners conforming to Military Specification MIL–L–10547 (class 2), and sealed in accordance with the appendix thereto. Case liners for boxes conforming to Federal Specification PPP–B–636 may be omitted, provided all joints and corners of the boxes are sealed with minimum 1½-inch-wide tape conforming to Federal Specification PPP–T–76. Box closures shall be as specified in the applicable box specification or appendix thereto. Fiberboard boxes shall be reinforced with bands of tape conforming to Federal Specification PPP–T–97, type III. The gross weight shall not exceed the limitations of the applicable specification for fiberboard boxes and approximately 200 pounds for wood-cleated or wood boxes. Strapping shall be flat steel, type I, class B.

5.2.2 *Level B.*—The packaged items shall be packed as specified for level A, except that the domestic type or class of box shall be used, case liners shall not be required, and strapping shall be as specified in the appendix to the applicable box specification.

5.2.3 *Level C.*—The items shall be packed in a manner which will insure arrival at destination in satisfactory condition and which will be acceptable to the carrier at lowest rates.

5.3 Marking.

5.3.1 *Nonmilitary agencies.*—Shipping containers shall bear standard marking with the name and size of the commodity as defined by the contract or order under which the shipment is made, the quantity of each type contained therein, the name of the contractor, the number of the contract or order, and the name and address of the consignee, and as otherwise required by Federal Standard No. 123.

5.3.2 *Military agencies.*—Interior packages and shipping containers shall be marked in accordance with Military Standard MIL–STD–129.

6. NOTES

6.1 Ordering data.—Purchasers should exercise any desired options offered herein, and procurement documents should specify the following:

(*a*) Title, number, and date of this specification.

(*b*) Type number of lampholder or adapter required (see 1.2 and figures 1 through 11).

(*c*) Type and size of shadeholder, if required (see 1.2.2).

(*d*) When Pull 6/I or 3/C is required in lieu of Pull 6 (see 3.9).

(*e*) When insulating links on pull chains are required (see 3.9).

(*f*) When pigtail weatherproof lampholders are for use in severe heat and moisture conditions (H–R) (see 3.12.1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

(*g*) When specific color is required for lampholders, pulls, or adapters (see 3.15).

(*h*) When specific inspection facilities other than specified in 4.1 are to be used.

(*i*) Length of time inspection records are to be kept (see 4.1).

(*j*) Level of preservation and packaging, and level of packing required (see 5.1 and 5.2).

(*k*) Quantity to be preserved in each wrap (see 5.1.1).

6.2 **Other types.**—The types of lampholders and adapters most commonly in use are included by type numbers in figures 1 through 11; other types within the scope of this specification should be described in the contract, order, or invitation for bid.

6.3 It is believed that this specification adequately describes the characteristics necessary to secure the desired material, and that normally no samples will be necessary prior to award to determine compliance with this specification. If, for any particular purpose, samples with bids are necessary, they should be specifically asked for in the invitation for bids, and the particular purpose to be served by the bid sample should be definitely stated, the specification to apply in all other respects.

6.4 Federal specifications do not include all types, classes, grades, sizes, etc., of the commodities indicated by the titles of the specifications, or which are commercially available, but are intended to cover the types, etc., which are suitable for Federal Government requirements.

6.5 **Transportation description.**—Transportation description applicable to the item is:

Devices, electrical.
Carload minimum weight 30,000 pounds.
Truckload minimum weight 30,000 pounds.

Notice.—When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data, is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

MILITARY INTEREST:

Army—M O T
Navy—Y
Air Force

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the currentversion before use.

INTERCHANGEABLE BODIES FOR TYPE I LAMPHOLDERS


CLASS A
CLASS E


CLASS B
CLASS F


CLASS C
CLASS G


CLASS H

Body class	Material of outer shell	Switch design	Ratings: Watts	Ratings: Volts	Provision for threading
A	Metal	Push button	250	250	Thread
B	Metal	Pull chain	250	250	Thread
C	Metal	Key	660	250	Thread
E	Metal	Push button	660	250	Thread
F	Metal	Pull chain	660	250	Thread
G	Metal	Key	660	660	Thread
H	Metal	Switchless	660	250	Thread

INTERCHANGEABLE CAPS FOR TYPE I LAMPHOLDERS


Style 1


Style 2


Style 5 Style 7 Style 9


Style 10 Style 12 Style 13


Cap style	Material	Description	Size of fitting or grip
1	Metal	Porcelain; with composition bushing	For cord diameters of 1/4" to 3/8"
2	Metal	Porcelain; with composition bushing and cord grip	
3	Metal	With female threaded pipe fitting	For 1/8" pipe
7	Metal	With female threaded pipe fitting	For 3/8" pipe
9	Metal	With female threaded pipe fitting	For 1/2" pipe
10	Metal	With female threaded pipe fitting; 90° angle	For 1/8" pipe
12	Metal	With female threaded pipe fitting; 90° angle	For 3/8" pipe
13	Metal	With female threaded pipe fitting; 90° angle	For 1/2" pipe

Note.—The complete lampholder shall be identified by the type number which includes the body class letter and the cap style number, for example: Type I–A5, I–B7.

FIGURE 1.—Type I press-fit attaching, standard size.


Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

INTERCHANGEABLE BODIES FOR TYPE IIIm LAMPHOLDERS

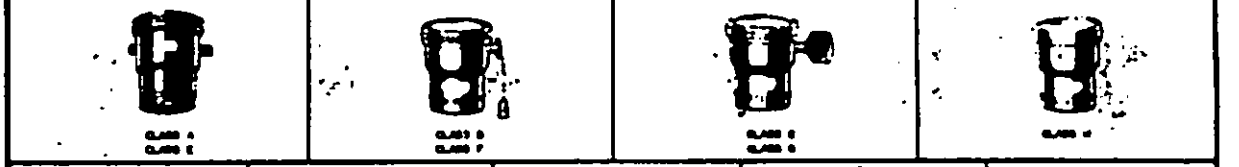

BODY CLASS	MATERIAL OF SHELL	SWITCH SECTION	RATING	
			WATTS	VOLTS
A	METAL	PUSH BUTTON	660	250
B	METAL	PULL CHAIN	660	250
C	METAL	KEY	660	250
E	METAL	PUSH BUTTON	660	250
F	METAL	PULL CHAIN	660	250
G	METAL	KEY	660	250
H	METAL	SWITCHLESS	660	250

INTERCHANGEABLE CAPS FOR TYPE IIIm LAMPHOLDERS

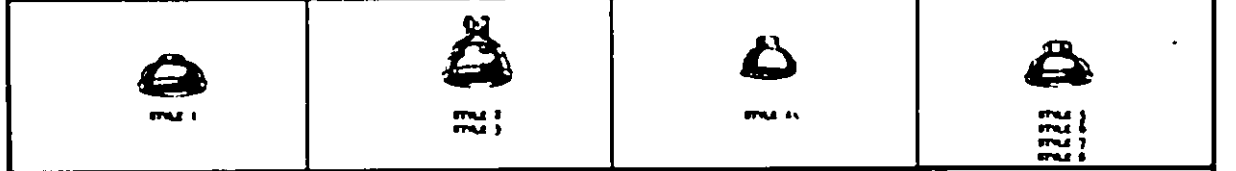


CAP STYLE	MATERIAL	DESCRIPTION	SIZE OF FITTING OR OPEN
1	METAL	PUSHOUT; WITH COMPOSITION BUSHING.	FOR WIRE DIAMETERS OF 1/64" TO 3/64"
2	METAL	PUSHOUT; WITH COMPOSITION BUSHING AND CORD GRIP.	FOR WIRE DIAMETERS OF 3/64" TO 1/8"
3	METAL	PUSHOUT; WITH COMPOSITION BUSHING AND CORD GRIP.	
4	METAL	PUSHOUT; WITH PORCELAIN BUSHING.	
5	METAL	WITH FEMALE THREADED PIPE FITTING.	FOR 1/8" PIPE.
6	METAL	WITH FEMALE THREADED PIPE FITTING.	FOR 1/4" PIPE.
7	METAL	WITH FEMALE THREADED PIPE FITTING.	FOR 3/8" PIPE.
8	METAL	WITH FEMALE THREADED PIPE FITTING.	FOR 1/2" PIPE.

Note.—The complete lampholder shall be identified by the type number which includes the body class letter and the cap style number, for example: Type IIIm–B3, Type IIIm–H8.

Figure 2.—Type IIIm, thread-attaching, standard size (metal).

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

INTERCHANGEABLE BODIES FOR TYPE IIIp LAMPHOLDERS.

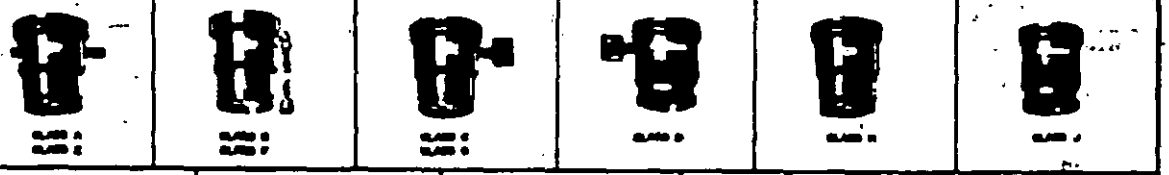

BODY CLASS	MATERIAL OF OUTER SHELL	SWITCH DESIGN	RATING		PROVISION FOR ATTACHMENT
			WATTS	VOLTS	
A	THERMO-SETTING PLASTIC	PUSH BUTTON	660	250	THREAD
B	"	PULL CHAIN	660	250	THREAD
C	"	KEY	660	250	THREAD
D	"	PUSH BUTTON	660	250	CHECK
E	"	PULL CHAIN	660	250	THREAD
F	"	KEY	660	250	THREAD
G	"	SWITCHLESS	660	250	THREAD
J	"	SWITCHLESS	660	250	CHECK

INTERCHANGEABLE CAPS FOR TYPE IIIp LAMPHOLDERS



STYLE 1 STYLE 2 STYLE 3 STYLE 7

CAP STYLE	MATERIAL	DESCRIPTION	SIZE OF FITTING OR CORD
1	THERMO-SETTING PLASTIC	POCKET; WITH COMPOSITION BUSHING.	
2	"	PENDENT; WITH COMPOSITION BUSHING AND CORD GRIP.	FOR CORD DIAMETERS OF 3/16" TO 1/2"
3	"	WITH FEMALE THREADED PIPE FITTING.	FOR 1/8" PIPE.
7	"	WITH FEMALE THREADED PIPE FITTING.	FOR 1/4" PIPE.

Note.—The complete lampholder shall be identified by the type number which includes the body class letter and the cap style number, for example: Type III_p–C3, Type III_p–H7.

FIGURE 3.—Type IIIp, thread-attaching, standard size (plastic).


Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

INTERCHANGEABLE BODIES FOR TYPE IV LAMPHOLDERS



B	PORCELAIN	FULL OHMS			
C	PORCELAIN	KEY			
F	PORCELAIN	PUSH SWITCH			
H	PORCELAIN	FULL OHMS			
	PORCELAIN				

INTERCHANGEABLE CAPS FOR TYPE IV LAMPHOLDERS

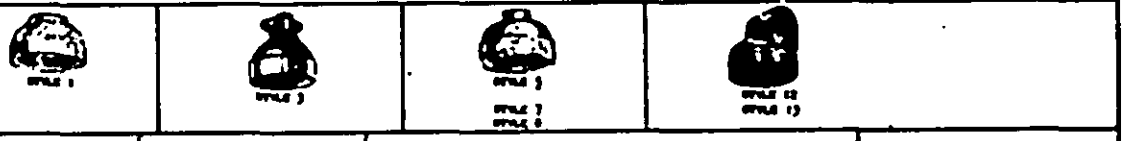


1	PORCELAIN	PORCELAIN.	
3	PORCELAIN	PORCELAIN; WITH COMPOSITION SLEEVE AND CORD GRIP.	
5	PORCELAIN	WITH FEMALE THREADED PIPE FITTING.	
7	PORCELAIN	WITH FEMALE THREADED PIPE FITTING.	
9	PORCELAIN	WITH FEMALE THREADED PIPE FITTING.	
11	PORCELAIN	WITH FEMALE THREADED PIPE FITTING, 90° ANGLE.	
13	PORCELAIN	WITH FEMALE THREADED PIPE FITTING, 90° ANGLE.	

Note.—The complete lampholder shall be identified by the type number which includes the body class letter and the cap style number, for example: Type IV–B5, Type IV–H8.

FIGURE 4.—Type IV, screw-attaching, standard size (porcelain).


Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.

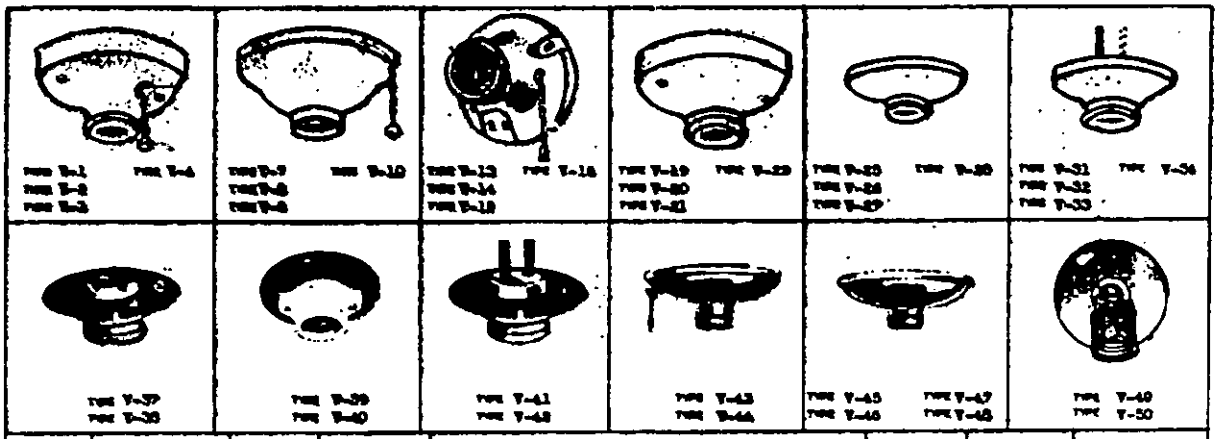


TYPE	MATERIAL	FINISH	RATING		DESCRIPTION	DESIGNATION FOR SHADEHOLDER	FOR OUTLET BOX HAVING	SPACING OF SCREW HOLES (ON CENTERS) INCHES TOLERANCE ±1/8
			AMPS	VOLTS			INCHES	
V-1	PORCELAIN	PULL CHAIN	250	250	RECESSED BACK	GROOVE	3-1/4	2-3/4
V-2	PORCELAIN	PULL CHAIN	250	250	RECESSED BACK	GROOVE	4	3-1/2
V-3	PLASTIC	PULL CHAIN	250	250	RECESSED BACK	GROOVE	3-1/4	2-3/4
V-4	PLASTIC	PULL CHAIN	250	250	RECESSED BACK	GROOVE	4	3-1/2
V-7	PORCELAIN	PULL CHAIN	250	250	CEILING STYLE	GROOVE	3-1/4	2-3/4
V-8	PORCELAIN	PULL CHAIN	250	250	CEILING STYLE	GROOVE	4	3-1/2
V-9	PLASTIC	PULL CHAIN	250	250	CEILING STYLE	GROOVE	3-1/4	2-3/4
V-10	PLASTIC	PULL CHAIN	250	250	CEILING STYLE	GROOVE	4	3-1/2
V-13	PORCELAIN	PULL CHAIN	250	125	WALL STYLE WITH CONVENIENCE OUTLET: 15A 125V	GROOVE	3-1/4	2-3/4
V-14	PORCELAIN	PULL CHAIN	250	125	WALL STYLE WITH CONVENIENCE OUTLET: 15A 125V	GROOVE	4	3-1/2
V-13	PLASTIC	PULL CHAIN	250	125	WALL STYLE WITH CONVENIENCE OUTLET: 15A 125V	GROOVE	3-1/4	2-3/4
V-15	PLASTIC	PULL CHAIN	250	125	WALL STYLE WITH CONVENIENCE OUTLET: 15A 125V	GROOVE	4	3-1/2
V-19	PORCELAIN	SWITCHLESS	660	250	RECESSED BACK	GROOVE	3-1/4	2-3/4
V-20	PORCELAIN	SWITCHLESS	660	250	RECESSED BACK	GROOVE	4	3-1/2
V-21	PLASTIC	SWITCHLESS	660	250	RECESSED BACK	GROOVE	3-1/4	2-3/4
V-22	PLASTIC	SWITCHLESS	660	250	RECESSED BACK	GROOVE	4	3-1/2
V-25	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS	GROOVE	3-1/4	2-3/4
V-26	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS	GROOVE	4	3-1/2
V-27	PLASTIC	SWITCHLESS	660	250	WITH SCREW TERMINALS	GROOVE	3-1/4	2-3/4
V-28	PLASTIC	SWITCHLESS	660	250	WITH SCREW TERMINALS	GROOVE	4	3-1/2
V-31	PORCELAIN	SWITCHLESS	660	250	WITH LEAD-IN WIRES	GROOVE	3-1/4	2-3/4
V-32	PORCELAIN	SWITCHLESS	660	250	WITH LEAD-IN WIRES	GROOVE	4	3-1/2
V-33	PLASTIC	SWITCHLESS	660	250	WITH LEAD-IN WIRES	GROOVE	3-1/4	2-3/4
V-34	PLASTIC	SWITCHLESS	660	250	WITH LEAD-IN WIRES	GROOVE	4	3-1/2
V-37	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS AND METAL COVER	GROOVE	3-1/4	2-3/4
V-38	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS AND METAL COVER	GROOVE	4	3-1/2
V-39	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS AND PLASTIC COVER	GROOVE	3-1/4	2-3/4
V-40	PORCELAIN	SWITCHLESS	660	250	WITH SCREW TERMINALS AND PLASTIC COVER	GROOVE	4	3-1/2
V-41	PORCELAIN	SWITCHLESS	660	250	WITH LEAD-IN WIRES AND METAL COVER	GROOVE	3-1/4	2-3/4
V-42	PORCELAIN	SWITCHLESS	660	250	WITH LEAD-IN WIRES AND METAL COVER	GROOVE	4	3-1/2
V-43	METAL	PULL CHAIN	250	250	CEILING STYLE	THREAD	3-1/4	2-3/4
V-44	METAL	PULL CHAIN	250	250	CEILING STYLE	THREAD	4	3-1/2
V-45	METAL	SWITCHLESS	660	250	CEILING STYLE	THREAD	3-1/4	2-3/4
V-46	METAL	SWITCHLESS	660	250	CEILING STYLE	THREAD	4	3-1/2
V-47	METAL	SWITCHLESS	660	250	CEILING STYLE	THREAD	3-1/4	2-3/4
V-48	METAL	SWITCHLESS	660	250	CEILING STYLE	THREAD	4	3-1/2
V-49	PLASTIC/METAL	SWITCHLESS	660	250	PLASTIC SOCKET, ADJUSTABLE: 180° VERTICALLY & 360° HORIZONTALLY, METAL Box Cover	NONE	3-1/4	2-3/4
V-50	PLASTIC/METAL	SWITCHLESS	660	250	PLASTIC SOCKET, ADJUSTABLE: 180° VERTICALLY & 360° HORIZONTALLY, METAL Box Cover	NONE	4	3-1/2

FIGURE 5.—Type V, lampholders for outlet box mounting.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

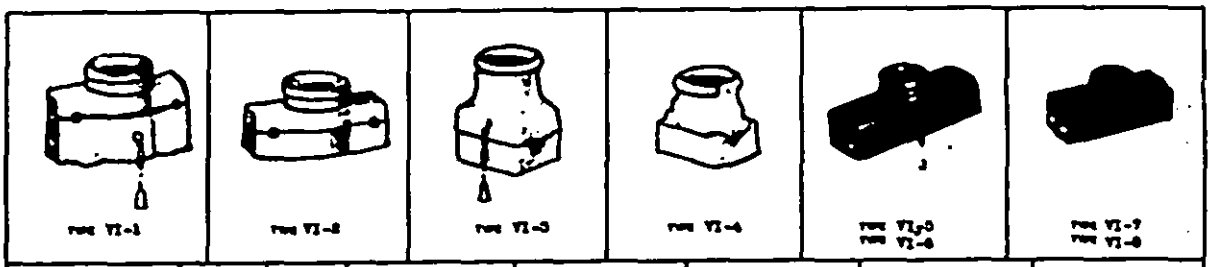


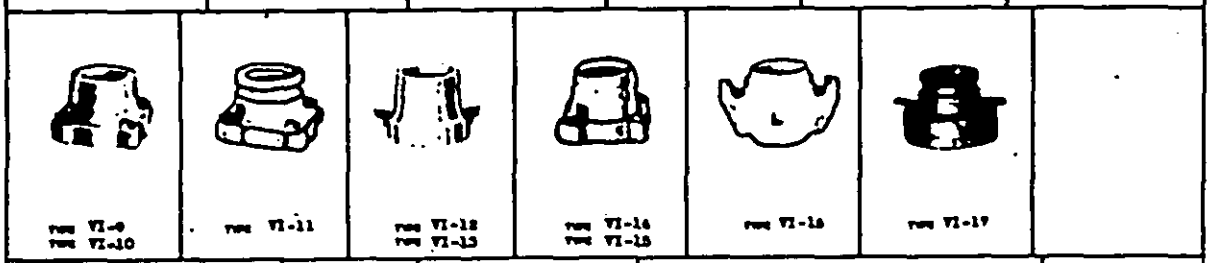

VI - 1	PORCELAIN	FULL CHAIN	typ	typ	RECTANGULAR	GROOVE
VI - 2	PORCELAIN	SWITCHLESS	660	typ	RECTANGULAR	GROOVE
VI - 3	PORCELAIN	FULL CHAIN	typ	typ	RECTANGULAR	GROOVE
VI - 4	PORCELAIN	SWITCHLESS	660	typ	RECTANGULAR	GROOVE
VI - 5	PORCELAIN	FULL CHAIN	typ	typ	RECTANGULAR	GROOVE
VI - 6	PLASTIC	FULL CHAIN	typ	typ	RECTANGULAR	GROOVE
VI - 7	PORCELAIN	SWITCHLESS	660	typ	RECTANGULAR	GROOVE
VI - 8	PLASTIC	SWITCHLESS	660	typ	RECTANGULAR	GROOVE
VI - 9	PORCELAIN	SWITCHLESS	660	typ	FANCY BASE	NONE
VI -10	PLASTIC	SWITCHLESS	660	typ	FANCY BASE	NONE
VI -11	PORCELAIN	SWITCHLESS	660	typ	FANCY BASE	GROOVE
VI -12	PORCELAIN	SWITCHLESS	660	typ	ROUND BASE	NONE
VI -13	PLASTIC	SWITCHLESS	660	typ	ROUND BASE	NONE
VI -14	PORCELAIN	SWITCHLESS	660	typ	FANCY BASE	NONE
VI -15	PLASTIC	SWITCHLESS	660	typ	FANCY BASE	NONE
VI -16	PORCELAIN	SWITCHLESS	660	typ	FANCY BASE, WITH RAISED TERMINALS	NONE
VI -17	PORCELAIN	SWITCHLESS	660	typ	ROUND BASE, WITH LEAD-IN GRID	GROOVE

FIGURE 6.—Type VI, lampholders for client wiring.


Source: https://assist.dla.mil -- Downloaded: 2026l0-26T11:25Z
Check the source to verify that this is the current version before use.

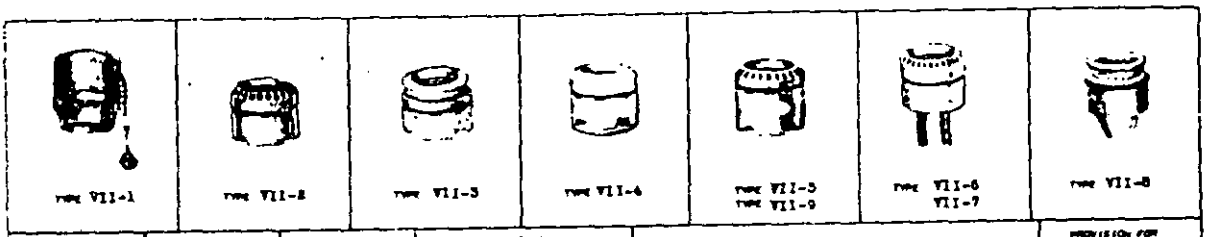

TYPE NUMBER	MATERIAL	SWITCH DESIGN	RATING		DESCRIPTION	PROVISION FOR SHADEHOLDER
			WATTS	VOLTS		
VII- 1	PORCELAIN	PULL CHAIN	250	250	DEEP STYLE	NONE
VII- 2	PORCELAIN	SWITCHLESS	660	250	SHALLOW STYLE WITH BINDING SCREWS	NONE
VII- 3	PORCELAIN	SWITCHLESS	660	250	SHALLOW STYLE WITH BINDING SCREWS	GROOVE
VII- 4	PORCELAIN	SWITCHLESS	660	250	SHALLOW STYLE WITH BINDING SCREWS AND COVERED TERMINALS	NONE
VII- 5	PORCELAIN	SWITCHLESS	660	250	DEEP STYLE WITH BINDING SCREWS	NONE
VII- 6	PORCELAIN	SWITCHLESS	660	250	SHALLOW STYLE WITH LEAD-IN WIRES	NONE
VII- 7	PORCELAIN	SWITCHLESS	660	600	SHALLOW STYLE WITH LEAD-IN WIRES	NONE
VII- 8	PORCELAIN	SWITCHLESS	660	600	SHALLOW STYLE WITH LEAD-IN WIRES	GROOVE
VII- 9	PORCELAIN	SWITCHLESS	660	600	DEEP STYLE WITH BINDING SCREWS	NONE

Note: Type VII lampholders shall be designed for mounting on 2-1/2 inch diameter hole.

FIGURE 7. Type VII lampholders for wire mounting.

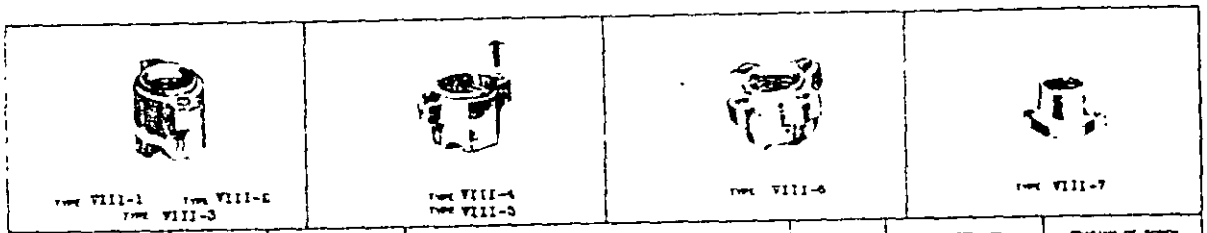

TYPE NUMBER	MATERIAL	SWITCH DESIGN	RATING		DESCRIPTION	PROVISION FOR SHADEHOLDER	DIAMETER OF MOUNTING HOLE INCHES TOLERANCE ± 1/32	SPACING OF SCREW HOLES (ON CENTERS) INCHES TOLERANCE ± 1/32
			WATTS	VOLTS				
VIII-1	PORCELAIN	SWITCHLESS	660	250	ONE PIECE, WITH BINDING SCREWS	NONE	1-3/8	1-13/16
VIII-2	PLASTIC	SWITCHLESS	660	600	ONE PIECE, WITH BINDING SCREWS	NONE	1-3/8	1-13/16
VIII-3	PORCELAIN	SWITCHLESS	660	250	ONE PIECE, WITH LOOP TERMINALS	NONE	1-3/8	1-13/16
VIII-4	PORCELAIN	SWITCHLESS	660	250	ONE PIECE, WITH BINDING SCREWS, SPRING STUD AND SCREW	NONE	1-3/8	1-13/16
VIII-5	PORCELAIN	SWITCHLESS	660	600	ONE PIECE, WITH BINDING SCREWS, SPRING STUD AND SCREW	NONE	1-3/8	1-13/16
VIII-6	PORCELAIN	SWITCHLESS	660	250	ONE PIECE, FOR WOODEN SIGNS	NONE	1-1/2	1-13/16
VIII-7	PORCELAIN	SWITCHLESS	660	250	ONE PIECE, WITH FOUR SCREWS	NONE	1-3/8	1-13/16

FIGURE 8. Type VIII lampholders for signs.

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:25Z
Check the source to verify that this is the current version before use.



Type IX-5
Type IX-6

Type IX-7
Type IX-8



Type IX-9



Type IX-10



Type IX-11




Type IX-12

TYPE NUMBER	MATERIAL	SWITCH DESIGN	RATING WATTS	RATING VOLTS	DESCRIPTION	PROVISION FOR GROUNDING
IX - 5	PORCELAIN	SWITCHLESS	660	250	WITH LAMPHOLDER WITH METAL 1/8" FEMALE THREADED PIPE FITTING	NONE
IX - 6	PLASTIC	SWITCHLESS	660	250	WITH LAMPHOLDER WITH METAL 1/8" FEMALE THREADED PIPE FITTING	NONE
IX - 7	PORCELAIN	SWITCHLESS	660	250	WITH LAMPHOLDER WITH METAL 1/4" FEMALE THREADED PIPE FITTING	NONE
IX - 8	PLASTIC	SWITCHLESS	660	250	WITH LAMPHOLDER WITH METAL 1/4" FEMALE THREADED PIPE FITTING	NONE
IX - 9	PORCELAIN	SWITCHLESS	660	250	WITH METAL 1/8" FEMALE THREADED PIPE FITTING	NONE
IX -10	PORCELAIN	SWITCHLESS	660	250	WITH METAL 1/8" FEMALE THREADED PIPE FITTING, 90° ANGLE	NONE
IX - 11	PORCELAIN	SWITCHLESS	660	600	TERMINAL BLOCK FASTENED TO OUTER SHELL BY TWO SCREWS IN LAMPHOLDER BASE	NONE
IX - 12	PORCELAIN	SWITCHLESS	660	250	COLLAR THREADED ON TO LAMPHOLDER BASE	NONE

FIGURE 9.—Type IX, lampholders for miscellaneous uses.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

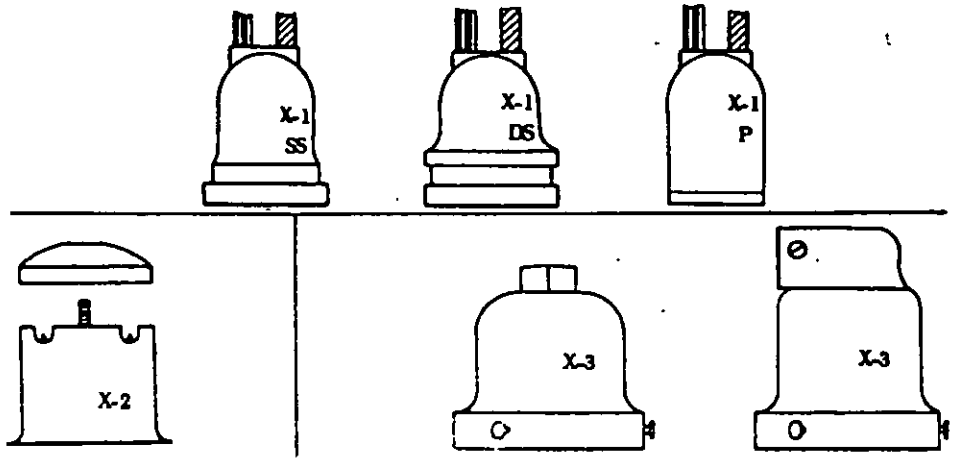

Type number shall consist of the basic design, material class, shadeholder provision, and when applicable, size of wire channel or pipe fitting, e.g. X1-A-SS-14. X3-E-H-½A.

Basic design	Material class
X1—Pigtail	A—Porcelain
X2—Pin terminal	B—Thermosetting plastic
X3—Conduit	C—Rubber
	D—Composition
	E—Porcelain with metal head

Shadeholder provision

SS—Single shoulder forming ledge for shadeholder.
DS—Double shoulder forming groove for shadeholder.
P —Plain- .o provision for shadeholder.
H —Shadeholder for a 2½-inch shade integral with metal hood (see 3.12.3).

Wire channel size (X2 design only)

10—Having channels across top of body to accommodate No. 10 and No. 12 wires.
14—Having channel across top of body to accommodate No. 12 and No. 14 wires.

Pipe fitting size (X3 design only)

⅜ —⅜-inch female pipe thread.
½S—½-inch female pipe thread.
½A—½-inch female pipe thread with 90 degree angle between axis of pipe thread and axis of socket.

FIGURE 10.—Type X, weatherproof lampholders, switchless.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.



ADAPTER- LAMPHOLDER TO PLUG, 125 VOLT

TYPE No.	Plug-in Design		Accommodation Design Poles (Polarized)	Material
	Screw Size	Rating		
701	Medium	660 watts	2-Pole, Parallel, Regular Size	Molded Plastic



ADAPTER - LAMPHOLDER TO CURRENT TAPS, 125 VOLT

TYPE No.	Plug-in Design Screw Size	Accommodation Design					Material
		Bladed		Medium Screw			
		Poles and Rating (Polarized	Number	Number	Watts	Switch	
771	Medium	2-Pole, Parallel, 660 watts	2	1	250	Pull	Molded Plastic



ADAPTERS LAMPHOLDER, MOGUL TO MEDIUM REDUCTION 250 V.

TYPE No.	Plug-in Design Screw Size	Accommodation Design			Material
		Screw Size	Feature	Watts	
886	Mogul	Medium	Reduction	660	Porcelain

Figure 11. Adapters.

U. S. GOVERNMENT PRINTING OFFICE, 1960

Copies of this specification may be purchased for 15 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE NAVY

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATE

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 12503 WASHINGTON D. C.

POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE NAVY

Commanding Officer
Naval Construction Battalion Center
Code 156
Port Hueneme, CA 93043

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:25Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR
b. ADDRESS *(Street, City, State, ZIP Code)*	☐ USER
	☐ MANUFACTURER
	☐ OTHER *(Specify)*: _____

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

Source: https://assist.dla.mil -- Downloaded: 2026-10-26 11:25Z
Check the source to verify that this is the current version before use.