METRIC

DOD-B-24200/5A(SH)
23 October 1978
SUPERSEDING
MIL-B-24200/5(SHIPS)
18 November 1963


MILITARY SPECIFICATION SHEET

BATTERY CELLS AND ELEMENTS, LEAD-ACID, LEAD-ANTIMONY,

MAIN STORAGE, SUBMARINE, TYPE GUPPY I (METRIC)

This specification sheet is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the batteries and elements described herein shall consist of this document and the latest issue of DOD-B-24200.

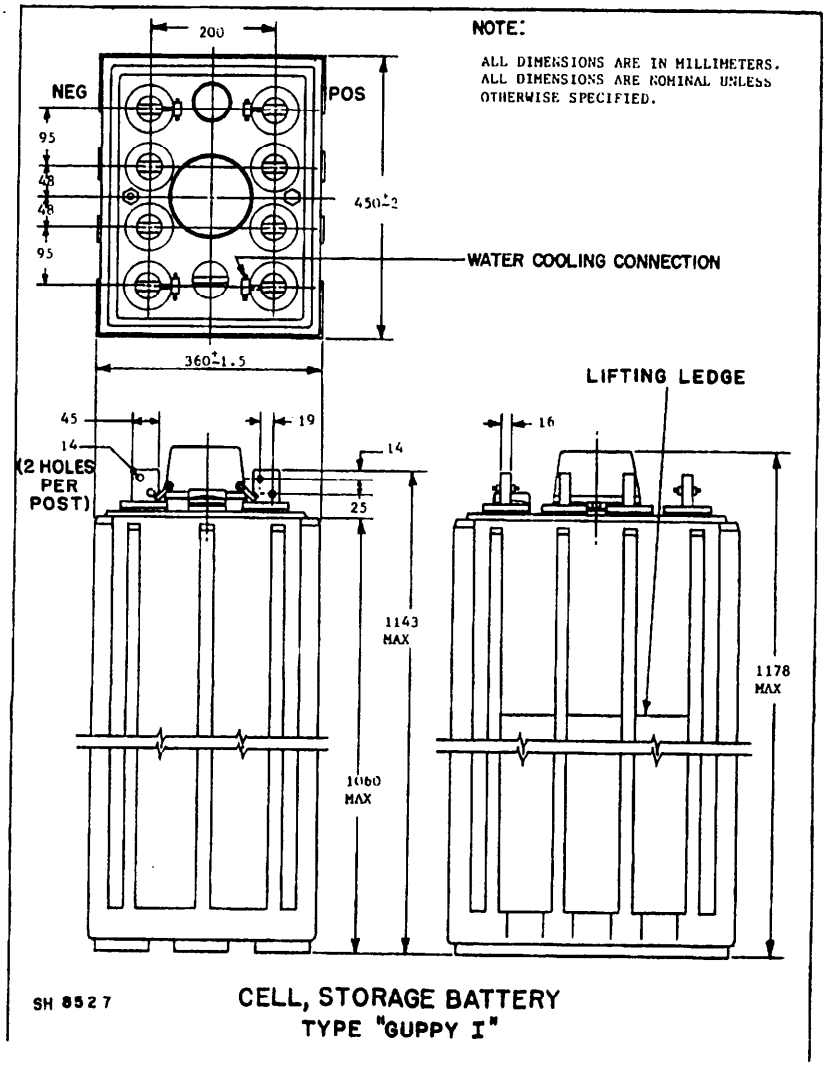

FSC 6140

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T19:56Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Class: 2.

Electrolyte specific gravity: 1.265 nominal.

Measurement of capacity: Capacity in ampere-hours is based on an initial electrolyte temperature of 26.7°C, specific gravity of 1.265, and shall be not less than as specified in table I.

TABLE I. Electrical characteristics.

Capacity ampere-hour	Time hours	Discharge current amperes	Minimum battery voltage		Minimum cell voltage	
			252-cell group			
			Average	Final	Average	Final
3,387	1/2	6,775	390	320	1.31	1.05
4,340	1	4,340	424	360	1.46	1.28
5,505	3	1,835	462	402	1.61	1.51
6,100	5	1,220	472	414	1.65	1.57
6,270	6	1,045	476	416	1.66	1.58
6,850	10	685	482	424	1.69	1.63
7,400	20	370	488	430	1.71	1.66
7,740	36	215	492	434	1.72	1.68
7,920	48	165	494	434	1.72	1.68

Mass per cell (filled and charged):
Maximum: 467 kilograms (kg).
Maximum average: 458 kg.

Guaranteed service life (equivalent cycle equals 5000 ampere-hours of charge): 300 equivalent cycles or 30 months, whichever occurs first.

Hydrogen evolution (maximum):
Initial: 50 cubic centimeters (cm^3).
After sixth routine: 122 cm^3.

Demonstration of rated capacity: within 30 equivalent cycles.

Routine 18-hour discharge rate: 110 amperes.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 6140-N486-3)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T19:56Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS: This form is provided to solicit beneficial comments which may improve this document and enhance its use. DoD contractors, government activities, manufacturers, vendors, or other prospective users of the document are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity. A response will be provided to the submitter, when name and address is provided, within 30 days indicating that the 1426 was received and when any appropriate action on it will be completed.
NOTE: This form shall not be used to submit requests for waivers, deviations or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

DOCUMENT IDENTIFIER *(Number)* AND TITLE
DOD - B- 24200/5A METRIC

NAME OF ORGANIZATION AND ADDRESS OF SUBMITTER

☐ VENDOR ☐ USER ☐ MANUFACTURER

1. ☐ HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE? ☐ IS ANY PART OF IT TOO RIGID, RESTRICTIVE, LOOSE OR AMBIGUOUS? PLEASE EXPLAIN BELOW.

A. GIVE PARAGRAPH NUMBER AND WORDING

B. RECOMMENDED WORDING CHANGE

C. REASON FOR RECOMMENDED CHANGE(S)

2. REMARKS

SUBMITTED BY *(Printed or typed name and address — Optional)*	TELEPHONE NO.
	DATE

DD FORM 1 OCT 76 1426 Replaces edition of 1 Jan 72 which may be used. S/N 0102-LF-001-4260

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T19:56Z
Check the source to verify that this is the current version before use.