[INCH-POUND]
A-A-55427C
May 3, 2007
SUPERSEDING
A-A-55427B
February 1, 2006

COMMERCIAL ITEM DESCRIPTION

# FUSEHOLDER, BLOCK, CLASS H, 60 AMPERE, 250 V AC, ONE, TWO, AND THREE POLE

The General Services Administration has authorized the use of this commercial item description for all federal agencies.

1. SCOPE. This CID covers the general requirements for one, two, and three pole, 60 ampere, 250 V AC, type H fuseholder blocks. Fuseholders covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION/PART OR IDENTIFICATION NUMBER (PIN). This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 7.1).

| AA55427 | - | 001 |
|---|---|---|
| CID number | | Dash number (see table I) |

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Fuseholders supplied to this CID shall be as specified herein and shall meet the requirements of UL 512 for class H fuseholders (see figure 1).

3.2. Ampere rating. The ampere rating shall be 60 amperes maximum.

3.3 Voltage rating. The voltage rating shall be 250 V ac maximum.

3.4 Interrupting rating. This class H fuseholder shall be used with class H fuses that have an interrupting rating of 10,000 amperes maximum.

3.5 Wire termination. Wire termination shall be specified on figure 2 and as follows:

a. Screw connector for use with spade tugs or ring terminals.

b. Screw with pressure plate connector for use with solid or standard wire without terminal (recommended where vibration will be a factor).

c. Box lug connector (the most durable). For use with all types of wire without terminal.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAT, P.O. Box 3990, Columbus, OH 43218-3990, or email to mailto:CircuitProtect@dscc.dla.mil. Since contact information can change you may want to verify the currency of the address information using the ASSIST Online database at http://assist.daps.dla.mil.

AMSC N/A FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

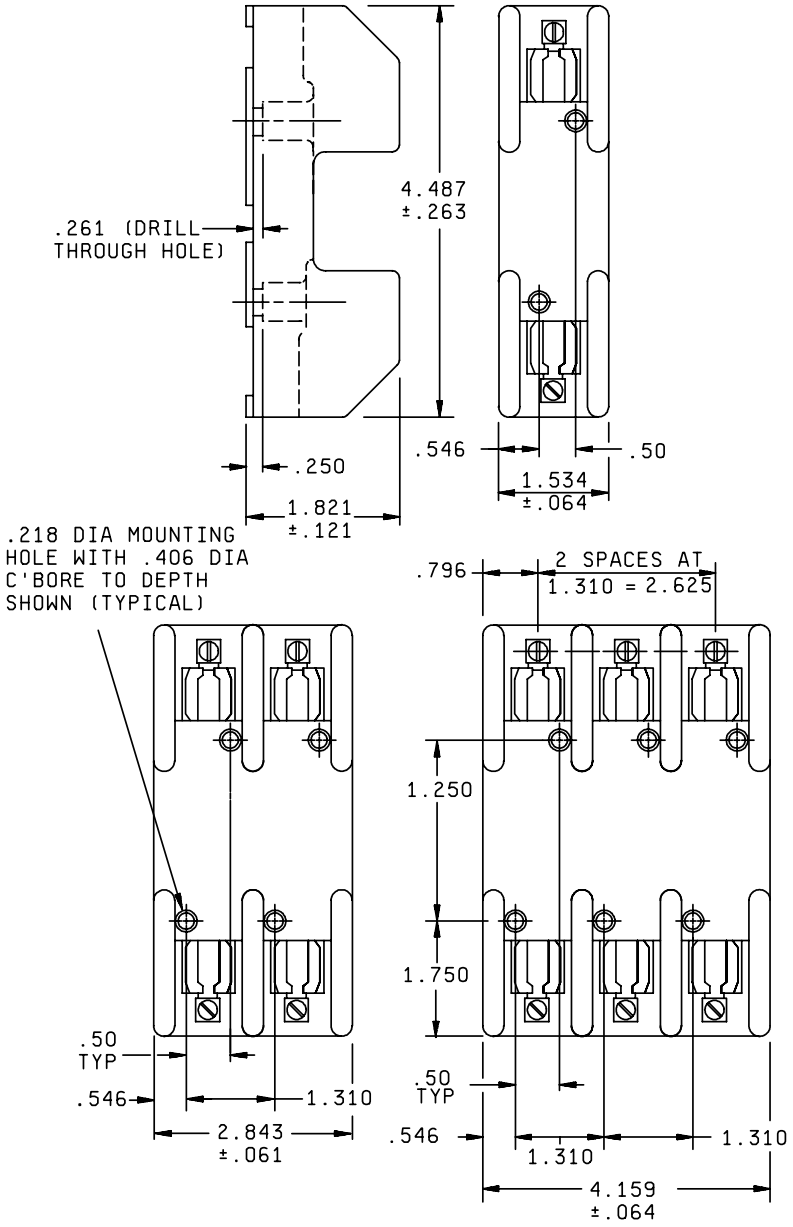



FIGURE 1. Configuration and dimensions.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

| Inches | mm | Inches | mm |
|---|---|---|---|
| .061 | 1.56 | .796 | 20.24 |
| .064 | 1.64 | 1.250 | 31.75 |
| .065 | 1.65 | 1.310 | 33.33 |
| .121 | 3.09 | 1.534 | 38.97 |
| .218 | 5.55 | 1.750 | 44.45 |
| .250 | 6.35 | 1.821 | 46.25 |
| .261 | 6.63 | 2.625 | 66.67 |
| .263 | 6.82 | 2.843 | 72.23 |
| .406 | 10.31 | 4.750 | 102.65 |
| .50 | 12.7 | 4.159 | 105.64 |
| .546 | 13.89 | 4.487 | 113.96 |

NOTES:

1. Dimensions are in inches.
2. Tolerance is ±.005 inch (0.13 mm), unless otherwise specified.

FIGURE 1. Configuration and dimensions - Continued.

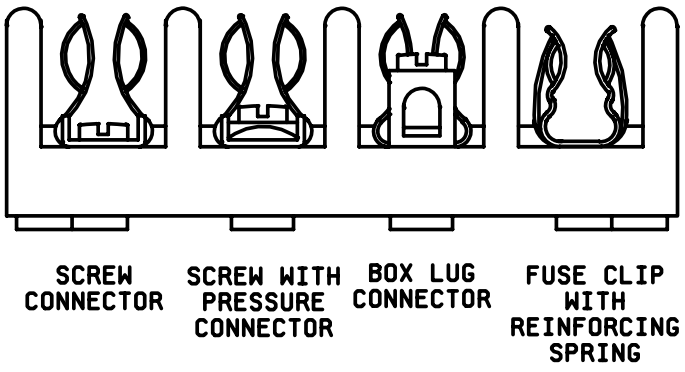



FIGURE 2. Wire termination configuration.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

TABLE I. Characteristics.

| AA55427- | Characteristics |
|---|---|
| 001 | 1 pole with screw connectors. |
| 002 | 1 pole with screw connectors. Fuse clips with reinforcing springs. |
| 003 | 1 pole with screws with pressure plate connectors. |
| 004 | 1 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs. |
| 005 | 1 pole with box lug connectors. |
| 006 | 1 pole with box lug connectors. Fuse clips with reinforcing springs. |
| 007 | 2 pole with screw connectors. |
| 008 | 2 pole with screw connectors. Fuse clips with reinforcing springs. |
| 009 | 2 pole, screws with pressure plate connectors. |
| 010 | 2 pole, screws with pressure plate connectors. Fuse clips with reinforcing springs. |
| 011 | 2 pole, screws with pressure plate connectors. |
| 012 | 2 pole with box lug connectors. Fuse clip with reinforcing springs. |
| 013 | 3 pole with screw connectors. |
| 014 | 3 pole with screw connectors. Fuse clips with reinforcing springs. |
| 015 | 3 pole, screws with pressure plate connectors. |
| 016 | 3 pole, screw with pressure plate connectors. Fuse clips with reinforcing springs. |
| 017 | 3 pole with box lug connectors. |
| 018 | 3 pole with box lug connectors. Fuse clips with reinforcing springs. |

3.6 Wire size. The maximum wire size shall be #10 CU-AL for screw connectors and screw with pressure plate connectors and #4 CU-AL for box lug connectors.

3.7 Reinforcing spring. Reinforcing springs are used for reinforcement of the fuse clip. Spring reinforced fuse clips are recommended if frequent fuse replacement is expected.

3.8 Fuse accomodation. This fuseholder accepts class H fuses with dimensions of 0.812 inch x 3.00 inches (20.63 mm x 76.2 mm).

3.9 Marking. Fuseholders supplied to this CID shall be marked with the manufacturer's (MFR's) standard commercial PIN and the UL listing mark. (NOTE: The part number marked on the unit pack shall be the CID PIN.)

3.10 Recycled, recovered, or environmentally preferable materials. Recycled, recovered, or environmentally preferable materials should be used to the maximum extent possible provided that the material meets or exceeds the operational and maintenance requirements, and promotes economically advantageous life cycle costs.

3.11 Workmanship. Fuseholders shall be processed in such a manner as to be uniform in quality and shall be free from other defects that will affect life, serviceability, or appearance.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

4. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

5. PRODUCT CONFORMANCE PROVISIONS

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b. The company producing the item must have sold 1,000 units meeting this CID in the commercial marketplace over the past 2 years.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Environmentally preferable material. Environmentally preferable materials should be used to the maximum extent possible to meet the requirements of this specification. Table II lists the Environmental Protection Agency's (EPA) top seventeen hazardous materials targeted for major usage reduction. Use of these materials should be minimized or eliminated unless needed to meet the requirements specified herein (see Section 3).

TABLE II. EPA top seventeen hazardous materials.

| | | |
|---|---|---|
| Benzene | Dichloromethane | Tetrachloroethylene |
| Cadmium and Compounds | Lead and Compounds | Toluene |
| Carbon Tetrachloride | Mercury and Compounds | 1,1,1 - Trichoroethane |
| Chloroform | Methyl Ethyl Ketone | Trichloroethylene |
| Chromium and Compounds | Methyl Isobutyl Ketone | Xylenes |
| Cyanide and Compounds | Nickel and Compounds | |

7.3 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuseholders to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.4 Source of documents.

Federal Regulations

FEDERAL ACQUISITION REGULATION (FAR)

FAR - Federal Acquisition Regulations.

(Copies of this document are available online at http://www.acquisition.gov/comp/far/index.html or from the U.S. Government Printing Office, 732 N. Capital Street, NW, Washington D.C. 20401-0001.)



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 512 - Fuseholders, Standard for Safety.

(Copies of this document are available online at http://www.ul.com/ or from the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.5 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Product conformance provisions.

c. Packaging requirements.

7.6 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

| MFR's CAGE | MFR's name and address |
|---|---|
| 26405 | Marathon Special Products<br>13300 Van Camp Road<br>Bowling Green, OH 43402-0468<br>Phone number (419) 352-8441<br>Facsimile number (419) 352-0875<br>E-mail: mailto:marketing@marathonsp.com<br>Uniform Resource Locator (URL): http://www.marathonsp.com/ |
| 71400 | Cooper Bussmann, Incorporated<br>P. O. Box 14460<br>St. Louis, MO 63178-4460<br>Phone number (636) 394-2877<br>Facsimile number (800) 544-2570<br>E-mail: mailto:fusebox@buss.com<br>URL: http://www.bussmann.com |
| 71424 | Ferraz Shawmut<br>374 Merrimac Street<br>Newburyport, MA 01950-1930<br>Phone number (978) 462-6662<br>Facsimile number (978) 462-3131<br>E-mail: mailto:info@ferrazshawmut.com<br>URL: http://www.gouldshawmut.com |
| 75915 | Littelfuse Incorporated<br>800 E. Northwest Highway<br>Des Plaines, IL 60016-3096<br>Phone number (847) 824-1188<br>Facsimile number (847) 391-0894<br>E-mail: mailto:electronics@littelfuse.com<br>URL: http://www.littelfuse.com |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

7.7 Part number (P/N) supersession data. These CID PINs supersedes the following MFR's P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE III. P/N supersession data.

| CID dash number AA55427- | MFR's CAGE 26405 | MFR's CAGE 71400 | MFR's CAGE 71424 | MFR's CAGE 75915 |
|---|---|---|---|---|
| | MFR's P/N 1/ | MFR's P/N 1/ | MFR's P/N 1/ | MFR's P/N 1/ |
| 001 | F60A1SQ | N/A | 20611 | LH25060-1S |
| 002 | RF60A1SQ | N/A | 20616 | LH25060-1SR |
| 003 | N/A | N/A | N/A | N/A |
| 004 | N/A | N/A | N/A | N/A |
| 005 | F60A1B | H25060-1C | 20601 | LH25060-1C |
| 006 | RF60A1B | H25060-1CR | 20606 | LH25060-1CR |
| 007 | F60A2SQ | N/A | 20612 | LH25060-2S |
| 008 | RF60A2SQ | N/A | 20617 | LH25060-2SR |
| 009 | N/A | N/A | N/A | N/A |
| 010 | N/A | N/A | N/A | N/A |
| 011 | F60A2B | H25060-2C | 20602 | LH25060-2C |
| 012 | RF60A2B | H25060-2CR | 20607 | LH25060-2CR |
| 013 | F60A3SQ | N/A | 20613 | LH25060-3S |
| 014 | RF60A3SQ | N/A | 20618 | LH25060-3SR |
| 015 | N/A | N/A | N/A | N/A |
| 016 | N/A | N/A | N/A | N/A |
| 017 | F60A3B | H25060-3C | 20603 | LH25060-3C |
| 018 | RF60A3B | H25060-3CR | 20608 | LH25060-3CR |

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown. For actual part marking requirements see 3.9.

7.8 Government users. To acquire information on obtaining these fuseholders from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-FMXA, Post Office Box 3990, Columbus, OH 43218-3990, or telephone (614) 692-7435.

7.8.1 National stock number (NSN). The following is a list of NSN's assigned which correspond to this CID. The list is for information only and may not be indicative of all possible NSN's associated with the CID. For up to date information on assigned NSN's, please contact the aforementioned DSCC office (See 7.7).



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

TABLE IV. NSN's.

| Dash number (see table I) AA55427- | NSN | Dash number (see table I) AA55427- | NSN |
|---|---|---|---|
| 001 | N/A | 010 | N/A |
| 002 | N/A | 011 | 5920-01-325-8842 |
| 003 | N/A | 012 | N/A |
| 004 | N/A | 013 | N/A |
| 005 | 5920-01-188-8294 | 014 | N/A |
| 006 | N/A | 015 | N/A |
| 007 | N/A | 016 | N/A |
| 008 | N/A | 017 | N/A |
| 009 | N/A | 018 | N/A |

7.9 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

MILITARY INTERESTS:

Custodians:
Navy - EC
DLA - CC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FSS

Preparing activity:

DLA-CC

Project 5920-2007-030

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.