
MIL-F-24646/17(SH)
30 November 1984
SUPERSEDING
(See table I)

MILITARY SPECIFICATION SHEET

FUSE BOXES, FEEDER JUNCTION, SUBMERSIBLE
(15 FEET), 500 VOLTS, ALTERNATING CURRENT, THREE PHASE BUSES,
0-30 AMPERE FUSES,
SYMBOL 693.1

This specification sheet is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the fuse boxes described herein shall consist of this document and the latest issue of MIL-F-24646(SH).

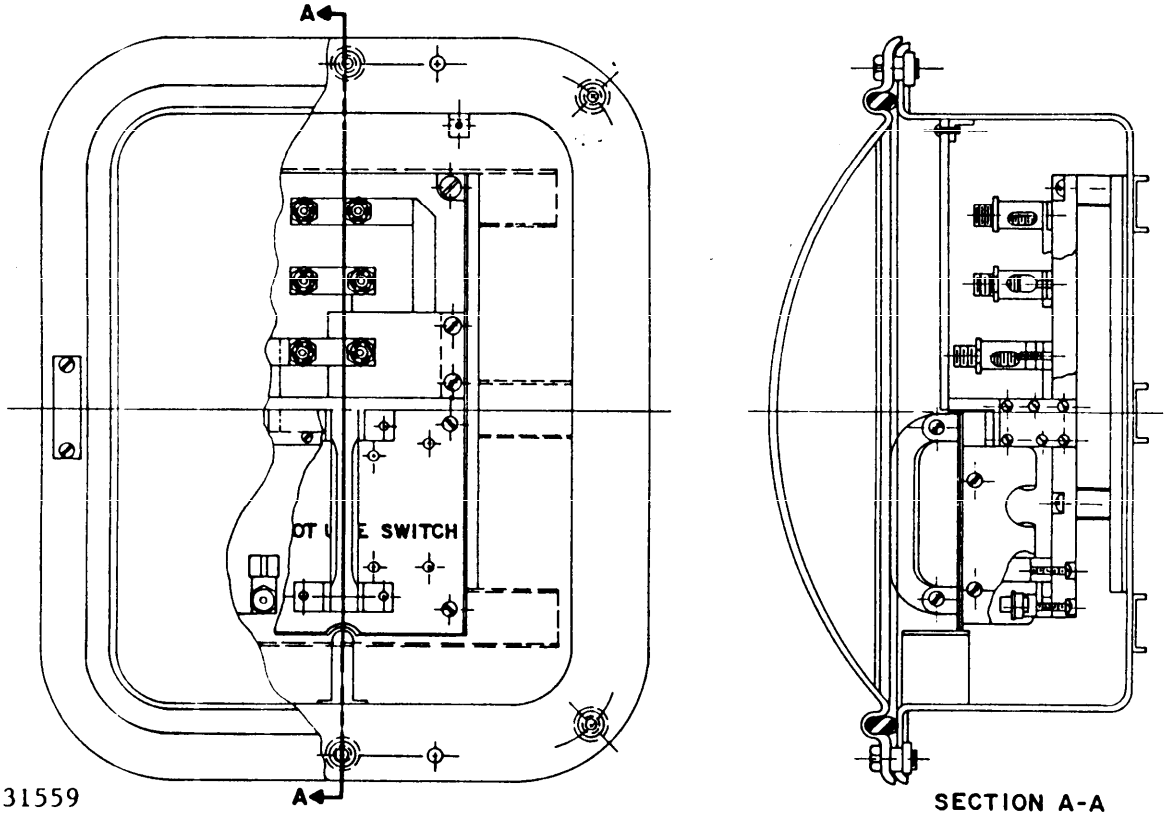

SH 131559

FIGURE 1. Fuse box assembly, typical. (01)
(Symbol 693.1 shown)

NOTES:

1. Dimensions are in inches.
2. Unless otherwise specified herein, tolerances shall be as follows:
   Two place decimals - plus or minus 0.02.
   Three place decimals - plus or minus 0.005.

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:36Z
Check the source to verify that this is the current version before use.


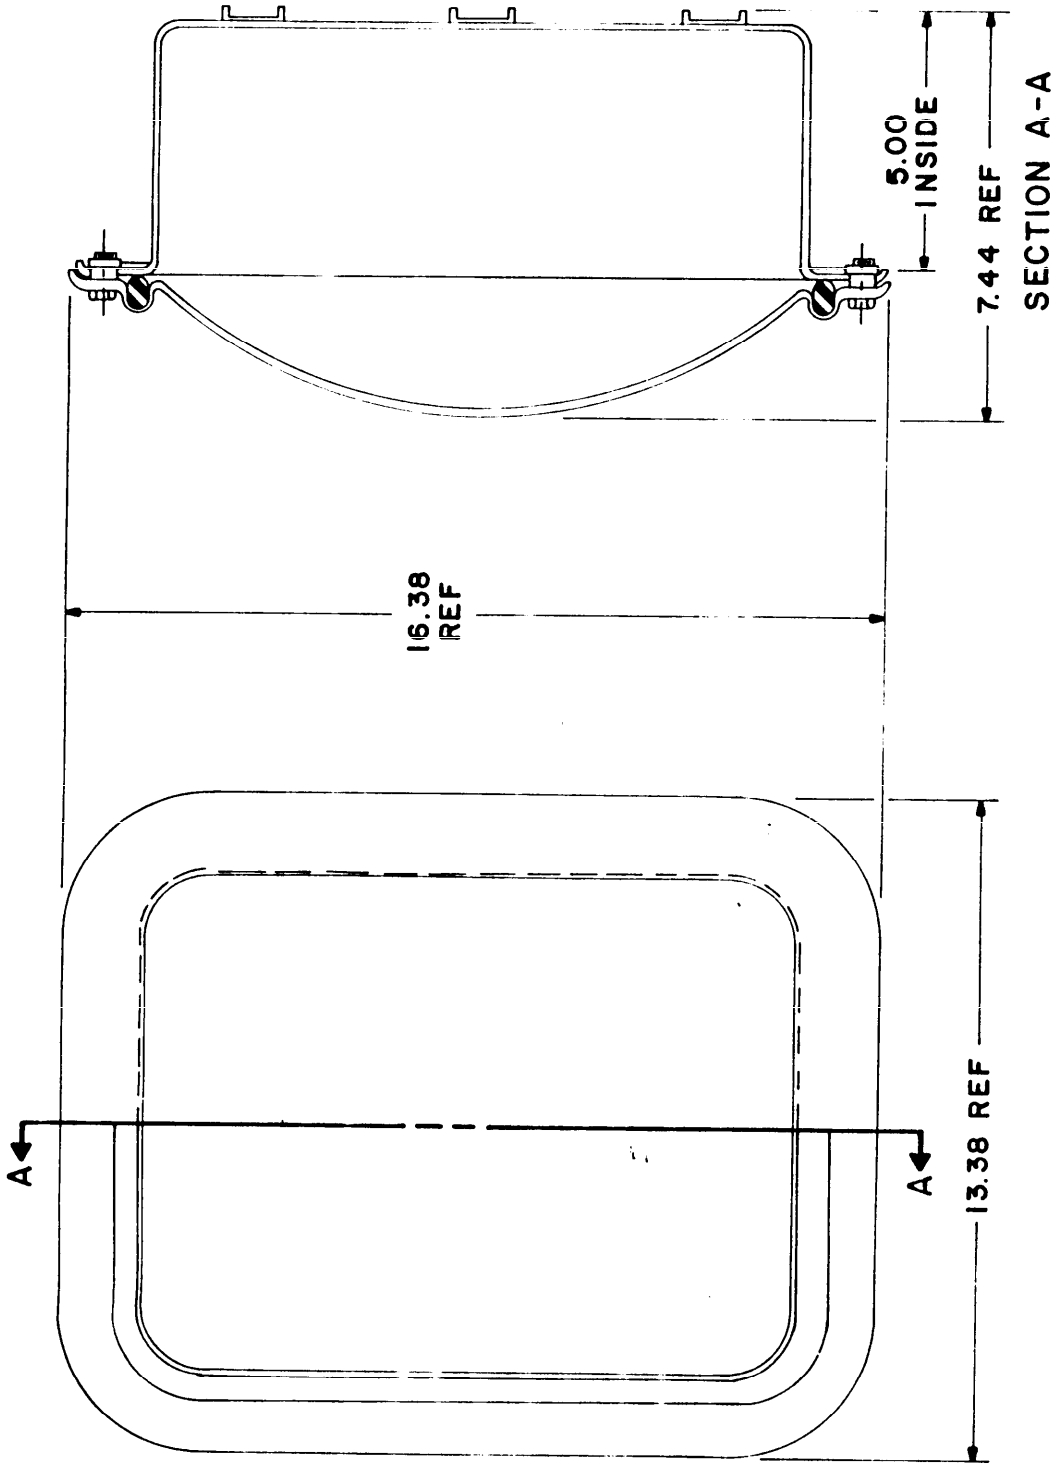


FIGURE 2. Enclosure, overall dimensions. (02)
(Symbol 693.1)

Sd 131560


Source: https://assist.dla.mil -- Downloaded: 202610-20T00:36Z
Check the source to verify that this is the current version before use.

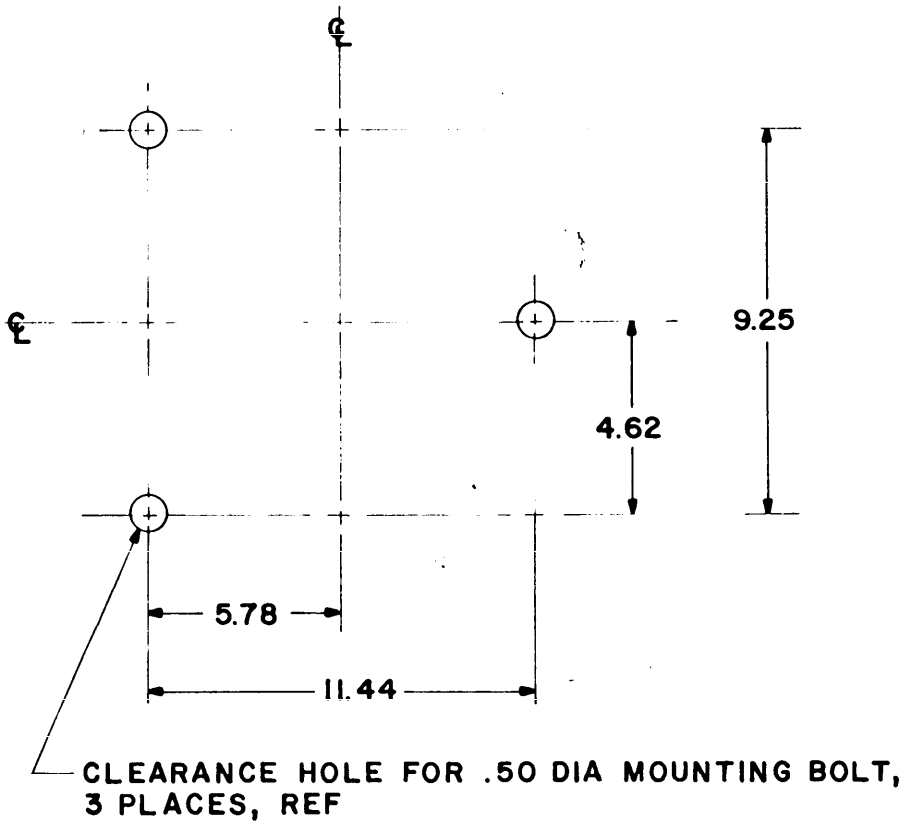

SH 131561

FIGURE 3. Mounting dimensions, ref.
(Symbol 693.1)


Source: https://assist.dla.mil -- Downloaded: 20261O-20T00:36Z
Check the source to verify that this is the currentversion before use.

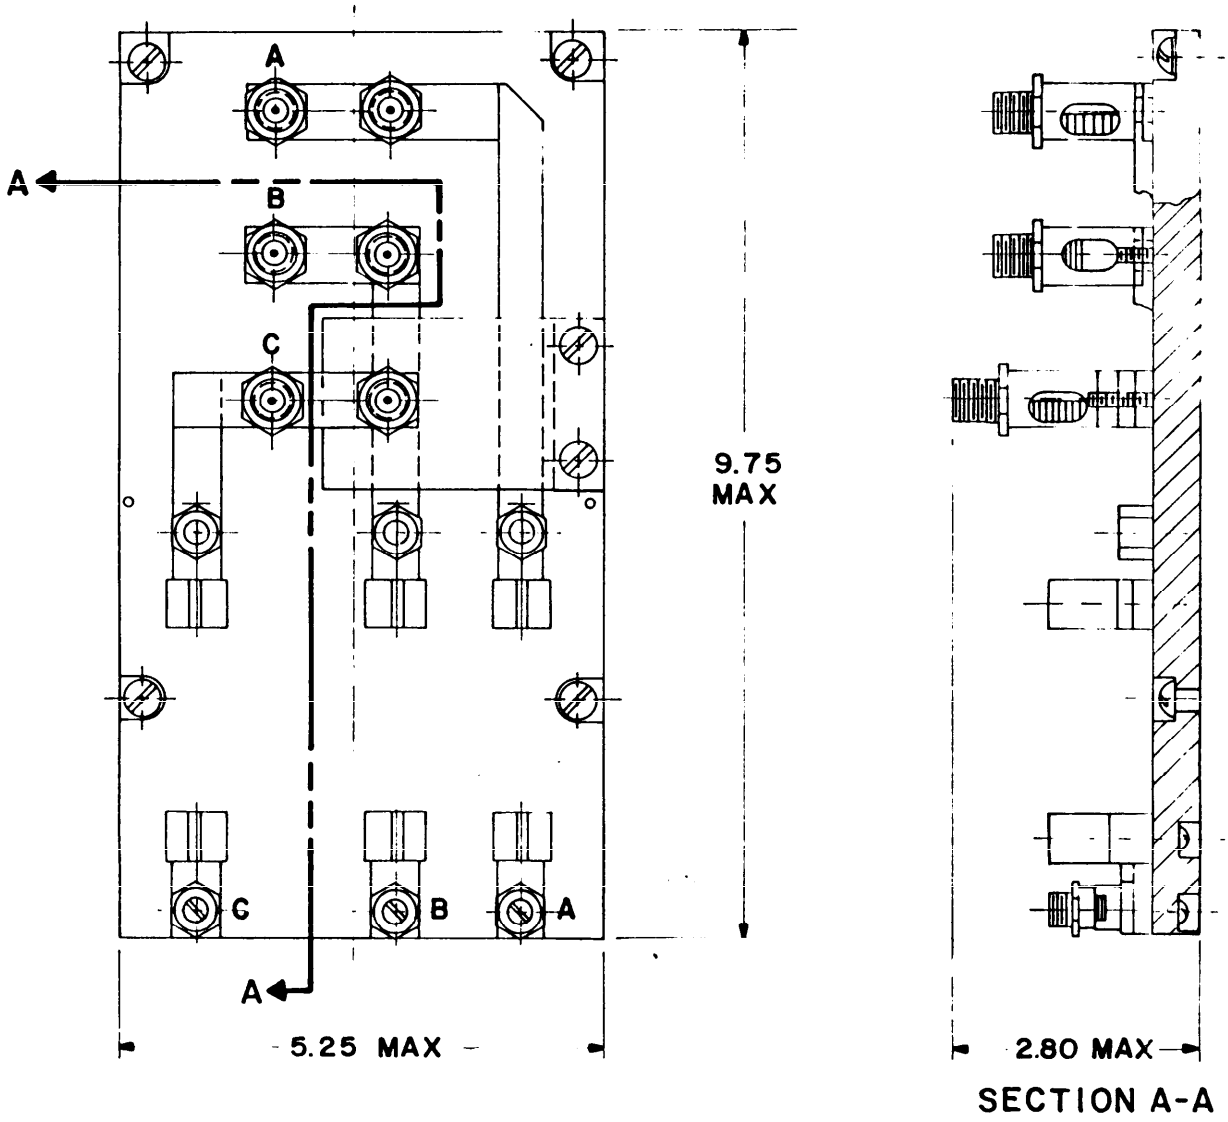

SH 131562

FIGURE 4. Fuse block assembly, typical. (03)
(Symbol 693.1)


Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:36Z
Check the source to verify that this is the current version before use.

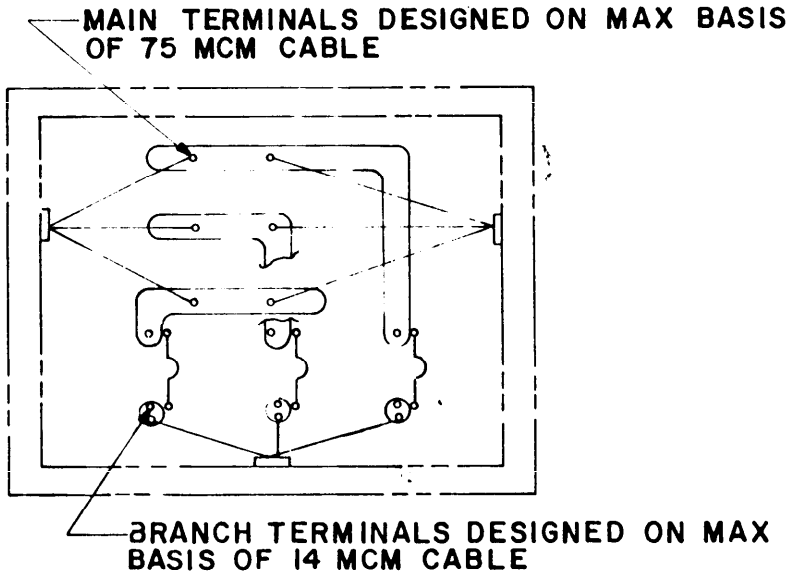

SH 131563

FIGURE 5. Wiring diagram. (04)
(Symbol 693.1)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:36Z
Check the source to verify that this is the current version before use.

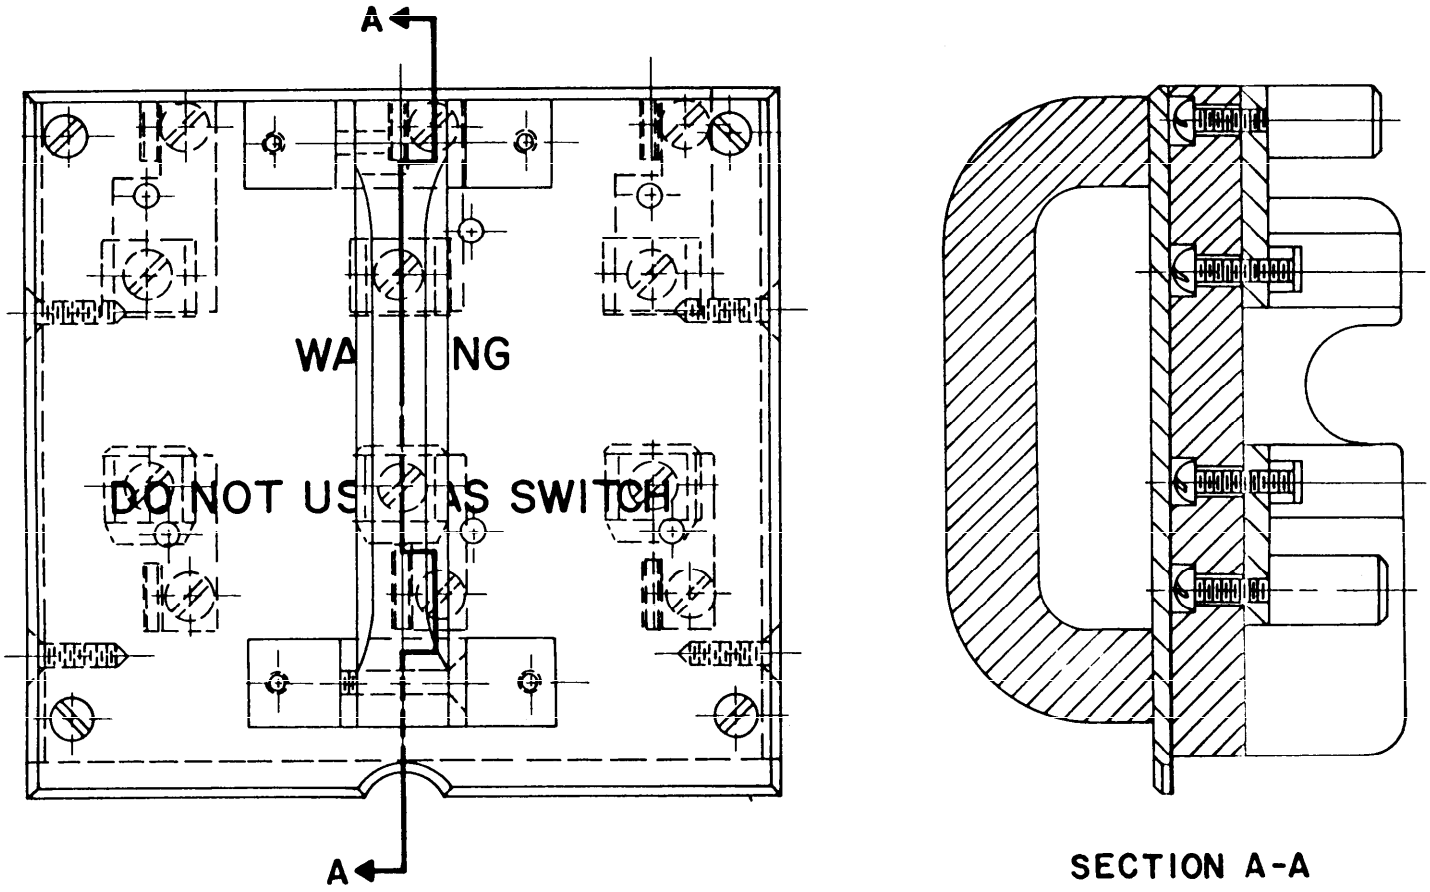

SH 131564

FIGURE 6. Fuse puller assembly, typical. (06)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:36Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Symbol numbers: See table I.

Design:

Electrical rating: 500 volts alternating current, 0-30 ampere, 60 hertz.
Dimensions and configuration: See figures 1, 2, 3 and 4.
Wiring diagrams: See figure 5.
Mounting dimensions: See figure 3.
Degree of enclosure: Submersible (15 feet).
Designation and marking: See MIL-F-24646(SH).
Fuse puller assembly: The fuse puller assembly shall have blades that engage the jaws fastened to the base. The blades shall spread the jaws. The jaws shall grip the blade with enough force to prevent heating when under full load.
Parts The parts listed in table II and specified in MIL-F-24646(SH) shall be used in the construction of the fuse boxes specified herein.

General information:

Military part numbers and general information are as specified in table I.

TABLE I. Military part numbers and general information.

Military part no.	Symbol no.	Weight in pounds	No. of circuits	Feeder MCM	Branch MCM	Fuse size	Bus bar size	Supersedes	
								Drawing no.	Type
M24646/17-001	693.1	29.0	1	75	14	0-30A	0.62 x 0.19	9000-S-6202-74191	-

TABLE II. Parts list.

Item no. 1/	Description	QTY M /- 001	Material/spec	Remarks
01	Fuse box assembly (sym 693.1)	-	MIL-F-24646/17	See figure 1
02	Enclosure (10 x 13 x 5)	1	M24142/6-004	See figure 2
03	Fuse block assembly	1	MIL-F-24646/17	See figure 4
04	Wiring diagram	1	MIL-E-2036	See figure 5
05	Fuse clip (0-30A)	6	M21346/1-06	----
2/06	Fuse puller assembly	1	----	See figure 6
07	Identification plate	1	Brass, QQ-B-613	----
08	Information plate	1	Brass, QQ-B-613	----

1/ Numbers in circles shown on the figures are the same as the item numbers shown in this table.
2/ Warning shall be engraved on front of plate and filled with red enamel.

Preparing activity:
Navy - SH
(Project 5920-N163-17)

Source: https://assist.dla.mil -- Downloaded: 20260-20T00:36Z
Check the source to verify that this is the current version before use.