W-R-550A
AMENDMENT-1
August 18, 1977

FEDERAL SPECIFICATION

ROD, GROUND (WITH ATTACHMENTS)

This amendment, which forms a part of Federal Specification W-R-550A, dated June 12, 1975, was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

PAGE 2

2.1, under Federal Specification, delete:

"QQ-S-634 - Bar, Carbon, Cold Finished, Standard Quality."

2.1, under Military Standards, delete:

"MIL-STD-130 - Identification Marking of US Military Property."

PAGE 3

2.2, under American Society for Testing and Materials, add:

"A108 - Steel Bars, Carbon, Cold Finished, Standard Quality."

PAGE 4

After 3.3.1, add:

"3.3.1.1 Threads for the Type III, Class B rods and couplings. The Type III rods shall have 5/8-II-UNC-2A or 3/4-IO-UNC-2A threads as specified. The coupling shall be in accordance with Figure 5."

3.3.3, line 2, after "to", delete "QQ-S-634, Grade 1025" and substitute "ASTM A108, Grade 1020, 1022, or 1025."

3.3.4, line 2, after "to", delete "QQ-S-634, Grade 1018" and substitute "ASTM A108, Grade 1016, 1018, or 1020."; second sentence, after "B", delete "92" and substitute "90".

3.10.2, line 3, delete "SQUARE" and substitute "HEX".

PAGE 6

3.16, delete in its entirety.

FSC 5975

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.

PAGE 7

4.4.1, after "MIL-STD-105", change comma to period; delete "Inspection Level III" and add the following sentence:

"The inspection level for examination shall be Level II, and the inspection level for tests shall be Level S-3."

4.4.2.1, delete second sentence and substitute:

"AQL for examination shall be 4.0 percent defective and AQL for tests shall be 1.5 percent defective."

PAGE 8

TABLE I. TEST SCHEDULE, add under column headings:

	QUALITY CONFORMANCE			TEST	REQUIREMENT
PREPRODUCTION	INDIVIDUAL	SAMPLE	TEST	PARAGRAPH	PARAGRAPH
" X	1	X	Copper	4.6.5	3.3.4 "

PAGE 9

Add 4.6.5:

"4.6.5 Thickness of copper cladding. The thickness of the copper cladding on Class B rods shall be measured with an elecometer thickness gage, Type B, thickness not in accordance with 3.3.4 shall constitute failure of test and shall be cause for rejection."

PAGE 11

Delete "GL" as preparing activity and substitute "ME".

PAGE 13

Figure 2, delete "SQUARE-HEAD" and substitute "HEX-HEAD"; show set screw as hex-head.

PAGE 14

Figure 3, show set screw as hex-head; add: "2-5' sections for 10' rod"; add: "2-couplings for 10' rod".

Add Figure 5.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.

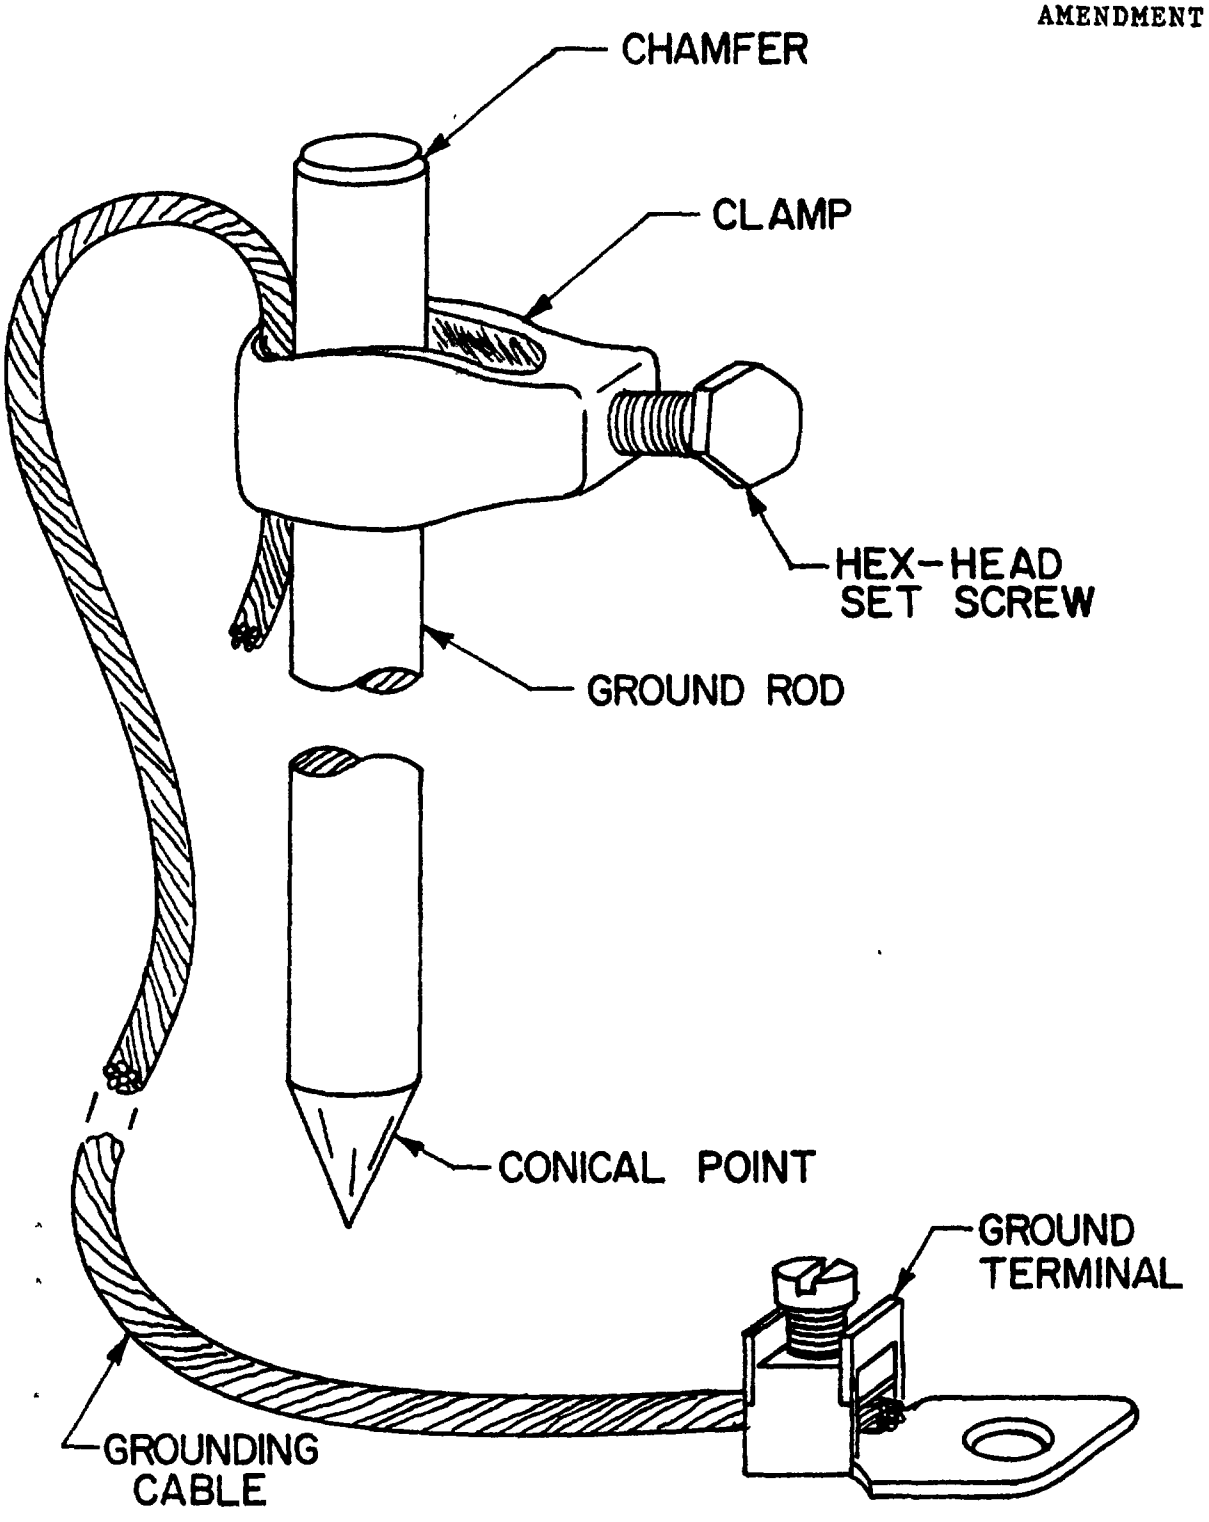


FIGURE 2. Type II, Class A or B, driven rod.

X-1882B

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.


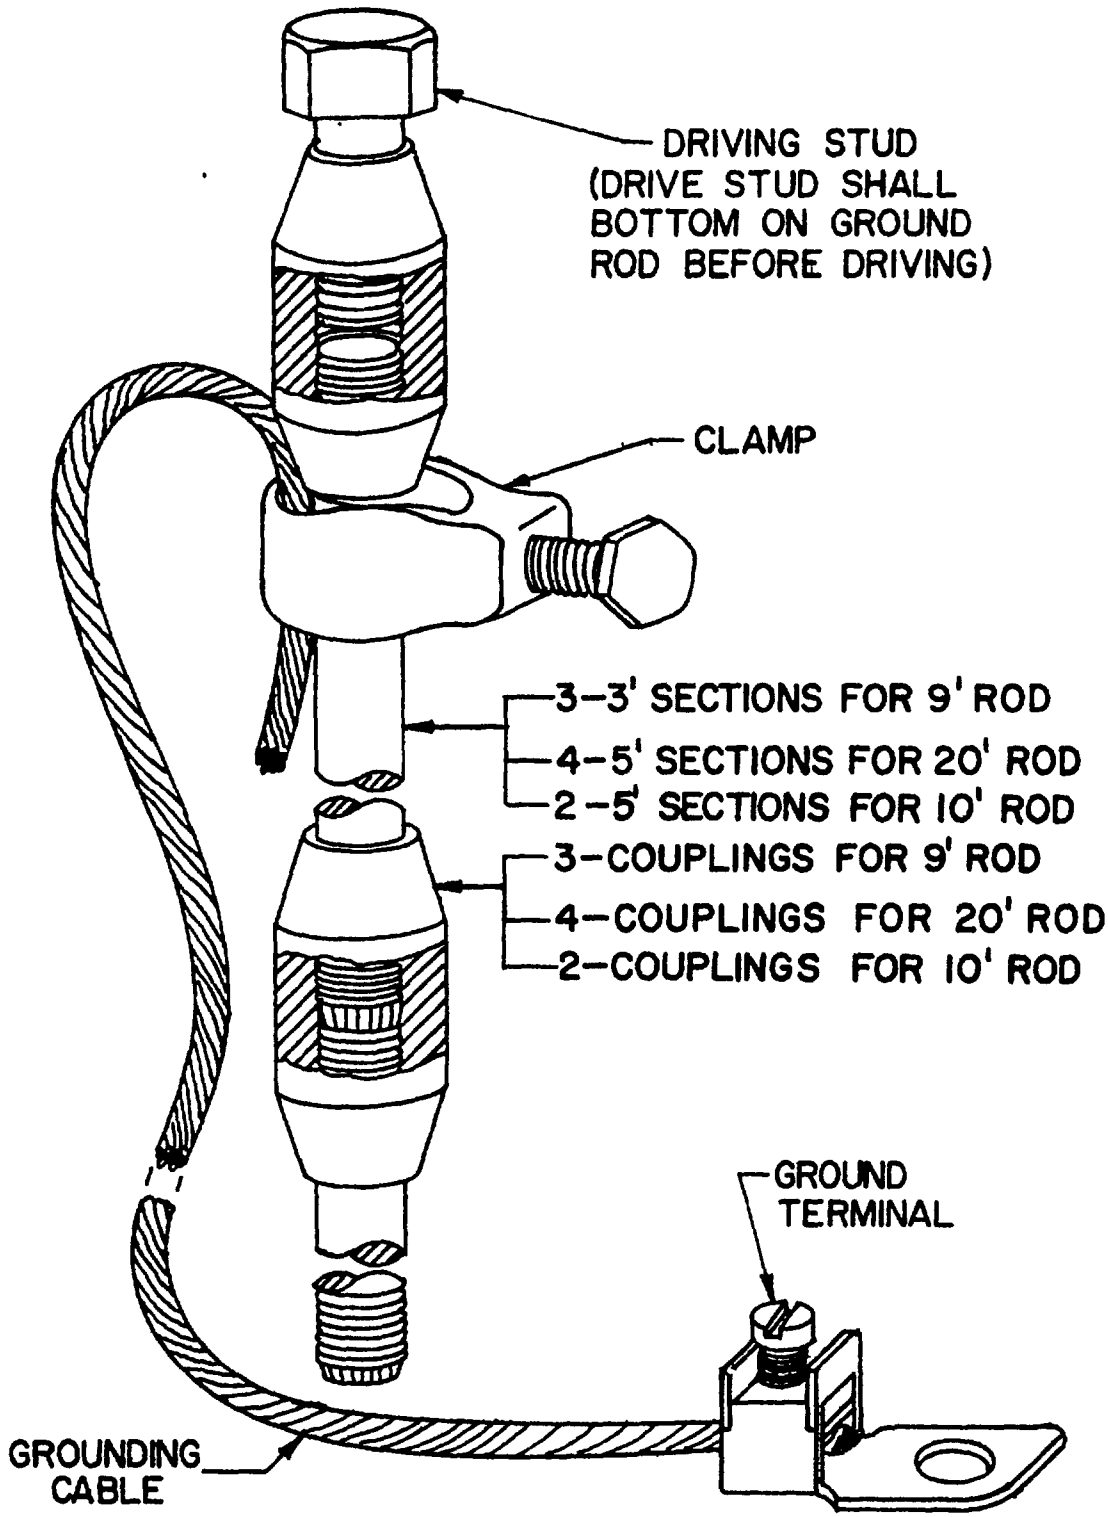


FIGURE 3. Type III, Class B, sectional rod. X-1883B

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.

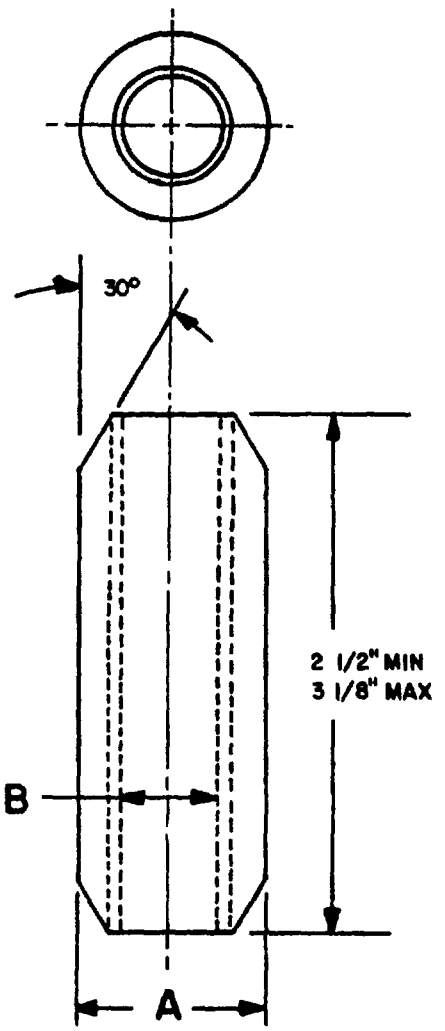

	A	B
FOR 5/8" ROD	7/8"	5/8-11 UNC-2B
FOR 3/4" ROD	1"	3/4-10 UNC-2B

MATERIAL: COPPER ALLOY NO. 655, HIGH SILICON BRONZE; 1/4 HARD TEMPER CONDITION, ROCKWELL B80 HARDNESS.

FIGURE 5. Coupling for Type III, Class B, sectional rod.

X-3948A

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.

MILITARY INTERESTS:

Custodians:
Army - ME
Navy - YD
Air Force - 85

Review activities:
Army - EL
Air Force - 99, 11
DLA - GS

User activity:
Army - WC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - FSS

Preparing activity:
Army - ME

Project 5975-0534

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:27Z
Check the source to verify that this is the current version before use.