INCH-POUND

MIL-PRF-52308J
27 July 2000
SUPERSEDING
MIL-PRF-52308H
23 November 1998

PERFORMANCE SPECIFICATION

FILTER-COALESCER ELEMENT, FLUID PRESSURE

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers filter-coalescer elements for use in filter-separator vessels for handling liquid petroleum fuels (see 6.1).

1.2 Classification. Filter-coalescer elements covered by this specification are of the following classes as specified (see 6.2):

Class M	-	JP8 fuel compatible (API 1581, category M fuel (see 4.4.2)).
Class M100	-	JP8+100 fuel compatible (API 1581, category M100 fuel (see 4.4.2)).

2. APPLICABLE DOCUMENTS

2.1 General. The documents listed in this section are specified in sections 3 and 4 of this specification. This section does not include documents cited in other sections of this specification or recommended for additional information or as examples. While every effort has been made to ensure the completeness of this list, document users are cautioned that they must meet all specified requirement documents cited in sections 3 and 4 of this specification, whether or not they are listed.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: U.S. Army Tank-automotive and Armaments Command, ATTN: AMSTA-TR-D/210, Warren, MI 48397-5000, by using the Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4330

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

2.2 Non-Government publications. The following document(s) form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the Department of Defense Index of Specifications and Standards (DoDISS) cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DoDISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

ASTM D 3240	-	Standard Test Method for Undissolved Water in Aviation Turbine Fuels. (DoD adopted)
ASTM D 5006	-	Standard Test Method for Measurement of Fuel System Icing Inhibitor (Ether Type) in Aviation Fuels. (DoD adopted)

(Application for copies should be addressed to The American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959.)

AMERICAN PETROLEUM INSTITUTE (API)

API 1581	-	Specification and Qualification Procedures for Aviation Jet Fuel Filter Separators, Fourth Edition.

(Application for copies should be addressed to The American Petroleum Institute, Order Desk, 1220 L Street, N.W., Washington, DC 20005-4070.)

2.3 Order of precedence. In the event of a conflict between the text of this document and the references cited herein, the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 First article. When specified (see 6.2), a sample shall be subjected to first article inspection in accordance with 4.2.

3.2 Materials. Material used shall be in accordance with the manufacturer's materials specifications for filter-coalescer elements, hereinafter referred to as "elements". The materials shall be capable of meeting all of the operational and environmental requirements specified herein. Materials used shall be compatible with petroleum fuels containing water, salt water, and additives as specified with no evidence of deleterious effect. Materials in contact with test waters shall be corrosion resistant. Zinc or cadmium plating, or use of brass, bronze and other copper bearing alloys shall not be permitted. Recovered materials should be used to the maximum extent practicable (see 6.7). Used, rebuilt or remanufactured components, pieces and parts shall not be incorporated in the element.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

3.2.1 Material deterioration, prevention and control. The elements shall be fabricated from compatible materials, inherently corrosion resistant or treated to provide corrosion and deterioration protection for the element's expected service life in any operating and storage environment.

3.2.2 Dissimilar metals. Dissimilar metals shall not be used in intimate contact with each other unless protected against galvanic corrosion.

3.2.3 Identification of materials and finishes. The contractor shall identify the specific material, material finish or treatment for use with component and subcomponent and shall make information available upon request to the contracting officer or designated Government representative.

3.3 Interface and interoperability requirements.

3.3.1 Filter-coalescer elements. Elements shall be fabricated and assembled to the form and dimensions shown in Figure 1 to insure proper interface and interchangeability with existing filter/separator vessels.

3.3.1.1 End caps. The end caps shall be mounted perpendicular within 3 degrees to the longitudinal axis of the element.

3.3.1.2 O-ring. The O-ring packing and its retaining groove shall retain the O-ring seal during installation and operation, and the O-ring form and dimensions shall be in accordance with Figure 2 to insure proper interface and interchangeability of the elements with existing filter/separators. The O-ring shall be hydrocarbon fuels (automotive and aircraft types) resistant (see 6.9). The O-ring packing shall consist of a light coating of silicone compound or other compatible material to O-ring and O-ring grooves to facilitate installation.

3.4 Operating requirements.

3.41 Water coalescence. The filter element shall coalesce water into visible drops from the test fuel (see 4.4.2) at a fuel flow rate of 20 gallons per minute (gal/min or GPM) (76 liters per minute, L/min), which is hereinafter referred to as rated flow or 100% of rated flow.

3.4.2 Differential pressure and fiber migration. The differential pressure across the element, in combination with a separator stage (see 6.4.2 and 6.5), using clean, dry fuel (see 6.4.3 and as defined by API 1581, Table 1), shall not exceed 6 pounds per square inch (psi) (42 kiloPascals, kPa) at 100% of rated flow. The effluent fuel sample shall contain an average of not more than 10 fibers per liter and the number of fibers in any single sample shall not exceed 15 fibers per liter (see 6.4.1). The element shall incorporate sufficient radial support to withstand a differential pressure across the element of not less than 75 psi (520 kPa) without structural failure or permanent deformation.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

3.4.3 Contaminant removal. The element in combination with a separator stage (see 6.5) shall remove solids and up to 3 % water by volume at fuel flow rates up to 100 % of rated flow. The effluent fuel samples shall contain not more than 15 parts per million by volume (ppmv) of undissolved water when measured in accordance with ASTM D 3240. The average weight of solids in the effluent fuel samples shall not exceed 0.26 milligrams per liter (mg/L), and the weight of solids in any single sample shall not exceed 0.5 mg/L.

3.4.3.1 Solids removal capacity. The element shall remove and retain a quantity of solids at least equal to 5.4 grams per gal/min of its rated flow capacity. The pressure differential across the element at rated flow shall not exceed 15 psi (105 kPa) before 50 minutes, nor 45 psi (315 kPa) before 75 minutes at a solids concentration in the influent test fuel of 72 mg/gal (19 mg/l).

3.5 Environmental requirements.

3.5.1 Transit drop. Each packaged element (see 5.1) shall withstand the shock of being dropped on a flat surface of solid concrete, from a height of 48 inches, by showing no evidence of cracks or deformation of the end caps or damage to element media.

3.5.2 Temperature resistance. The element shall withstand storage in fuel in temperatures ranging from -50 degrees Fahrenheit (°F) to +160 °F (-46 degrees Celsius (°C) to + 71 °C) after which it shall operate as specified.

3.5.3 Fuel and salt water immersion. The element, after being immersed in test fuel for 100 hours near both the high and low operating temperature limits in 3.5.2, and after immersion in salty water for 72 hours, shall show no evidence of swelling, corrosion, separation of components, dissolving of adhesives, or deformation which could cause failure during operation.

3.5.4 Post-environmental testing. The element having completed 3.5.3 shall operate as specified.

3.6 Support and ownership requirements.

3.6.1 Identification marking. Element marking shall include, as a minimum, the following information permanently marked or stamped on the element (see 6.2):

a. NSN: (Specify)
b. Contract or Order No.: (Specify)
c. Lot: (Specify) (see 6.2e and 6.2f)
d. Manufacturer’s Identification: (Specify)
e. Date of Manufacture: (Specify)
f. Class of element: (Specify) (see 6.2b)

3.6.2 Workmanship. The element shall be free from burrs, tears, smudges, or any other defect that will impair serviceability.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

4. VERIFICATION

4.1 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.2).
b. Conformance inspection (see 4.3).

4.2 First article inspection. The contractor shall furnish a minimum of 18 elements to determine conformance to this specification (see 6.2). First article inspection shall be conducted as specified in 4.5, Table I. Presence of one or more defects or failure of any examination or test shall be cause for rejection.

4.3 Conformance inspection.

4.3.1 Lot. Unless otherwise specified (see 6.2), a lot shall consist of not more than 1,000 elements, identically produced by one shift during a single day.

4.3.2 Sampling. Sampling for examinations and tests shall consist of elements randomly selected from production lots. The number of elements sampled per production lot shall be as specified in the contract or order (see 6.2).

4.3.3 Inspection. Samples selected in accordance with 4.3.2 shall be examined and tested as specified in 4.5, Table I. Presence of one or more defects or failure of any test shall be cause for rejection, and for rejection of the lot represented by the sample.

4.4 Test conditions. The fuel flow rate shall be 20 gal/min (76 L/min) per element, 100 % of rated flow per element.

4.4.1 Test facility. The test facility shall be in accordance with API 1581, section 4.2.1 Test Apparatus. Testing shall be conducted by the Government using Government test facilities at a site selected by the Government. Both single element and full-scale tests shall be conducted using the military vessel configuration of concentric, vertical elements and separators. The single element test vessel shall be a uniform standard, single element vessel constructed by the Government. The full-scale test vessel shall be a military standard 50 GPM filter-separator vessel, LIN H51915. The full-scale vessel, having four elements, shall be operated at 80 GPM, or 100% of rated flow per element. Both the single element and full-scale test vessels may be made available to the contractor upon request, for preliminary qualification testing. The facility shall contain calibrated and certified measuring equipment.

4.4.2 Test fuel and additives. The category of test fuel used shall be in accordance with the class of element (see 1.2 and 6.2), and shall be in accordance with API 1581, section 4.2.2 Test Fuel. The additives used in the test fuel shall be in accordance with API 1581, section 4.2.4.2 Additive Package/Category M100 and M Fuels, for both class M and M100 elements. For class M100 elements, the additives shall be added to the test fuel in accordance with API 1581, section 4.3.2.3.2 Additive Addition/Category M100 Fuel. For class M elements, the additives shall be

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

added to the test fuel in accordance with API 1581, section 4.3.2.3.3 Additive Addition/Category M Fuel.

4.4.3 Fuel temperature. Unless otherwise specified (see 4.5.4.2 and 4.5.4.3), the test fuel temperature shall be between +40 °F to +90 °F (+5°C to +32 °C) during testing. The test fuel temperature shall be maintained within plus or minus 11 °F (6 °C) of the starting temperature for any individual test.

4.4.4 Test contaminants. The contaminants used, and their addition to the test fuel, shall be in accordance with API 1581, section 4.2.3 Test Contaminants.

4.4.5 Test sampling and analysis. Test sampling and measurement shall be conducted in accordance with API 1581, section 4.7 Test Sampling, and all subsections thereof.

4.4.5.1 Icing inhibitor. The concentration of icing inhibitor in the fuel shall be determined in accordance with ASTM D 5006. Samples shall be taken for measurement prior to start of 4.5.3 (operational performance test), and immediately after the conclusion of such test.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

4.5 Methods of inspection. First article and conformance inspections shall include the relevant inspections as listed in Table I.

TABLE I. Inspection requirements.

	First Article (9+ samples)			Conformance
Inspection	FAT, set 1 (3+ samples)	FAT, set 2 (2+ samples)	FAT, set 3 (4+ samples)	(All samples)
Examination, 4.5.1	**X**	**X**	**X**	**X**
Structural strength, 4.5.2	**X**			**X (or 4.5.3)**
Differential pressure, operational performance, 4.5.3		**X**		**X (or 4.5.2)**
Transit drop, 4.5.4.1			**X**	
Resistance to fuel, high temp, 4.5.4.2			**X**	
Resistance to fuel, low temp, 4.5.4.3			**X**	
Resistance to salt water, 4.5.4.4			**X**	
Post-environmental performance, 4.5.4.5			**X**	

4.5.1 Examination. The elements shall be examined for the defects specified in Table II.

TABLE II. Visual defects.

Defect	Paragraph
Material not as specified.	3.2
Material not resistant to corrosion and deterioration or not treated to be made resistant to corrosion and deterioration.	3.2.1
Dissimilar metals in intimate contact.	3.2.2
Dimensions not as shown in Figure 1.	3.3.1
End caps mounting not as specified.	3.3.1.1
O-Rings in ends of element missing or damaged.	3.3.1.2
Dimensions of O-Rings not as shown in Figure 2.	3.3.1.2
Silicone compound not present as specified.	3.3.1.2 and Figure 1, note 4
Identification marking incorrect, missing or illegible.	3.6.1
Workmanship not as specified.	3.6.2

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

4.5.2 Structural strength. To determine conformance to 3.4.2, elements shall be tested in accordance with API 1581, section 4.5.1 Structural Test. The category of test fuel used, for this test only, shall be as specified in 4.4.2, with the exception that additives are optional.

4.5.3 Differential pressure, operational performance. Test sampling schedule and procedures shall be in accordance with API 1581, section 4.3 Single Element Test Method for Filter/Separators, and all subsections thereof for Type S filter-separators only and excludes multi-stage systems, using the single element test vessel specified. Test sampling schedule and procedures are also summarized in API 1581, Table 4, and API 1581, section 4.7 Test Sampling. Nonconformance to 3.4.1, 3.4.2, 3.4.3 or 3.4.3.1 shall constitute failure of this test.

4.5.4 Environmental. The environmental tests shall be conducted in the following order. The same complete set of elements shall be used for each environmental test, and the number of samples in the set shall be as stated in the contract or order (see 6.2).

4.5.4.1 Transit drop. To determine conformance to 3.5.1, each element contained in their unit package shall be dropped on a flat surface of solid concrete, from a height of 48 inches. All drops shall be made so that the element falls freely through the distance specified. The element shall be dropped eight times, four on each end of the unit package. Cracks or deformation of end caps, or damage to element media shall constitute failure of this test.

4.5.4.2 Resistance to fuel, high temperature. The elements shall be immersed in the test fuel for a minimum period of 100 hours at an ambient temperature of +140 °F (+60 °C), plus or minus 5 °F (3 °C), and examined for defects. Nonconformance to 3.5.3 shall constitute failure of this test.

4.5.4.3 Resistance to fuel, low temperature. The elements shall be immersed in the test fuel for a minimum period of 100 hours at an ambient temperature of -25 °F (-32 °C), plus or minus 5 °F (3 °C), and examined for defects. Nonconformance to 3.5.3 shall constitute failure of this test.

4.5.4.4 Resistance to salt water. The elements shall be immersed in a solution consisting of 4% sodium chloride (NaCl) and 96% distilled water by weight for a period of 72 hours, and examined for defects. Nonconformance to 3.5.3 shall constitute failure of this test.

4.5.4.5 Post-environmental performance. The elements shall be tested in accordance with API 1581, section 4.4 Full-Scale Test Method for Filter/Coalescers, and all subsections thereof for Type S filter-separators only and excludes multi-stage systems, using the full-scale vessel specified. Test sampling schedule and procedures are also summarized in API 1581, Table 5, and API 1581, section 4.7 Test Sampling. Nonconformance to 3.4.2 or 3.4.3 shall constitute failure of this test.

5. PACKAGING

5.1 Packaging. For acquisition purposes, the packaging requirements shall be as specified in

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

the contract or order (see 6.2). When actual packaging of materiel is to be performed by DoD personnel, these personnel need to contact the responsible packaging activity to ascertain requisite packaging requirements. Packaging requirements are maintained by the Inventory Control Point's packaging activity within the Military Department or Defense Agency, or within the Military Department's System Command. Packaging data retrieval is available from the managing Military Department's or Defense Agency's automated packaging files, CD-ROM products, or by contacting the responsible packaging activity.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The elements are intended for use in military filter-separator vessels to remove solid contaminants and coalesce water from diesel and jet fuels. The elements covered by this performance specification are military unique since they must interface with the family of military standard filter/separators.

6.2 Acquisition data. Acquisition documents should specify the following:

a. Title, number, and date of this specification.
b. Class of filter-coalescer element required by the Government (see 1.2).
c. Issue of DoDISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.2).
d. If first article inspection is required (see 3.1 and 4.2), the total number of samples, and number of elements per each FAT set (see 4.5).
e. Identification markings including NSN, contract or order number, lot number, manufacturer’s identification, date of manufacture, and fuel category compatibility (see 3.6.1).
f. When lot size other than as specified (see 4.3.1).
g. Number of samples per production lot that shall undergo conformance inspection (see 4.3.2).
h. Test data sheets as provided in API 1581, Table 6 Data Sheet for Single-Element Tests, Type S Filters, and Table 7 Data Sheet for Full-Scale Tests, Type S Filters.
i. Selection of applicable packaging and packing requirements (see 5.1).

6.3 Disposition of test assemblies. Elements undergoing destructive tests should be indelibly marked "DO NOT USE".

6.4 Definitions.

6.4.1 Fiber. A fiber is defined as any particle with a length-to-diameter ratio of ten to one, or more, and a length of 100 microns or more.

6.4.2 Differential pressure across the element. The differential pressure across the element is defined as the pressure drop across the filter/separator with the element installed measured from

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

the fuel inlet coupling to the fuel outlet coupling (excluding accessory valves), less the pressure drop across the filter/separator without the element installed.

6.4.3 Clean, dry fuel. As defined by API 1581, Table 1; also as fuel containing not more than 0.26 mg per liter of solid contamination and no free water, or an irreducible minimum amount of free water, as indicated by the test system fuel quality monitors or devices specified herein.

6.4.4 GPM. Gallons per minute, also gal/min; inch-pound flow rate.

6.4.5 L/min. Liters per minute; metric flow rate.

6.4.6 ppmv. Parts per million by volume; dimensionless, volumetric concentration.

6.4.7 mg/L. Milligrams per liter; metric concentration.

6.4.8 psi. Pounds per square inch; inch-pound pressure.

6.4.9 kPa. Kilopascals; metric pressure.

6.5 Separator stages. Satisfactory performance of filter/separators utilizing the elements cited in 3.4.1, has been based on the use of water-removing separators that physically strip the coalesced water droplets from the flowing fuel stream. The vertical filter/separators used by the military utilize a cylindrical canister (separator) that surrounds each element and contains a 100-mesh monel (or stainless steel) screen coated with polytetrafluoroethylene, a hydrophobic material. Drawings 13216E2773 and 13217E6316 are provided for guidance only.

6.6 Subject term (key word) listing.

Contamination
Filtration
Separator
Fuel

6.7 Recovered materials. For the purpose of this requirement, recovered materials are those materials which have been collected from solid waste and reprocessed to become a source of raw materials, as distinguished from virgin raw materials. The components, pieces and parts incorporated in the element may be newly fabricated from recovered materials to the maximum extent practicable, provided the element produced meets all other requirements of this specification.

6.8 Solid contaminants The solid contaminants can be obtained from the following suppliers.

a. Red iron oxide, obtainable from Harcros Pigments Inc., 2001 Lynch Avenue, East St. Louis, IL 62205, identified as Copperas Red Iron Oxide no. R9998.

b. A1 Ultrafine Test Dust ISO 12103-1, obtainable from Powder Technology Inc., P.O. Box 1464, Burnsville, MN 55337.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

6.9 Hydrocarbon fuel resistant O-rings. Historically the hydrocarbon fuel resistant O-rings were manufactured in accordance with MS29513-123.

6.10 Part Identification Number (PIN). The following part identification numbering procedure is for Government purposes and does not constitute a requirement for the contractor. This example describes a part numbering system for MIL-PRF-52308J:

M 52308 - X


- M -Class M: JP8 fuel compatible
- M100 -Class M100: JP8+100 fuel compatible

Specification number

Prefix for military specification

6.11 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

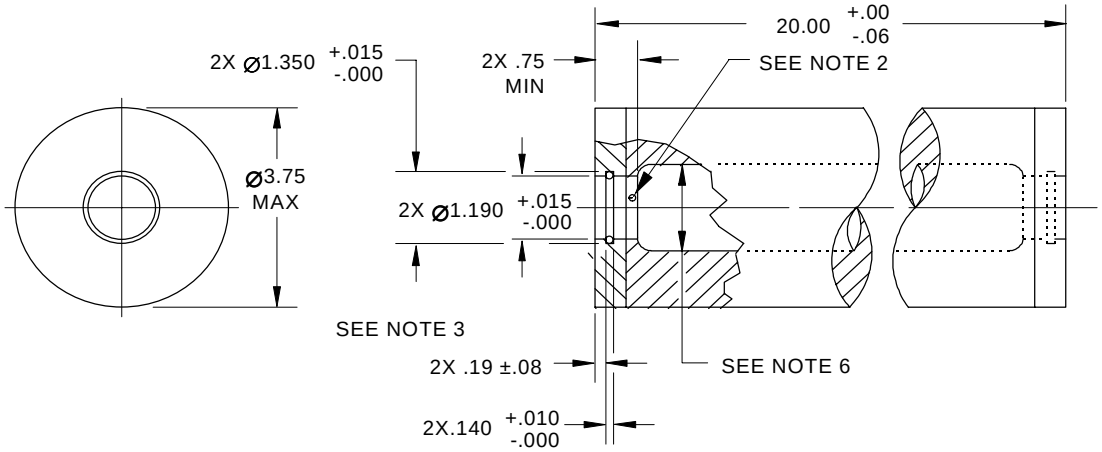

NOTES:
1. DIMENSIONS ARE INCHES.
2. THIS AREA TO BE LEFT FREE FROM FILTER ELEMENT MATERIAL, BOTH ENDS.
3. PROVIDE O-RING IN EACH END GROOVE.
4. APPLY LIGHT COATING OF SILICONE COMPOUND TO O-RING GROOVES AND O-RING.
5. FLOW SHALL BE FROM INSIDE TO OUTSIDE.
6. INSIDE DIAMETER AND CONFIGURATION ARE OPTIONAL.
7. REFERENCE: FOR USE WITH 1.182-1.187 MALE GLAND AT 100 PSI MIN, BOTH ENDS.
8. NOMINAL RATE OF FLOW IS 20 GPM.

FIGURE 1. Filter-coalescer element.

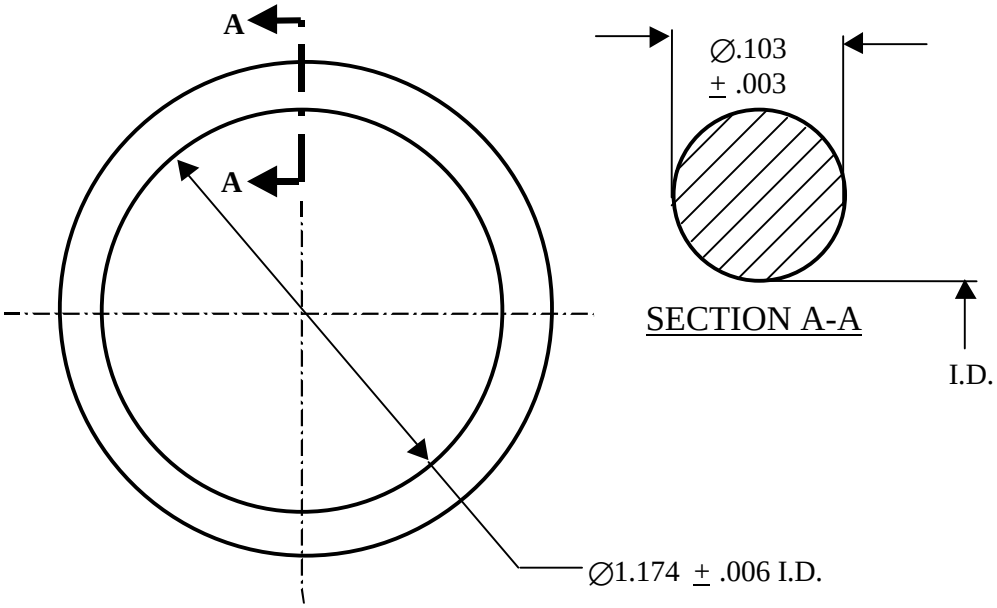


FIGURE 2. O-ring size and geometry.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

Custodians:
Army – AT
Navy – AS
Air Force – 11

Review activities:
Army – AV, MI
Navy - MC
Air Force – 68, 99
DLA - CC

Preparing activity:
Army - AT

(Project 4330-0160)

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.

2. The submitter of this form must complete blocks 4, 5, 6, and 7, and send to preparing activity.

3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	**1. DOCUMENT NUMBER** MIL-PRF-52308J	**2. DOCUMENT DATE (YYYYMMDD)** 20000727

3. DOCUMENT TITLE **FILTER-COALESCER ELEMENT, FLUID PRESSURE**

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME *(Last, First, Middle Initial)*	b. ORGANIZATION	
c. ADDRESS *(Include Zip Code)*	d. TELEPHONE (Include Area Code) (1) Commercial (2) AUTOVON *(if applicable)*	**7.DATE SUBMITTED** (YYYYMMDD)

8. PREPARING ACTIVITY

a. NAME COMMANDER	b. TELEPHONE *Include Area Code)* (1) Commercial (810) 574-8745 (2) AUTOVON 786-8745
c. ADDRESS *(Include Zip Code)* U.S. Army Tank-Automotive and Armaments Command ATTN: AMSTA-TR-E/BLUE Warren, MI 48397-5000	**IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:** Defense Standardization Program Office (DLSC-LM) 8725 John J. Kingman road, Suite 2533 Ft. Belvoir, VA 22060-2533 Telephone (703) 767-6888 AUTOVON 427-6888

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:14Z
Check the source to verify that this is the current version before use.