
MILITARY SPECIFICATION SHEET


TRANSFORMER, POWER, 150 VA, 400 Hz, TF4S03YY

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The complete requirements for procuring the transformer described herein shall consist of this document and the latest issue of Specification MIL-T-27.

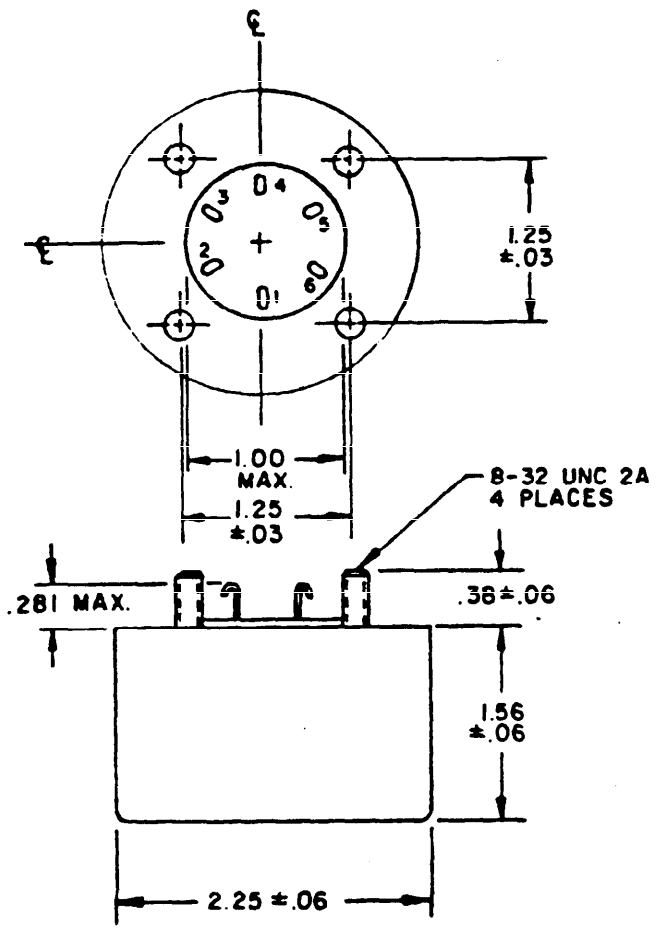


(1-2) 115 V 400 Hz



CONFIGURATION A

(1-2) 115 V 400 Hz



CONFIGURATION B

WORKING VOLTAGE 170 Vrms
ALTITUDE - 70,000 FT MAX
CIRCUIT DIAGRAM AND MARKING

INCHES	MM
.03	.76
.96	1.52
.164	4.16
.281	7.14
.38	9.65
1.00	25.40
1.25	31.75
1.56	39.62
2.25	57.15

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only and are based upon 1.00 inch = 25.4 mm.
3. Marking shall be on the sides fo the case.

FIGURE 1. Dimensions and configuration.

FSC 5950

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T04:00Z
Check the source to verify that this is the current version before use.

REQUIREMENTS: (When numbers in parentheses, i.e., (1-2) are used, they indicate the winding and the extreme terminals of the winding.)

Electrical ratings:
Primary (1-2): 150 voltamperes, 115 volts rms, 400 hertz.
Secondary (3-5): See table I.
Working voltage:
(1-2): 170 volts rms.

Design and construction:
Dimensions and configuration: See figure 1.
Duty cycle: Continuous.
Case: Metal enclosed.
Material: Steel
Terminals: Hook type, solder terminals.
Height: .281 inch, maximum.
Diameter: .234 inch, maximum.
Weight: 21 ounces, maximum.
Operating temperature range: -55° to +130°C.
Altitude: 70,000 feet.

Terminal strength: MIL-STD-202, method 211, test condition A, 5 pounds.

Dielectric withstanding voltage (each winding):
At sea level: 500 volts rms.
At reduced barometric pressure: 300 volts rms.

Electrical characteristics:
Rated load: With 115 volts rms and 400 Hz in (1-2), and rated current in secondary: Voltage across (3-5): Shall be as specified in table I.

Efficiency: 90 percent at rated load, minimum.

Temperature rise: 60°C with 115 volts rms, 400 hertz across (1-2) at an ambient temperature of 70°C, full load terminals (3-5).

Vibration (high frequency): MIL-STD-202, method 204, test condition D.

Regulation: $\frac{\text{Voltage (no load)} - \text{Voltage (rated load)}}{\text{Voltage (rated load)}} \times 100$
Shall not exceed 6 percent

Polarity: Additive with terminals 2 and 3 connected.

Marking location: See figure 1.

Part number: M27/276 -dash number from table I.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T04:00Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical ratings.

Dash 1/ number	Secondary voltage (3-5) (Vrms) ±3%	Secondary current (3-5) (amps rms)	Dash 1/ number	Secondary voltage (3-5) (Vrms) ±3%	Secondary current (3-5) (amps rms)
01 A or B	10	15.00	20 A or B	51	2.94
02 A or B	11	13.64	21 A or B	56	2.68
03 A or B	12	12.50	22 A or B	62	2.42
04 A or B	12.6	11.91	23 A or B	68	2.21
05 A or B	13	11.54	24 A or B	75	2.00
06 A or B	15	10.00	25 A or B	82	1.83
07 A or B	16	9.38	26 A or B	91	1.65
08 A or B	18	8.33	27 A or B	100	1.50
09 A or B	20	7.50	28 A or B	110	1.36
10 A or B	22	6.82	29 A or B	115	1.30
11 A or B	24	6.25			
12 A or B	26	5.77			
13 A or B	28	5.36			
14 A or B	30	5.00			
15 A or B	33	4.55			
16 A or B	36	4.17			
17 A or B	39	3.85			
18 A or B	43	3.49			
19 A or B	47	3.19			

1/ Configuration B includes electrostatic shield. The shield terminal shall be number 6. Voltage ratio shall be 5 to 1 at 10 kHz.

Custodians:
Army - ER
Navy - EC
Air Force - 85

Review activities:
Army - AR
Navy - SH, OS
Air Force - 11, 17, 99
DLA - ES

User activities:
Army - ME
Navy - MC, AS
Air Force - 19

Preparing activity:
Army - ER

Agent:
DLA - ES

(Project 5950-0569-6)

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T04:00Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS: This form is provided to solicit beneficial comments which may improve this document and enhance its use. DoD contractors, government activities, manufacturers, vendors, or other prospective users of the document are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity. A response will be provided to the submitter, when name and address is provided, within 30 days indicating that the 1426 was received and when any appropriate action on it will be completed.

NOTE: This form shall not be used to submit requests for waivers, deviations or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

DOCUMENT IDENTIFIER *(Number)* AND TITLE MIL-T-27/276A TRANSFORMER, POWER, 150 VA, 400 Hz, TF4S03YY

NAME OF ORGANIZATION AND ADDRESS OF SUBMITTER

☐ VENDOR ☐ USER ☐ MANUFACTURER

1. ☐ HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE? ☐ IS ANY PART OF IT TOO RIGID, RESTRICTIVE, LOOSE OR AMBIGUOUS? PLEASE EXPLAIN BELOW.

A. GIVE PARAGRAPH NUMBER AND WORDING

B. RECOMMENDED WORDING CHANGE

C. REASON FOR RECOMMENDED CHANGE(S)

2. REMARKS

SUBMITTED BY *(Printed or typed name and address — Optional)*

TELEPHONE NO.

DATE

DD FORM 1 OCT 76 1426 EDITION OF 1 JAN 72 WILL BE USED UNTIL EXHAUSTED.

Source: https://assist.dla.mil -- Downloaded: 2026-10-16T04:00Z
Check the source to verify that this is the current version before use.