MIL-F-8115D(USAF)
14 July 1989
SUPERSEDING
MIL-F-8115C(USAF)
21 December 1960

MILITARY SPECIFICATION

FLOODLIGHT, INCANDESCENT, EXPLOSION PROOF, TYPE MA-1

This specification is approved for use within the Department of the Air Force and is available for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers one type of explosion proof, incandescent floodlight, designated Type MA-1.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this specification to the extent specified herein. Unless otherwise specified, the issues of these documents shall be those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation.

SPECIFICATIONS

FEDERAL

J-C-580	Cord, Flexible and Wire Fixture, (Electrical 0 to 600 Volt Service).
PPP-B-601	Boxes, Wood, Cleated Plywood.

MILITARY

MIL-P-116	Preservation, Methods of.
DOD-D-1000	Drawing, Engineering and Associated List.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Engineering Division, San Antonio ALC/MMDEMM, Kelly AFB TX 78241-5000, by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 6230

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

MIL-C-7989	Covers, Light Transmitting, for Aeronautical Lights. General Specification for.

STANDARDS

MILITARY

MIL-STD-129	Marking for Shipment and Storage
MIL-STD-130	Identification Markings of U.S. Military Property
MIL-STD-147	Palletized Unit Loads
MIL-STD-810	Environmental Test Methods & Engineering Guidelines.
MIL-STD-889	Dissimilar Metals
MIL-STD-970	Specification and Standards, Order of Precedence for the selection of
MIL-STD-1186	Cushioning, Anchoring, Bracing, Blocking and Water-proofing; with Appropriate Test Methods
MIL-STD-2073	DoD Material Procedures for Development and Application of Packaging Requirements

(Copies of specifications and standards required by manufacturers in connection with specific acquisition functions should be obtained from the contracting activity or as directed by the contracting officer.)

2.2 Non-Government publications. The following documents form a part of this specification to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the DODISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

ASTM D-3951	Packaging, Commercial

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

UNDERWRITERS LABORATORIES INC (UL)

UL-844	Electrical Lighting Fixtures, for use in Hazardous (Classified) Locations.

(Application for copies should be addressed to Underwriters Laboratories Inc, 207 E. Ohio Street, Chicago, IL 60611.)

(Non-Government standards and other publications are normally available from the organizations that prepare or distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of conflict between the text of this document and the references cited herein, the text of this document shall take

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 First article. When specified (see 6.2), a sample shall be subjected to first article inspection (see 6.3) in accordance with 4.3.

3.2 Selection of specifications and standards. Selection of specifications and standards for materials, parts, and Government certification and approval of processes and equipment which are not specifically designated herein and which are necessary for the execution of this specification, shall be selected in accordance with MIL-STD-970.

3.2.1 General specification. The requirements of Underwriters' Laboratories Inc., shall apply as requirements of this specification. When the requirements conflict, the requirements of this specification shall take precedence.

3.3 Materials. Materials shall be as specified herein. However, when a definitive material has not been specified, a material shall be chosen of the quality used for the purpose in standard commercial practice. Materials shall be free from all defects and imperfections that might otherwise affect the serviceability of the finished product.

3.3.1 Standard parts. With the exception of 3.3.2, AN, MS, and NAS standard parts shall be used to the maximum extent possible. They shall be identified on all drawings by their standard military part numbers.

3.3.2 Commercial parts. Commercial (non-standard) parts having suitable properties may be used where, on the date of invitation for bids, there are no suitable standard parts. In any case, commercial utility parts such as screws, bolts, nuts, washers, cotter pins, etc, having suitable properties may be used provided:

a. They can be replaced by the standard parts (AN, MS, or NAS) without alteration.

b. The corresponding standard part numbers are referenced in the parts list and if practical, on the contractor's drawings.

3.3.3 Fungus-proof materials. Materials that are nutrients for fungi shall not be used where it is practical to avoid them. Where used and not hermetically sealed, they shall be treated with a fungicidal agent acceptable to the procuring activity. However, if they will be used in a hermetically sealed enclosure, fungicidal treatment will not be necessary.

3.3.4 Metals. Metals shall be corrosion-resistant or treated to resist corrosion due to fuels, salt spray, or atmospheric conditions as may be encountered in storage or normal service.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

3.3.5 Dissimilar metals. Dissimilar metals as defined by MIL-STD-889, shall not be used in intimate contact with each other unless adequately protected against galvanic corrosion.

3.3.6 Recycled, reclaimed, and virgin materials. Recycled or reclaimed material may be used in lieu of virgin material provided that all the requirements of this specification are met and the material does not jeopardize the quality or life of the finished product.

3.4 Design. The design of the floodlight shall be essentially as shown in figure 1, conforming to all the requirements of UL-844 for use in class I, division 1, group D, hazardous locations. The figure shown is a representative sample and assemblies of a slightly different design will be considered as meeting the requirements, provided the specified dimensions and all other requirements are met. The approval for design differences to be granted by the contracting activity.

3.4.1 Approval. The floodlight and cable shall be approved by Underwriters' Laboratories (UL), Factory Mutual Systems (FMS), or other equivalent Government approved qualification testing laboratory, as an electrical lighting fixture suitable for use in class I, division 1, group D, hazardous locations.

3.4.2 Lamp accommodation. The housing assembly shall be designed to accommodate any of the following lamps which shall not be furnished with the assembly:

a. A 300w, 120v, R-40, medium screw base, reflector lamp.

b. A 150w, 120v, PAR-38, medium skirted base, projector floodlamp.

c. A 75w, 30v, PAR-38, medium skirted base, projector floodlamp.

3.5 Construction. The floodlight shall be so constructed that no parts will work loose in service. It shall be built to withstand the strains, jars, vibrations, and other conditions incident to shipping, storage, installation, and service. All exposed metal parts shall be cast or fabricated from nonsparking metal. Carrying handle shall be manufactured from heat resistant materials.

3.5.1 Dimensions. The floodlight shall meet the envelope dimensional requirements of figure 1.

3.5.2 Mounting and positioning. The flexibility of mounting and positioning as required by 3.6.1.3, 3.6.1.4 and 3.6.1.5 shall be provided for through the use of the yoke and normal turntable base or pipe clamp mounting.

3.5.3 Repairs and adjustments. The floodlight shall be so constructed, that the lamp replacement and all other repairs and adjustments may be easily made without the use of special tools by personnel of the operating units and overhaul activities.

3.5.4 Weight. The weight of the floodlight shall exceed 35 pounds.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

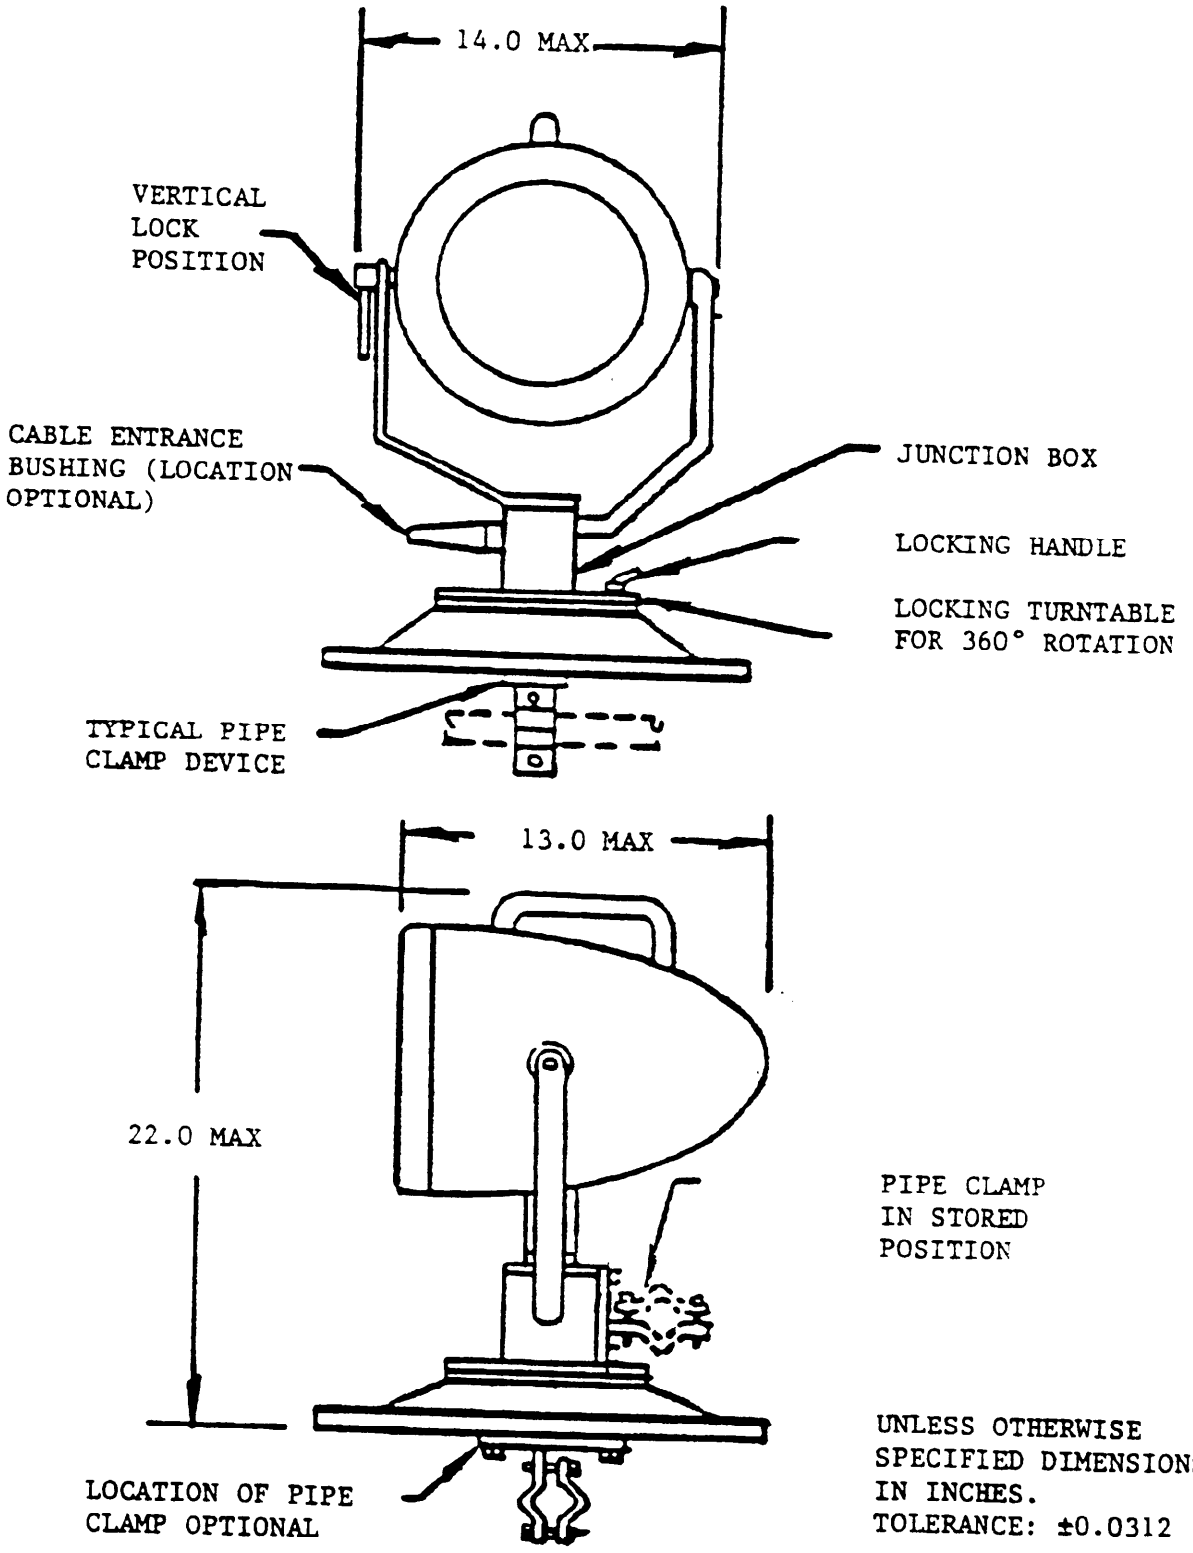


FIGURE 1. Floodlight

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

3.6 Components.

3.6.1 Fixture assembly. The floodlight fixture assembly shall consist of a lens assembly, carrying handle, lamp socket, lamp support, housing, and power cable. The lamp support shall be provided to prevent lamp breakage during handling and use and shall not interfere with lamp replacement.

3.6.1.1 Lens assembly. The lens assembly shall be designed for removal without the aid of special tools. The glass used in the lens shall be Class B, heat-resistant, clear glass in accordance with MIL-C-7989. The location and size shall be such that it will not interfere with the main beam of the lamp installed in the housing.

3.6.1.2 Carrying handle. A heat resistant carrying handle shall be provided.

3.6.1.3 Lamp socket. The lamp socket shall be of a design that will accommodate any one of the lamps specified in 3.4.2. The socket shall be constructed of porcelain or other high temperature resistant material having a minimum rating of 660w, 250v. The threaded socket shell shall be reinforced to prevent deformation if the lamp is screwed in too tightly.

3.6.1.4 Lamp support. The fixture assembly shall be furnished with a lamp support to prevent the movement of the lamp during conditions incurred during the normal course of handling, use, storage, and shipping. The support shall not interfere with the replacement of the lamp.

3.6.1.5 Housing. The lamp housing shall be configured to the approximate shape shown in figure 1.

3.6.1.6 Power cable. The floodlight assembly shall be furnished with a power cable 100±1 feet of SO or ST-6-C-K-3/16 flexible cable in accordance with J-C-580. One conductor shall be grounded to the floodlight for connection to the ground terminal of the plug. The power cable shall be supplied less the connector plug.

3.6.2 Yoke. The floodlight shall be provided with a yoke for holding the fixture assembly. The design of the yoke shall be such that it will allow the light beam to be elevated not less than 90° above and lowered not less than 45° below the horizontal, when the base is in a level plane. A means shall be provided for securely fastening the floodlight in any position in the specified vertical plane of adjustment.

3.6.3 Turntable. The floodlight shall be provided with a turntable for positioning and securely clamping the floodlight through 360° of rotation in the horizontal plane (parallel to the base). This shall be accomplished by means of a locking device on the turntable or similar device.

3.6.4 Base. The base of the floodlight assembly shall be of such that it will securely support the floodlight when placed upon a floor or other flat surface, and will prevent accidental tipping. The base shall be similar to the base shown in figure 1.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

3.6.5 Pipe clamp. The floodlight shall be provided with a pipe clamp for securely fastening the floodlight to vertical or horizontal tubing ranging from 1/2 to 2 3/16 inches in outside diameter. A means shall be provided for storing the clamp on the floodlight when the clamp is not in use as shown in figure 1.

3.7 Warning plate. Each floodlight shall have the following information molded into it or provided on a plate conveniently and conspicuously located:

CAUTION
If the connection of the electrical circuit is in an area where explosive gases are present, an explosion-proof plug and receptacle shall be used. If the electrical connection is made outside of the hazardous area, a three-way grounded plug may be used.

3.8 Identification of product. Equipment, assemblies, and parts shall be marked for identification in accordance with MIL-STD-130. The following additional information shall be included:

Part identifying number: M8115
Maximum wattage/voltage: 300w, 120v

3.8.1 Label. Each lamp assembly shall bear the label of certification for use in class I, division 1, group D, hazardous locations as certified by UL, FMS, or other equivalent Government approved qualification testing laboratory.

3.9 Interchangeability. All parts having the same manufactures part or identification number shall be functionally and dimensionally interchangeable. Any changes in these parts shall be governed by changes requiring new part or identification numbers as provided for in DOD-D-1000.

3.10 Anti-counterfeiting protection. When it has been determined that the item is susceptible to be counterfeited by either alteration, duplication, or simulation, the product shall be protected in such a manner as to allow it to be traced to the true manufacturer and authenticated as their product. The manner of this protection shall be proprietary to the true manufacturer and released only to the final procuring activities quality assurance department by secure means.

3.11 Workmanship. Each item, including all parts and accessories, shall be fabricated and finished, free of blemishes and defects which will adversely affect its life, form, fit, or function and finished in accordance with the highest quality commercial standards. All soldering, welding, brazing, grinding, cuts, shall be accurate and clean. All edges, corners, and exterior hardware shall be free from burrs, sharp edges, corrosion, or any other defect which would affect the safety of personnel handling the product.

3.11.1 Riveting. Riveting operations shall be carefully performed to insure tightness and satisfactory heading of rivets.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

3.11.2 Cleaning. The floodlight shall be thoroughly cleaned, with excess, loose, or spattered solder, metal chips, and other foreign materials removed during and after final assembly.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements (examinations and tests) as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in this specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to accept defective material.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.4).

b. Quality conformance inspection (see 4.5).

4.3 Inspection conditions. Unless otherwise specified, all operational inspections shall be performed in accordance with the test conditions of MIL-STD-810.

4.4 First article inspection. When specified (see 6.2), the first article inspection shall be performed at the contractor's plant, witnessed by a Government representative. Two production samples shall constitute a first article sample.

4.4.1 Examination. When specified, the first article shall be examined as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.4.2 Inspection. When specified, a first article shall be subjected to the inspections listed in 4.5. Operation is only required to be performed in any one of the three combinations (see 3.4.2). Failure of any inspection condition shall be cause for rejection. Any redesign or modification of the contractor's standard product to comply with specified requirements or any necessary redesign or modification following failure to meet specified requirements, shall receive particular attention for adequacy and suitability.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

4.5 Quality conformance inspection.

4.5.1 Examination of the product. Examination of the product shall include the inspection of each floodlight for compliance with the requirements specified herein with respect to materials, dimensions, marking, and workmanship and the comparison of the floodlight approval reports from UL, FMS, or equivalent Government approved qualification testing laboratory for compliance to UL-844 requirements. Table I lists the physical examination inspections that shall be performed to determine compliance with the respective paragraph cited. One major or two minor defects shall be cause for rejection.

TABLE I. Physical examination

Inspection	Requirement paragraph	Defect type
Lamp Accommodation	3.4.2	Major
Dimensions	3.5.1	Major
Mounting/positioning	3.5.2	Major
Repairability	3.5.3	Major
Weight	3.5.4	Minor
Components	3.6	Major
Base support	3.6.4	Major
Warning plate	3.7	Major
Marking	3.8	Minor
Label	3.8.1	Minor
Workmanship 1/	3.11	Minor

1/ any single item.

4.5.2 Dissimilar metals. Metals shall be examined for compliance to MIL-STD-889. Noncompliance shall be cause for rejection.

4.5.4 Environmental. The sample shall be subjected to the following tests in accordance with the methods and procedures of MIL-STD-810 specified herein. Upon completion of each test, there shall be no damage to the sample which would affect operation, serviceability, or cause the sample to malfunction.

4.5.4.1 Fungus. The sample, not operating, mounted upon a nonconducting panel or table for this test, shall be subjected to fungus in accordance with Method 508.3. Evidence of excessive fungus growth or a malfunction of the sample as a result of this test shall be cause for rejection.

4.5.4.2 Corrosion resistance. The sample, not operating, mounted upon a nonconducting panel or table for this test, shall be subjected to a salt spray fog in accordance with Method 509.2 for a period of 100 hours. Evidence of excessive corrosion or a malfunction of the sample as a result of this test shall be cause for rejection.

4.5.4.3 Vibration. The sample operating as required by the test method shall be subjected to vibration in accordance with Method 514.3, Category 8, Procedure I.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

Evidence of rivet loosing, loss of position lock, or malfunction of sample as a result of this test shall be cause for rejection.

4.5.5 Operation. Operation shall be performed with each of three lamp and voltage combinations (see 3.4.2). Each lamp and voltage combination shall provide illumination without producing an unsafe condition, deterioration or damage to any component part of the floodlight assembly. Failure of any sample to pass any of these conditions as a result of this test shall be cause for rejection.

4.6 Inspection of packaging. Except when industrial packaging is specified, the sampling and inspection of the preservation and interior package marking shall be in accordance with groups A and B quality conformance inspection requirements of MIL-P-116. The sampling and inspection of the packing and marking for shipment and storage shall be in accordance with the quality assurance provisions of the applicable container specification shown in section 5 and the marking requirements of MIL-STD-129. The inspection of industrial packaging shall be as specified in the contract (see 6.2).

5. PACKAGING

5.1 Preservation and packaging. The preservation and packaging shall be level A, C, or commercial as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Cleaning. Each complete unit shall be cleaned in accordance with 3.11.2 and MIL-P-116.

5.1.1.2 Preservation. Preservatives shall not be used.

5.1.1.3 Unit packs. Each complete unit shall be packed as specified in method IA-16, MIL-P-116.

5.1.2 Level C. Each complete unit shall be preserved and packaged in accordance with the applicable requirements of MIL-STD-2073.

5.1.3 Commercial. Each complete unit shall be preserved and packaged in accordance with ASTM D-3951.

5.2 Packing. The packing shall be level A, B, C, or commercial, as specified (see 6.2).

5.2.1 Level A. Each complete unit shall be packed in a close-fitting box conforming to PPP-B-601, overseas type. Blocking, bracing, cushioning, and anchoring or otherwise securing to prevent movement inside the container or damage to the contents shall conform to the requirements of MIL-STD-1186. The container shall be closed and strapped in accordance with the appendix of PPP-B-601.

5.2.2 Level B. Each complete unit shall be packed as specified for level A, except that the boxes shall conform to PPP-B-601, domestic type.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

5.2.3 Level C. Each complete unit shall be packed in accordance with the applicable requirements of MIL-STD-2073.

5.2.4 Commercial. Each complete unit shall be packed in accordance with the applicable requirements of ASTM D-3951.

5.3 Marking. In addition to any special marking specified in the contract or purchase order, interior packages and shipping containers shall be legibly marked in accordance with MIL-STD-129 or ASTM D-3951, as applicable. The nomenclature shall be as follows:

M8115 Floodlight, Incandescent, Explosion Proof, Type MA-1.

5.3.1 Anti-counterfeit marking. When an item has been deemed to be susceptible to counterfeiting, each item shall be marked in such a manner as to provide the contracting activity with an authentication and traceability track to the true manufacturer. The method in which this is done shall be proprietary to the true manufacturer and provided to the quality assurance office of the contracting activity by secure means.

5.4 Palletization. When unitized loads, commensurate with the level of packing are specified in the contract or purchase order, they shall be palletized in accordance with MIL-STD-147. Palletized loads shall be uniform in size and quantities, to the greatest possible extent possible. If the container is of a size which does not conform to any of the pallet patterns specified in MIL-STD- 147, the pallet pattern used shall first be approved by the contracting officer.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The type MA-1 portable floodlight covered by this specification is intended for use as a worklight in areas where explosive gases may be present. For mounting, the light may be used with a wheel base or clamped to the tubing members of aircraft maintenance stands. The pipe clamp feature show in figure 1 is intended to afford a convenient means for temporarily mounting the light adjacent to the working area. This feature is not to be construed as providing a means for permanently installing the light.

6.2 Acquisition requirements. Acquisition documents must specify the following:

a. Title, number, and date of this specification.

b. Identification marking (see 3.8).

c. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of the individual documents referenced (see 2.2).

d. When first article required (see 3.1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

e. Levels of preservation, packaging, and packing required (see 5.1 and 5.2).

f. When palletization is required (see 5.4).

6.3 First Article. When a first article inspection is required, the contracting officer should provide specific guidance to offerors as to whether the items should be preproduction samples, first article samples, first production samples, samples selected from the first (XX) items, or standard production items from the contractor's current inventory, and the number of items to be tested if different than 4.4. The contracting officer should also include specific instructions in acquisition documents regarding arrangements for examinations, approval of first article test results, and disposition of the first articles. Invitations for bids should provide that the Government reserves the right to waive the requirements for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government, and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.4 Subject term (key word) listing.

Floodlight, Explosion Proof
Floodlight, Incandescent, Explosion Proof MA-1
Floodlight, Hazardous Location
Light, Explosion Proof
Light, Incandescent, Explosion Proof MA-1
Light, Hazardous Location

6.5 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Custodian:
Air Force - 99

Reviewing activity:
DLA - GS

Preparing activity:
Air Force - 82

Agent activity:
Air Force - 99

(Project 6230-F301)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-F-8115	Floodlight, Incandescent, Explosion Proof, Type MA-1

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR
	☐ USER
b. ADDRESS *(Street, City, State, ZIP Code)*	☐ MANUFACTURER
	☐ OTHER *(Specify)*: _____

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

(TO DETACH THIS FORM, CUT ALONG THIS LINE.)

DD FORM 82 MAR 1426 PREVIOUS EDITION IS OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 2026-01-17 09:55Z
Check the source to verify that this is the current version before use.

(Fold along this line)

NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

CIAL BUSINESS
\LTY FOR PRIVATE USE $300

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 73236 WASH DC

POSTAGE WILL BE PAID BY HQ U.S. AIR FORCE

SA-ALC|MMDEMM
Kelly AFB, TX 78241

TRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in itting comments and suggestions for improvements. All users of military standardization documents are invited to provide estions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and ed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the blems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an nowledgement will be mailed to you within 30 days to let you know that your comments were received and are being sidered.

TE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of ification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization aive any portion of the referenced document*(s)* or to amend contractual requirements.

☆ U.S. Government Printing Office: 1992—350-879/80804

(Fold along this line)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T09:55Z
Check the source to verify that this is the current version before use.