
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, CLASS H, NONRENEWABLE, 600 VOLTS, 61-100 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1726.

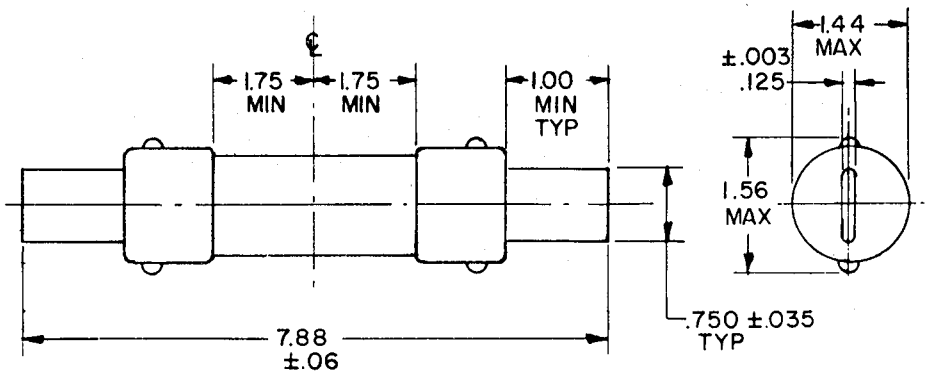

INCHES	MM
0.003	.08
.035	.89
.06	1.52
.125	3.18
.750	19.05
1.00	25.40
1.44	36.58
1.56	39.62
1.75	44.45
7.88	200.15

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Minimum acceptable thickness of tube wall .094(2.39 mm).

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical - Nonrenewable.
Terminals - Knife blade.
Material - Copper or copper alloy.
Strength - 5 pound-inches torque between body and blades.

Body:
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:
Voltage - 600 volts or less.

Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50° C above ambient on the body and the blades.

Overload interrupt:
Instantaneous - Shall interrupt within 2 hours at 135 percent of rated current and within 6 minutes at 200 percent of rated current.
Time delay - In addition to the above requirement, the fuse shall not interrupt 500 percent of rated current within 10 seconds.
Motor start - Shall interrupt within 2 hours at 135 percent of rated current and within 8 minutes at 200 percent of rated current. These fuses shall be plainly marked, "FOR USE ON MOTOR CIRCUITS ONLY".

Short circuit interrupt - 10,000 amperes at 600 volts.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table:

Government part number	Current rating (amps)	Overload interrupt
WF1726/ 9-001	70	Instantaneous
002	80	↕
003	90	↕
004	100	Instantaneous
005	70	Time delay
006	80	↕
007	90	↕
008	100	Time delay
009	70	Motor start
010	80	↕
011	90	↕
012	100	Motor start

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 80

Review activities:

Army - EL, ME, MI, MU
Navy - SH, MC
Air Force - 80
DSA - ES
NS

User activities:

Army - AT, WC
Navy - AS, OS
Air Force - 11

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
DOT - FIS
GSA - FSS, PBO
NASA - JFK, MSF
HEW - NIH
USDA - AFS

(Project 5920-0328-9)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 10 cents each.

Source: https://assist.dla.mil -- Downloaded: 20261O-26T11:35Z
Check the source to verify that this is the current version before use.