
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS G
(CURRENT-LIMITING) 300 VOLTS, 0-15 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

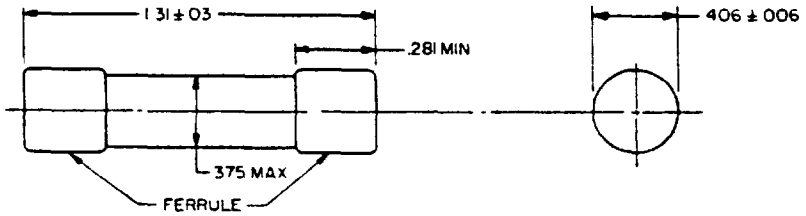

INCHES	MM
.006	15
.03	.76
.281	7.14
375	9.53
406	10 31
1 31	33.27

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest 01 mm) are given for general information only and are based upon 1 inch = 25 4 mm
3 Minimum acceptable thickness of ferrule side wall 025 (64 mm)

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction - See figure

Physical - Nonrenewable
Terminals - Ferrule type
Material - Brass, copper, or copper alloy
Strength - 2 pound-inches torque between body and ferrules

Body
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical
Voltage - 300 volts or less
Frequency - 48 to 60 hertz
Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50°C above ambient on the body and the ferrules

Overload interrupt
Instantaneous - Shall interrupt within 1 hour at 135 percent of rated current and within 2 minutes at 200 percent of rated current
Time delay - In addition to the above requirement, the fuse shall not interrupt 200 percent of rated current within 12 seconds
Watts loss - Average not to exceed 2.5 watts
Interrupting capacity rating - 100,000 amperes rms symmetrical at 300 volts, 60 Hz, and power factor of 20 percent or less

Threshold ratio - 30 maximum

Peak let-thru current - 3,000 amperes maximum

Maximum clearing I^2T - $2x10^3$ $ampere^2$ seconds

Applicable fuseholders Type II in accordance with W-F-870

Part number See table

Government part number	Current rating (amps)	Overload interrupt
WF1811/01-001	1	Instantaneous
-002	3	Instantaneous
-003	6	Time delay
-004	10	Time delay
-005	15	Time delay

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS.

Army - EL
Navy - YD
Air Force - 85

Review activities

Army - EL, AT, ME, WC
Navy -
Air Force - 80
DSA - ES
NS

User activities

Army - MU
Navy - OS
Air Force -

Preparing activity.

DSA - ES

Civil Agency Coordinating Activities

AEC - AEC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0342-1)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents See section 2 of the general specification to obtain extra copies and other documents referenced herein Price 25 cents each

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:35Z
Check the source to verify that this is the current version before use.