INCH-POUND
W-F-1814/1D
19 February 2015
SUPERSEDING
W-F-1814/1C
27 July 2009

FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS G (CURRENT-LIMITING) 600 VOLTS, 0-15 AMPERES

The General Services Administration has authorized the use of this federal specification sheet by all federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue in effect of W-F-1814.

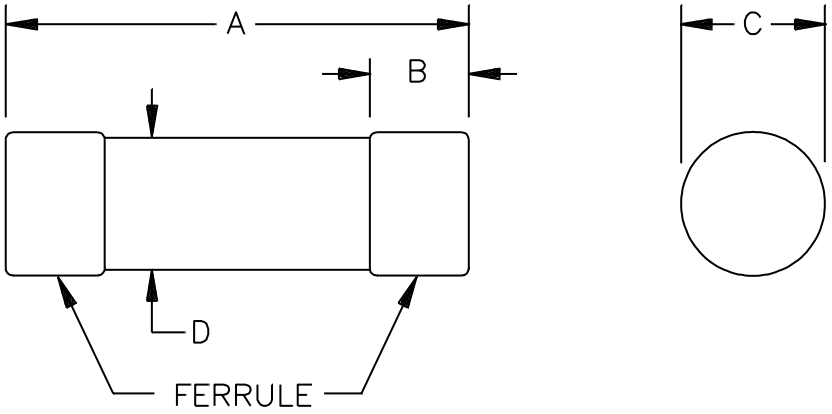

Dimensions				
Letter	Inches		Millimeters	
	Min.	Max.	Min.	Max.
A 1.31 ±.03	1.280	1.340	32.51	34.03
B .281 Min.	.281	---	7.14	---
C .406 ±.006	.400	.412	10.16	10.46
D .375 Max.	---	.375	---	9.53

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Minimum acceptable thickness of ferrule side wall .025 (.64 mm).

FIGURE 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Physical: Nonrenewable.

Terminals: Ferrule type.

Material: Brass, copper, or copper alloy.

Strength: 2 pound-inches torque between body and ferrules.

Body:

Insulating material: Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:

Voltage: 600 volts or less.

Frequency: 48 Hz to 60 Hz.

Current: See table I.

Current carrying capacity: 100 percent indefinitely with temperature rise not to exceed 75°C above ambient on the ferrules.

Overload interrupt:

Instantaneous: Shall interrupt within 1 hour at 135 percent of rated current and within 4 minutes at 200 percent of rated current.

Time delay: In addition to the above requirement, the fuse shall not interrupt 200 percent of rated current within 12 seconds.

Watts loss: Average not to exceed 2.5 watts.

Interrupting capacity rating: 100,000 amperes rms symmetrical at 600 volts, 60 Hz, and power factor of 20 percent or less.

Threshold ratio: 60 maximum.

Peak let-thru current: 4,000 amperes maximum.

Maximum clearing: I^2T - $3.8x10^3$ $ampere^2$ seconds.

Applicable fuseholders: Class G in accordance with UL 4248-5.

Part or Identifying Number (PIN): See table I.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

Government PIN	Current rating (amps)	Overload interrupt
WF1814/01-001	1	Instantaneous
WF1814/01-002	3	Instantaneous
WF1814/01-003	6	Time delay
WF1814/01-004	10	Time delay
WF1814/01-005	15	Time delay

Referenced documents. In addition to W-F-1814, this document references the following:

UL 4248-5

The margins of this specification sheet are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

MILITARY INTERESTS:

Custodians:
Army - CR
Navy - YD
Air Force - 85
DLA - CC

Review activities:
Army - AT, CR4
Navy - OS
NSA - NS

CIVIL AGENCY COORDINATING ACTIVITIES:

GSA -FAS

Preparing activity:
DLA - CC

(Project 5920-2015-016)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.