[INCH-POUND]
W-F-1814/5A
19 October 1998
SUPERSEDING
W-F-1814/5
23 May 1974

FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS J (CURRENT-LIMITING) 600 VOLTS, 0-30 AMPERES

The General Services Administration has authorized the use of this federal specification, by all federal agencies.

The complete requirements for procuring the fuse cartridge described herein shall consist of this document and the latest issue in effect of W-F-1814.

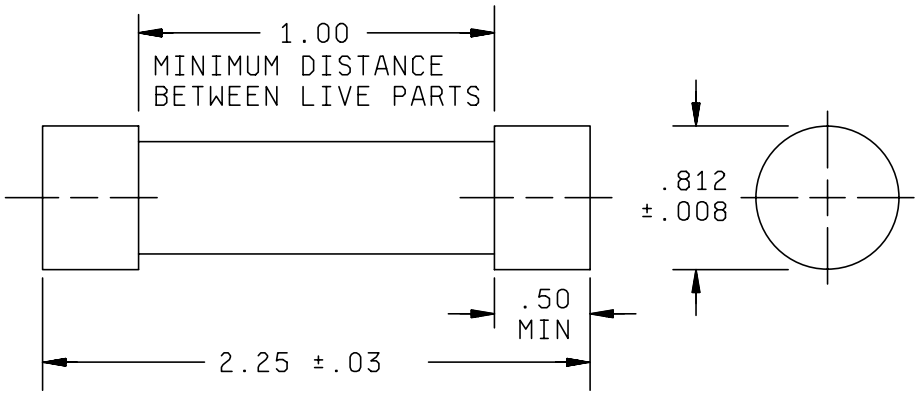

Inches	mm
0.008	0.20
0.03	0.76
.50	12.70
.812	20.62
1.00	25.40
2.25	31.75

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±0.02 (0.51 mm) for two-place decimals and ±0.005 (0.13 mm) for three-place decimals.

FIGURE 1. Configuration and dimensions.

Beneficial comments, recommendations, additions, deletions, clarifications, etc. and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAM, 3990 East Broad Street, Columbus, OH 43213-1199, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Physical: Nonrenewable.

Terminals - Ferrule type:

Material - Brass, copper or copper alloy.

Strength - 5 pound-inches torque between body and ferrules.

Body:

Insulating material - Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical:

Voltage - 600 volts or less.

Frequency - 48 Hz to 60 Hz.

Current - See table I.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 85°C above ambient on the body and 50°C on the ferrules.

Overload interrupt - Shall interrupt within 1 hour at 135 percent of rated current and within 2 minutes at 200 percent of rated current.

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Threshold ration - 30 maximum.

Maximum peak let-thru current - See table I.

Maximum clearing I^2T - See table I.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table I.

TABLE I. Electrical characteristics. 1/

Government part number	Current rating (amperes)	Maximum peak let-thru current amperes	Maximum clearing $I^2T \times 10^3$
WF1814/05-001	1	2,300	2.0
WF1814/05-002	3	2,300	2.0
WF1814/05-003	6	3,300	3.0
WF1814/05-004	10	3,300	3.0
WF1814/05-005	15	4,000	4.0
WF1814/05-006	20	5,000	5.0
WF1814/05-007	25	6,000	5.5
WF1814/05-008	30	7,500	7.0

1/ For silver plated terminals, the designator "S" is added after the dash number.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

MILITARY INTEREST:

Custodians
Army - CR
Navy - YD1
Air Force - 85

Review Activities
Army - AT, CR4
Navy - OS
Air Force - 80
NSA - NS

CIVIL AGENCY
COORDINATING ACTIVITIES:

Preparing Activity
DLA - CC

(Project 5920-0567)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.