
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS J
(CURRENT-LIMITING) 600 VOLTS, 31-60 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

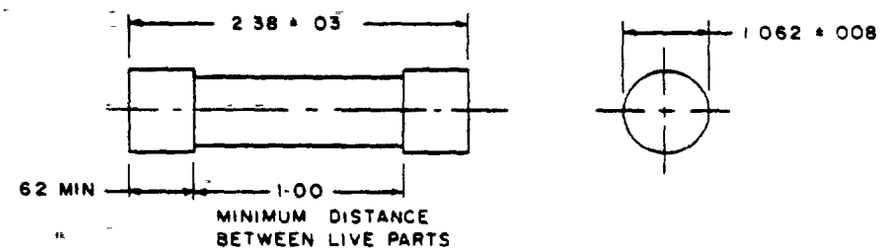

INCHES	MM
.008	.20
.03	76
.62	15.75
1.00	25.40
1.062	26.97
2.38	60.45

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical Nonrenewable.

Terminals - Ferrule type
Material - Brass, copper or copper alloy.
Strength - 5 pound-inches torque between body and ferrules.

Body

Insulating material - Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical.

Voltage - 600 volts or less.
Frequency - 48 to 60 hertz.
Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 85°C above ambient on the body and 50°C on the ferrules.

Overload interrupt - Shall interrupt within 1 hour at 135 percent of rated current and within 4 minutes at 200 percent of rated current

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Threshold ratio - 30 maximum

Maximum peak let-thru current - See table.

Maximum clearing I^2T - See table.

Applicable fuseholders Type II in accordance with W-F-870.

Part number See table.

Government part number	Current rating (amps)	Maximum peak let-thru current amperes	Maximum clearing I^2Tx10^3
WF1814/06-001	35	7,500	12
-002	40	8,000	17
-003	45	8,500	18
-004	50	9,000	22
-005	60	10,000	30

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 85

Review activities:

Army - EL, AT, ME, WC
Navy -
Air Force - 80
DSA - ES
NS

User activities:

Army - MU
Navy - OS
Air Force -

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0342-6)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 25 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.