A-A-50506A
1 December 1982
SUPERSEDING
A-A-50506
18 January 1982

COMMERCIAL ITEM DESCRIPTION

FAN, TUBEAXIAL, MINIATURE, FOR COOLING ELECTRONIC EQUIPMENT

This commercial item description (CID) is approved for use by the Naval Electronic Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

Salient characteristics:

Size: 4 11/16 x 4 11/16 x 1 1/2 inches, self contained (includes capacitor if required).

Ratings: 260 (max)/210(max) milliamperes (running), 380(max)/340 (max) ma (lock rotor) 115 volts, alternating current, 1 phase, 50/60 hertz, 18 watts maximum, single speed fully enclosed motor 100 CFM minimum at 0.0 static pressure at .075.


Bearings: Class A - Bearing, sleeve, self-lubricating
Class B - Bearing, ball annular, shielded, permanently lubricated

Material: Manufacturer standard commercial design per certification.

Ambient Temperature at Full Rated Power: (-) 15°C to 72°C

Electrical Connection: Solder Type or Screw Type terminals with terminal location as shown in figure. Type A -
Size 1 - Terminal plug-in (solderable) (see Figure 3).
Size 2 - Terminal plug-in (solderable) (see Figure 3)
Type B - Screw terminal

Shall conform to the Underwriters Laboratories, Inc., (UL) Standard 45.

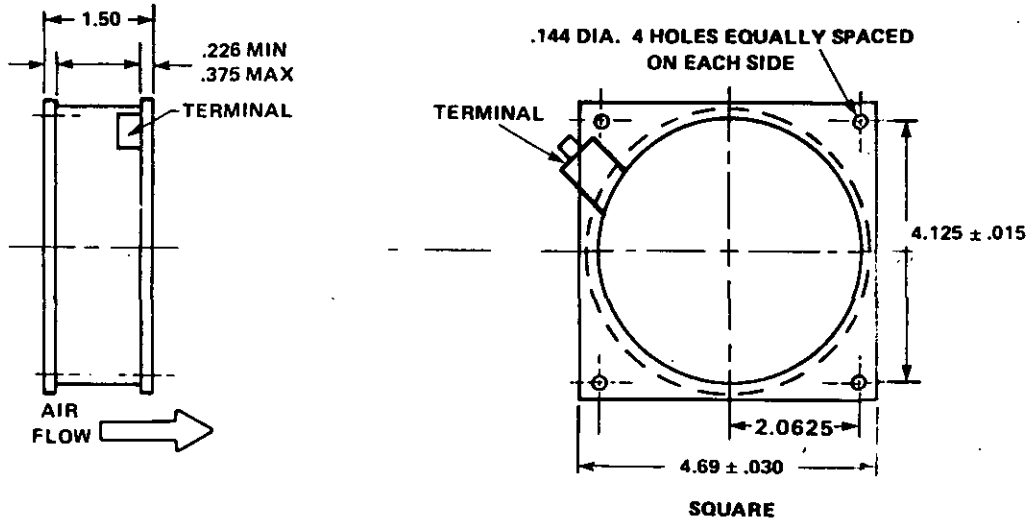


NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. DIMENSION TOLERANCES ARE ±.010 UNLESS OTHERWISE SPECIFIED.

FIGURE 1. Terminal location.

FSC 4140


Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:43Z
Check the source to verify that this is the current version before use.

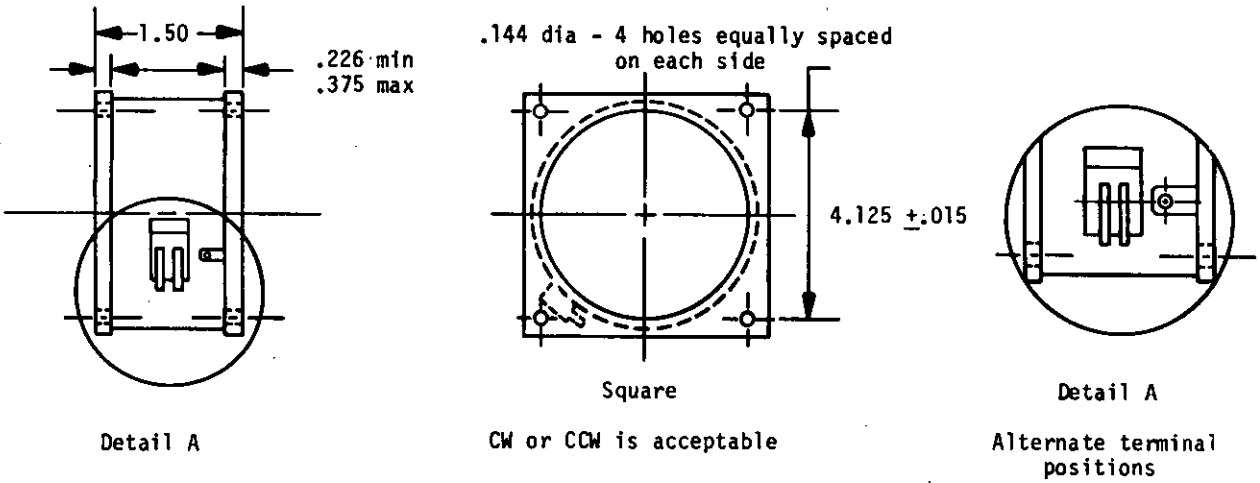

NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. DIMENSION TOLERANCES ARE ±.010 UNLESS OTHER SPECIFIED.

FIGURE 2. Alternate Terminal location.

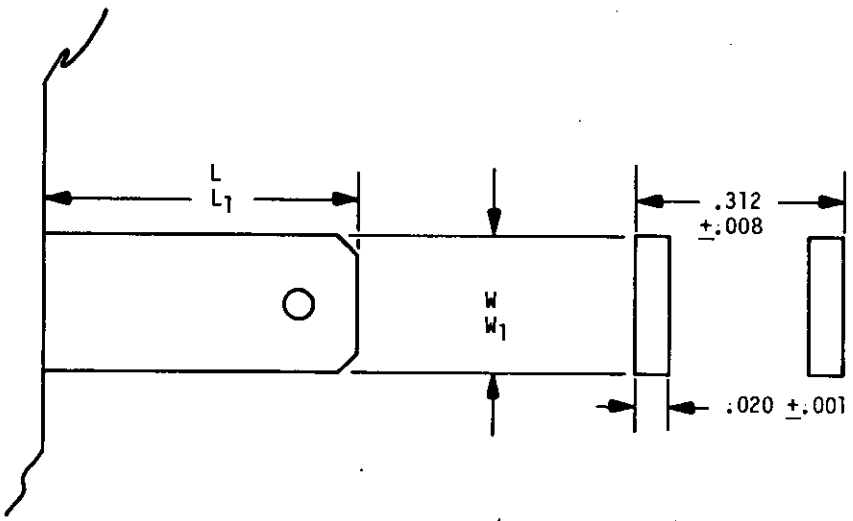

	L	L_1	W	W_1
SIZE 1 (110 Series)	.305 ±025		.115 ±005	
SIZE 2 (187 Series)		.350 ±.075		.187 ±.002

NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. DIMENSION TOLERANCES ARE ±.010 UNLESS OTHERWISE SPECIFIED.

FIGURE 3. Electrical Connection size.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:43Z
Check the source to verify that this is the current version before use.

Certification. The contractor shall certify that the product offered meets the salient characteristics of this description and conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

Regulatory requirements. The manufacturer shall utilize recovered materials to the maximum extent practicable.

Packaging, packing, and marking. The packaging, packing, and marking shall be as specified in the contract or order.

UL standards are available from Underwriters Laboratories, Inc., 1285 Walt Whitman Road, Melville, Long Island, NY 11747.

Preparing activity:
Navy - EC

Custodians:
Army - ME
Navy - EC
Air Force - 99

Review activity:
Air Force - 82

(Project 4140-0115)

☆U.S. GOVERNMENT PRINTING OFFICE: 1983-605-034/723

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:43Z
Check the source to verify that this is the current version before use.