FED. SUP CLASS
6115

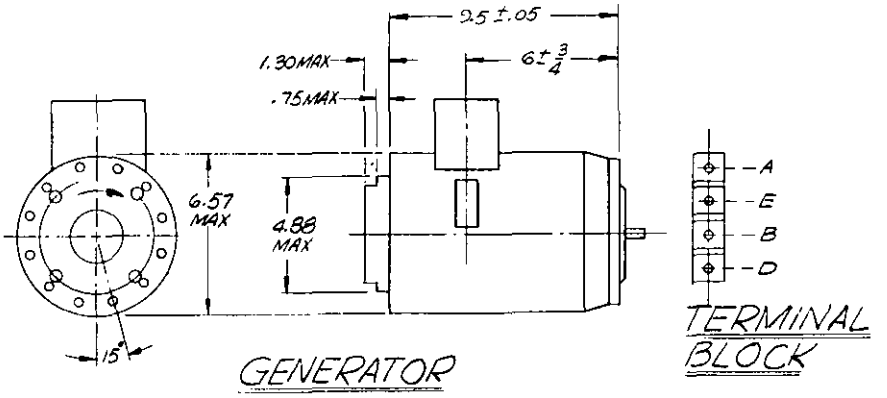

GENERATOR

TERMINAL BLOCK

ACCELERATION ALONG THIS AXIS FOR DETERMINATION OF VOLTAGE DEVIATION SHALL BE 5G. ACCELERATION FOR THE DETERMINATION OF INSTABILITY SHALL BE 1.75G

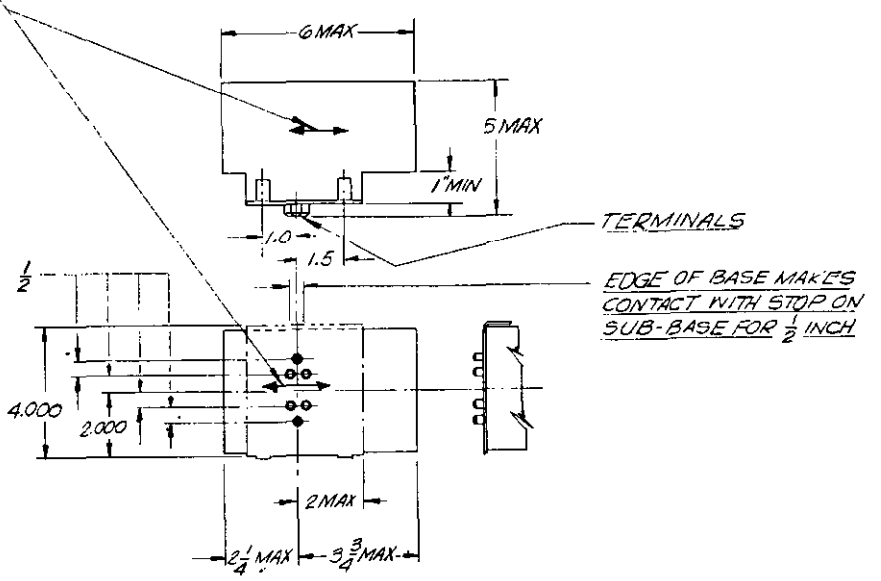

REGULATOR

(A) CANCELLED WITH NO SUPERCEDING STANDARD

APPROVED 3 JULY 1969 REVISED (A) 30 July 1984

This standard has been approved by the Department of the Air Force and is mandatory for use by the activity. All other military activities are required to employ this standard where suitable.

P.A. AIR FORCE - 11 Other Cust	TITLE STARTER-GENERATOR AND REGULATOR, 200 AMPERE, 30 Volt DC	MILITARY STANDARD MS 27602(USAF)
PROCUREMENT SPECIFICATION MIL-G-6162	SUPERSEDES:	SHEET 1 OF 2

DD FORM 1 SEP 83 672-1 (Limited coordination)

EDITION OF 1 SEP 57 MAY BE USED.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T16:44Z
Check the source to verify that this is the current version before use.