INCH-POUND
MIL-PRF-15160/40C
15 October 2008
SUPERSEDING
MIL-PRF-15160/40B
17 August 2006

PERFORMANCE SPECIFICATION SHEET

FUSES, STYLE F40

INACTIVE FOR NEW DESIGN
AFTER 27 DECEMBER 1990

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-PRF-15160.

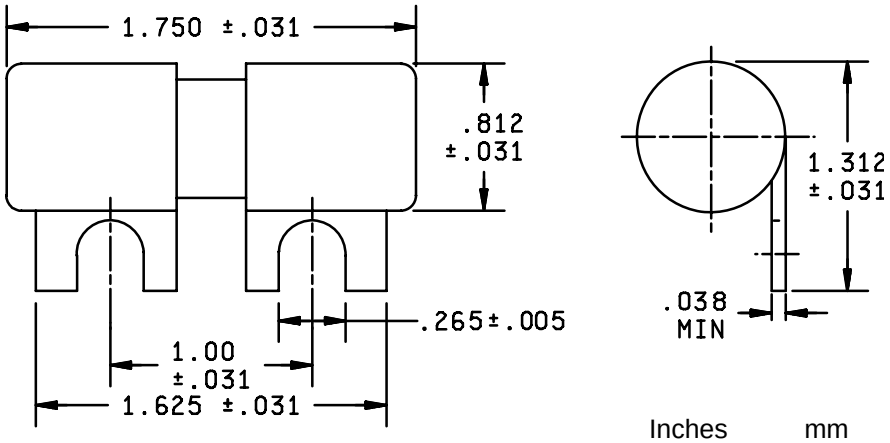

Inches	mm
.005	0.13
.031	0.78
.038	1.19
.265	6.73
.812	20.62
1.00	25.4
1.312	33.32
1.625	41.28
1.750	44.45

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.005 (0.13 mm) for three place decimals and ±.02 (0.5 mm) for two place decimals.

FIGURE 1. Style F40.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:46Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Case material: Fiber or black paper.

Ferrule material: Brass.

Lug material: Brass.

Terminal strength (ferrules): 5 inch-pound torque.

Electrical:

Current rating: See table I.

Voltage rating: See table I.

Characteristic: See table I and table II.

Type designation: Type designation shall be as specified in table I.

TABLE I. Type designation.

Style	Characteristic	Voltage	Current
F40	A	32V	40A
F40	A	32V	50A
F40	A	32V	60A
F40	A	32V	70A
F40	A	32V	75A
F40	A	32V	80A
F40	A	32V	100A
F40	A	32V	125A
F40	A	32V	150A
F40	B	32V	40A
F40	B	32V	50A
F40	B	32V	60A
F40	B	32V	70A
F40	B	32V	75A
F40	B	32V	80A
F40	B	32V	100A
F40	B	32V	125A
F40	B	32V	150A

Overload interrupt: See table II.

Short circuit interrupt: 10,000 A at rated voltage dc.

Insulation resistance: 0.1 megohm minimum.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:46Z
Check the source to verify that this is the current version before use.

TABLE II. Overload interrupt.

Percent nominal rating	Current range	Characteristic	
		A	B
1/ 135	40 A to 60 A	0 to 1 hour	0 to 1 hour
	70 A to 150 A	0 to 2 hours	0 to 2 hours
300	All ratings	N/A	15 seconds minimum

1/ The overload interrupt test at 135 percent shall be performed at 32 volts or less.

VERIFICATION:

Qualification inspection is not applicable for 40A, 50A, 75A, 100A, 125A, and 150A characteristic A fuses and all characteristic B fuses of this specification sheet (see table I) and shall be replaced by acceptance testing consisting of Group A and Group B inspections per MIL-PRF-15160, prior to delivery.

Qualification inspection (Characteristic A only): The number of qualification samples required shall be:

a. 24 samples maximum current rating of each voltage and design.

b. 24 samples minimum current rating of each voltage and design.

The margins of this specification sheet are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:46Z
Check the source to verify that this is the current version before use.

Custodians:
Army - CR
Navy - SH
Air Force - 85

Review activities:
Air Force - 99

Preparing activity:
DLA - CC

(5920-2008-041)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:46Z
Check the source to verify that this is the current version before use.