
INCH-POUND
MIL-F-15160/60F
29 October 1990
SUPERSEDING
MIL-F-15160/60E
20 October 1978

MILITARY SPECIFICATION SHEET

FUSES: INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F60

This specification sheet is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-F-15160

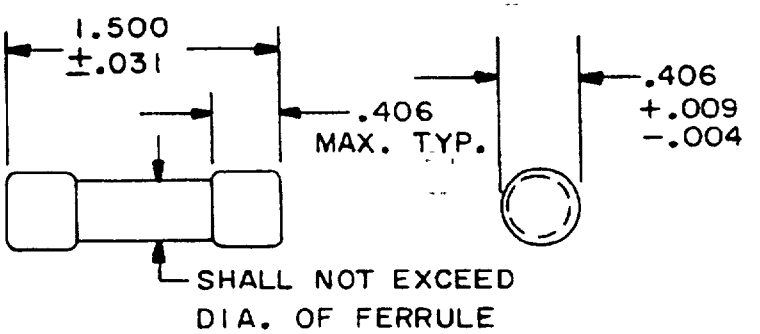

INCHES	MM
0 004	0 10
0.031	0 71
0 406	10 16
1.500	38 10

NOTES
1. Dimensions are in inches
2. Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm

FIGURE 1. *Style F60, characteristic C*

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:48Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. *Design and construction* See figure 1

Physical.

Material

Case – Glass melamine
Ferrule – Brass, copper, bronze, or copper alloy
Finish – Nickel or bright alloy plate, silver plated when specified
Terminal strength – MIL-STD-202, method 211, test condition E, 2 pound-inch torque between ferrules and fuse body.

Electrical

Current rating – See table I
Current carrying capacity – 110 percent of rated current
Voltage rating – See table I
Characteristic – See table I
Overload interrupt – Within 1 hour at 135 percent of rated current, and within 2 minutes at 200 percent
Short circuit interrupt – 200,000A at 500 Vac (symmetrical), 150,000A at 500 Vdc
Shock – MIL-STD-202, method 207, HI shock
Vibration – MIL-STD-202, method 204, test condition A (except 5g, 500 Hz).

2. *Type designation.* Type designation shall be as specified in table I

3. *Qualification.* Required.

TABLE I *Type designation.*[1]

Style	Characteristic	Voltage	Current
F60	C	500	1/8A
F60	C	500	1/4A
F60	C	500	3/8A
F60	C	500	1/2A
F60	C	500	3/4A
F60	C	500	1A
F60	C	500	3A
F60	C	500	5A
F60	C	500	6A
F60	C	500	8A
F60	C	500	10A
F60	C	500	15A
F60	C	500	20A
F60	C	500	25A
F60	C	500	30A

[1]For silver plated terminals, the designator "S" is added after the current rating

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:48Z
Check the source to verify that this is the current version before use.

QUALITY ASSURANCE PROVISIONS:

Qualification inspections The number of qualification samples required shall be:

a 24 samples maximum current rating of each voltage and design
b 24 samples minimum current rating of each voltage and design

NOTE: If labels are used 5 additional samples of any rating are required

Sample size. The number of group III samples shall be twelve samples each of the maximum and minimum current ratings. The samples shall be divided as shown in table II.

TABLE II. *Short circuit tests.*

Number of samples	Short circuit current	Test voltage
3	5,000A	500 Vac[1]
3	200,000A	500 Vac[1]
3	5,000A	500 Vdc
3	150,000A	500 Vdc

[1]A 600 volt ac test voltage may be used

INSPECTION ROUTINE:

AC short circuit test. AC short circuit tests shall be performed at the currents shown in table II at not less than 500 volts, single phase, and not greater than 20 percent power factor, lagging. The current shall be applied within plus or minus 10 degrees of the zero point of the voltage wave.

DC short circuit test. DC short circuit tests shall be performed at the currents shown in table II at not less than 500 volts. The rate of rise shall be between 25,000,000 and 30,000,000 amperes per second.

Cross-reference For applicable cross-reference see table III The existing stocks of superseded items may be used. When exhausted, the superseding parts shall be used

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:48Z
Check the source to verify that this is the current version before use.

TABLE III *Cross-reference*

Superseding No	Superseded numbers for CAGE				
	81349	96906	71400	71424	72076
F60C500V1/8A			KLM 1/8		
F60C500V1/4A			KLM 1/4		
F60C500V3/8			KLM 3/8		
F60C500V1/2A			KLM 1/2		
F60C500V3/4A			KLM 3/4		
F60C500V1A	F60H1R00C	MS15249-1	KLM 1	A5Y1-2	MCL 1
F60C500V3A	F60H3R00C	MS15249-3	KLM 3	A5Y3-2	MCL 3
F60C500V5A	F60H5R00C	MS15249-5	KLM 5	A5Y5-2	MCL 5
F60C500V6A	F60H6R00C	MS15249-6	KLM 6	A5Y6-2	MCL 6
F60C500V8A	F60H8R00C	MS15249-8	KLM 8	A5Y8-2	MCL 8
F60C500V10A	F60H10R0C	MS15249-10	KLM 10	A5Y10-2	MCL10
F60C500V15A	F60H15R0C	MS15249-15	KLM 15	A5Y15-2	MCL15
F60C500V20A	F60H20R0C	MS15249-20	KLM 20	A5Y20-2	MCL20
F60C500V25A	F60H25R0C	MS15249-25	KLM 25	A5Y25-2	MCL25
F60C500V30A	F60H30R0C	MS15249-30	KLM 30	A5Y30-2	MCL30

PACKAGING:

Unit packaging The standard unit pack shall be 5 pieces

Revision letters are not used to denote changes due to the extensiveness of the changes

Custodians.
Army – ER
Navy – SH
Air Force – 85

Review activities:
Army – MI, AR
Navy – AS, OS, YD,
Air Force – 17, 99
DSA – ES

User activities:
Army – ME, AT
Navy – MC, CG
Air Force - 19

Preparing activity:
Navy – SH
(Project 5920-0447-14)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:48Z
Check the source to verify that this is the current version before use.