
FEDERAL SPECIFICATION SHEET

CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS K5 (NONCURRENT-LIMITING) 600 VOLTS, 31-60 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

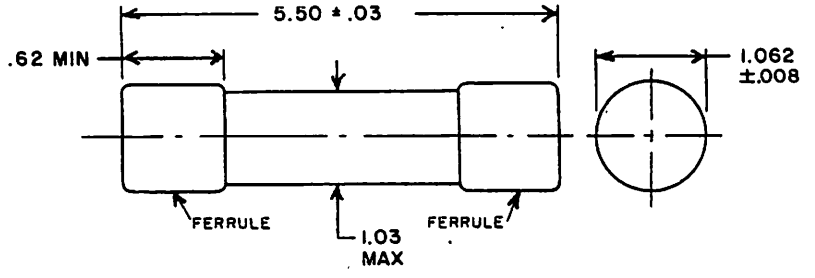

INCHES	MM
.008	.20
.03	.76
.62	15.88
1.03	26.16
1.062	26.79
5.50	139.70

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Minimum acceptable thickness of tube wall .062 (1.57 mm).
4. Minimum acceptable thickness of the ferrule sidewall .029 (.74 mm).

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:36Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure.

Physical - Nonrenewable.
Terminals - Ferrule type.
Material - Brass, copper or copper alloy.
Strength - 5 pound-inches torque between body and ferrules.
Alignment - The inside diameter of tubular gage shall be not more than 1.073 inch.

Body:
Insulating material - Fiber, ceramic, melamine-impregnated glass fiber, or other suitable material.

Electrical:
Voltage - 600 volts or less.
Frequency - 48 to 60 hertz.
Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 50°C above ambient on the body and the ferrules.

Overload interrupt:
Time delay - Shall interrupt within 1 hour at 135 percent of rated current and within 4 minutes at 200 percent of rated current. The fuse shall not interrupt 500 percent of rated current within 10 seconds.

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 48 to 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Peak let-thru current - 21×10^3 amperes maximum.

Maximum clearing I^2T - 200×10^3 $ampere^2$ seconds.

Applicable fuseholders: Type II in accordance with W-F-870.

Part number: See table.

Government part number	Current rating (amps)	Overload interrupt
WF1814/30-001	35	Time delay
-002	40	↕
-003	45	
-004	50	
-005	60	Time delay

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:36Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Army - EL
Navy - YD
Air Force - 85

Review activities:

Army - EL, AT, ME, WC
Navy -
Air Force - 80
DSA - ES
NS

User activities:

Army - MU
Navy - OS
Air Force -

Preparing activity:

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0342-30)

Source: https://assist.dla.mil -- Downloaded: 202610-26T11:36Z
Check the source to verify that this is the current version before use.