
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS J
(CURRENT-LIMITING) 600 VOLTS, 101-200 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

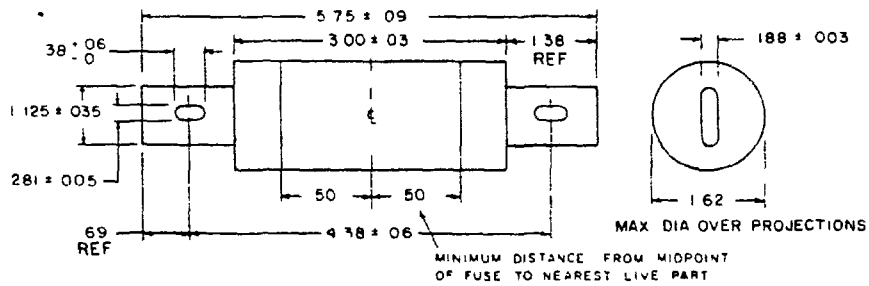

INCHES	MM	INCHES	MM
.003	.08	.50	12 70
.005	13	.69	17 53
.03	.76	1 125	28 58
035	.89	1.38	35 05
.06	1.52	1 62	41.15
.188	4.78	3 00	76.20
.281	7.14	4.38	111.25
.38	9 65	5.75	146 05

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest 01 mm) are given for general information only and are based upon 1 inch = 25 4 mm

FSC 5920

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction - See figure

Physical Nonrenewable.

Terminals - Knife blade type
Material - Brass, copper or copper alloy
Strength - 20 pound-inches torque between body and knife blades

Body.

Insulating material - Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical

Voltage - 600 volts or less
Frequency - 48 to 60 hertz
Current - See table

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 85°C above ambient on the body and 60°C on the terminals

Overload interrupt - Shall interrupt within 2 hours at 135 percent of rated current and within 8 minutes at 200 percent of rated current

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage

Threshold ratio - 30 maximum

Maximum peak let-thru current - See table

Maximum clearing I^2T - See table

Applicable fuseholders Type II in accordance with W-F-870

Part number See table

Government part number	Current rating (amps)	Maximum peak let-thru current amperes	Maximum clearing $I^2t \times 10^3$
WF1814/08-001	110	14,500	100
-002	125	15 500	150
-003	150	17,000	175
-004	175	18 500	225
-005	200	20,000	300

Source: https://assist.dla.mil -- Downloaded: 202640-26T11:35Z
Check the source to verify that this is the currentversion before use.

MILITARY CUSTODIANS

Army - EL
Navy - YD
Air Force - 85

Review activities

Army - EL, AT, ME, WC
Navy -
Air Force - 80
DSA - ES
NS

User activities

Army - MU
Navy - OS
Air Force -

Preparing activity

DSA - ES

Civil Agency Coordinating Activities

AEC - ALC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0342-8)

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 25 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.