
FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS J (CURRENT-LIMITING) 600 VOLTS, 201-400 AMPERES

(DETAIL SPECIFICATION)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue of Specification W-F-1814.

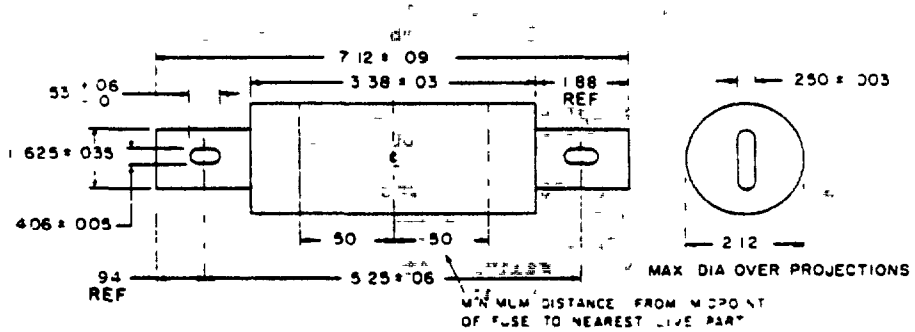

INCHES	MM	INCHES	MM
.003	.08	.406	10.31
.005	.13	.50	12.70
.03	.76	.53	13.46
.035	.89	.94	23.88
.06	1.52	1.625	41.28
.09	2.29	1.88	47.75
.212	5.38	3.38	85.85
.250	6.35	5.25	133.35
		7.12	180.85

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:36Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure

Physical Nonrenewable.

Terminals - Knife blade type
Material - Brass, copper or copper alloy.
Strength - 20 pound-inches torque between body and knife blades.

Body:

Insulating material - Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical:

Voltage - 600 volts or less.
Frequency - 48 to 60 hertz.
Current - See table.

Current carrying capacity - 110 percent indefinitely with temperature rise not to exceed 85°C above ambient on the body and 75°C on the terminals

Overload interrupt - Shall interrupt within 2 hours at 135 percent of rated current and within 10 minutes at 200 percent of rated current.

Interrupting capacity rating - 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Threshold ratio - 30 maximum.

Maximum peak let-thru current - See table.

Maximum clearing I^2T - See table.

Applicable fuseholders Type II in accordance with W-F-870.

Part number See table

Government part number	Current rating (amps)	Maximum-peak let-thru current amperes	Maximum clearing I^2Tx10^3
WF1814/09-001	225	22,500	350
-002	250	24,000	450
-003	300	26,000	600
-004	350	29,000	800
-005	400	30,000	1,100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:36Z
Check the source to verify that this is the current version before use.

Preparing activity.

DSA - ES

Civil Agency Coordinating Activities:

AEC - AEC
Commerce - NBS
DOT - ACO, FIS
GPO - GPO
GSA - FSS
Justice - FPI
NASA - JFK, LRC
Postal - POS
VA - DMS

(Project 5920-0342-9)

n are to be placed with General Services Administration,
perintendent of Documents. See section 2 of the general
copies and other documents referenced herein. Price 25

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:36Z
Check the source to verify that this is the current version before use.