
INCH-POUND
W-F-1814/9D
w/AMENDMENT 1
13 December 2023
SUPERSEDING
W-F-1814/9D
15 November 2013

FEDERAL SPECIFICATION SHEET

FUSE, CARTRIDGE, HIGH INTERRUPTING CAPACITY, CLASS J (CURRENT-LIMITING) 600 VOLTS, 201-400 AMPERES

The General Services Administration has authorized the use of this federal specification, by all federal agencies.

The complete requirements for procuring the fuses described herein shall consist of this document and the latest issue in effect of W-F-1814.

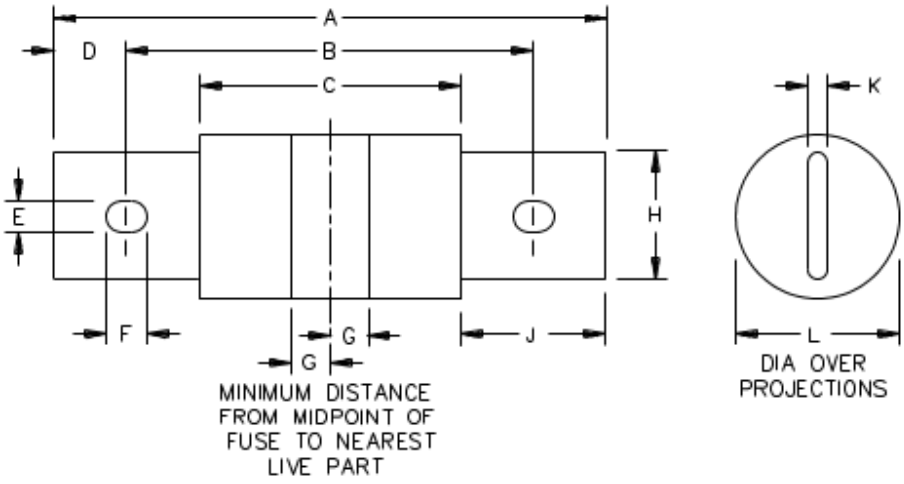

Ltr	Inches		mm		Ltr	Inches		mm	
	Min	Max	Min	Max		Min	Max	Min	Max
A	7.030	7.210	178.56	183.13	G	.500	---	12.70	---
B	5.190	5.300	131.83	76.20	H	1.590	1.660	40.39	42.16
C	3.350	3.410	85.09	86.61	J	1.88 (REF)		47.75 (REF)	
D	.940 (REF)		23.88 (REF)		K	.247	.253	6.27	6.43
E	.401	.411	10.19	10.44	L	---	2.120	---	53.85
F	.530	.590	13.46	14.99					

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±.02 (0.51 mm) for two-place decimals and ±.005 (0.13 mm) for three-place decimals.

FIGURE 1. Configuration and dimensions.

AMSC N/A
FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Physical: Nonrenewable.

Terminals: Knife blade type:

Material: Brass, copper, or copper alloy.

Strength: 20 pound-inches torque between body and knife blades.

Body:

Insulating material: Ceramic, melamine-impregnated glass fiber, or the equivalent.

Electrical:

Voltage: 600 volts or less.

Frequency: 48 Hz to 60 Hz.

Current: See table I.

Current carrying capacity: 100 percent indefinitely with temperature rise not to exceed 75°C above ambient on the ferrules.

Overload interrupt: Shall interrupt within 2 hours at 135 percent of rated current and within 12 minutes at 200 percent of rated current.

Interrupting capacity rating: 200,000 amperes rms symmetrical at 600 volts, 60 Hz and a power factor of 20 percent or less. Closing angle shall be essentially at the zero of the voltage wave (maximum offset) or later, to produce start of arcing within 30 electrical degrees prior to system peak voltage.

Threshold ration: 30 maximum.

Maximum peak let-thru current: See table I.

Maximum clearing I^2T: See table I.

Applicable fuseholders: Class J for blade type fuses in accordance with UL 4248-8.

Part or Identifying Number (PIN): See table I.

TABLE I. Electrical characteristics. 1/

Government PIN	Current rating (amperes)	Maximum peak let-thru current amperes	Maximum clearing $I^2T \times 10^3$
WF1814/09-001	225	22,500	350
WF1814/09-002	250	24,000	450
WF1814/09-003	300	26,000	600
WF1814/09-004	350	29,000	800
WF1814/09-005	400	30,000	1,100

1/ For silver plated terminals, the designator "S" is added after the dash number.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.

Referenced documents. In addition to W-F-1814, this document references the following:

UL 4248-8

Amendment notations. The margins of this specification are marked with vertical line to indicate modifications generated by this amendment. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations.

MILITARY INTEREST:

Custodians:
Army - CR
Navy - EC
Air Force - 85
DLA - CC

Review activities:
Army - AR, AT, CR4
Navy - OS
NSA - NS

CIVIL AGENCY COORDINATING ACTIVITIES:

GSA - FAS

Preparing activity:

DLA - CC

(Project 5920-2024-005)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:35Z
Check the source to verify that this is the current version before use.