MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, MAGNETIC, LOW-POWER UNSEALED, TRIP-FREE, SERIES TRIP, DOUBLE POLE, AUXILIARY CONTACTS (0.2 to 30 AMPERES)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the circuit breakers described herein shall consist of this document and the latest issue of Specification MIL-C-55629.


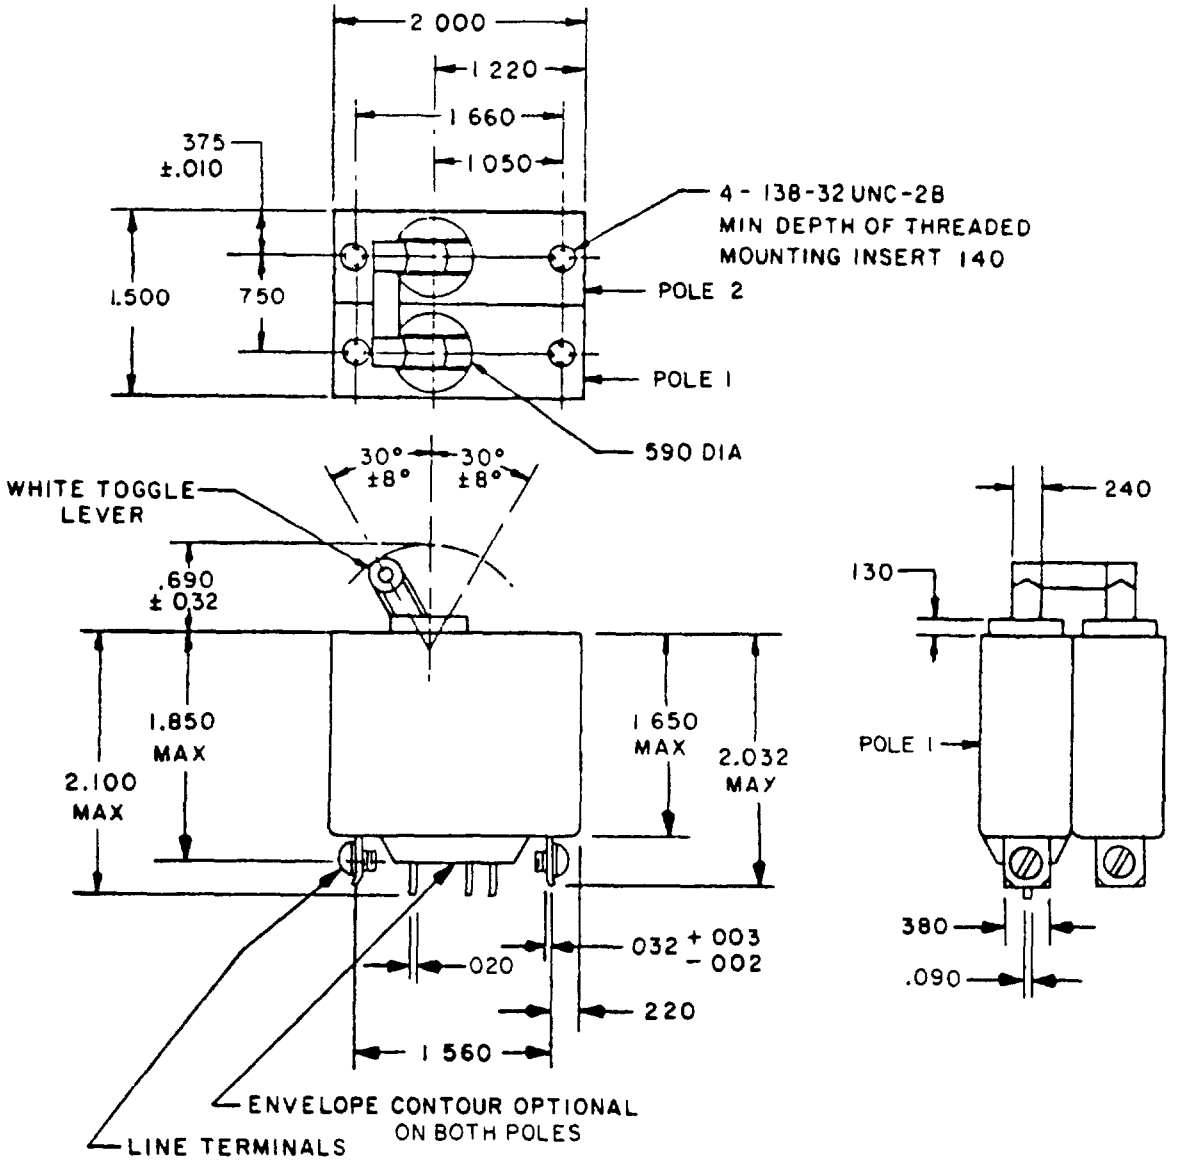



FIGURE 1 Dimensions and configurations

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

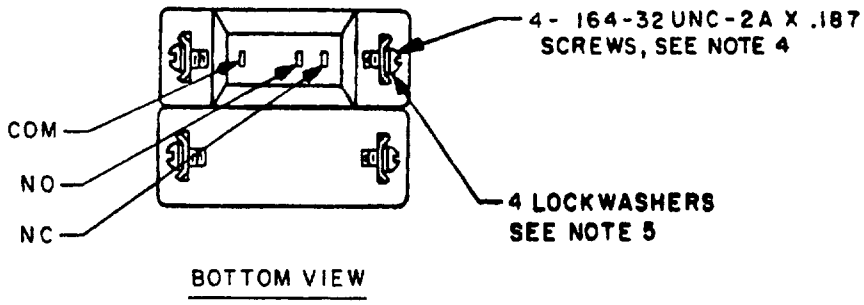

BOTTOM VIEW

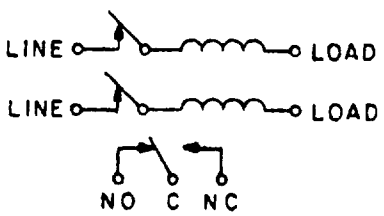

INCHES	MM	INCHES	MM	INCHES	MM	INCHES	MM
.002	.05	.140	3.56	590	14.99	1.650	41.91
.003	08	187	4.75	.690	17.53	1 660	42.16
010	.25	.220	5 59	.750	19.05	1.850	46 99
.020	.51	.240	6.10	1 050	26.67	2.000	50.80
032	.81	.250	6 35	1 220	30 99	2 032	51.61
.090	2 29	375	9.52	1 500	38.10	2 100	53.34
130	3.30	.380	9 65	1 560	39.62		

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerance is ±.031 (0.79 mm).
4. Terminal screw, No. 8, .164-32UNC-2A, .187 ±.015 long, material - brass, tin plated (MIL-T-10727 type I).
5. Lockwasher - split, No. 8 MS35338-137.

FIGURE 1. Dimensions and configurations - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions and configuration: See figure 1.

Current ratings: See table I.

Voltage ratings: See table I. 240 Vac breakers are designed also for use at 120 Vac.

Tripping-time delays: See table II.

Terminal and mounting hardware: See figure 1.

Terminals: See figure 1. Solderability is applicable. Solder terminals are formed by removal of screws.

Auxiliary contact terminals:

Contact capacity shall be 3.0 amperes at 50 Vdc, inductive; 5.0 amperes at 50 Vdc, resistive; and 5.0 amperes at 120 or 240 Vac.

Actuator strength: 25 pounds.

Actuator operating force: 8 pounds, maximum.

Terminal strength:

Applied load: 30 pounds.
Applied force: 10 pound-inches.

Interrupting capacities:

2,000 amperes at 50 volts, dc.
2,000 amperes at 120 volts, ac, 60 Hz.
1,500 amperes at 120 volts, ac, 400 Hz.
1,000 amperes at 240 volts, ac, 60 and 400 Hz.

Part number: M55629/10-(dash number from table I).

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE I. Circuit breaker dash numbers and applicable characteristics.

Dash No.	Current rating (amperes)	Voltage rating	Tripping-time delay	Resistance or impedance ohms (max)	Dash No.	Current rating (amperes)	Voltage rating	Tripping-time delay	Resistance or impedance ohms (max)
001	0.2	50 Vdc	A	32	059	7.0	240 Vac, 60 Hz	C	.04
002	0.2	50 Vdc	B	32	060	7.0	240 Vac, 60 Hz	D	.04
003	0.2	240 Vac,60 Hz	C	34	061	7.0	240 Vac,400 Hz	E	.07
004	0.2	240 Vac,60 Hz	D	34	062	7.0	240 Vac,400 Hz	F	.07
005	0.2	240 Vac,400 Hz	E	72	063	7.0	240 Vac, 400 Hz	G	.07
006	0.2	240 Vac,400 Hz	F	72	064	8.0	50 Vdc	A	.03
007	0.2	240 Vac,400 Hz	G	72	065	8.0	50 Vdc	B	.03
008	0.5	50 Vdc	A	6	066	8.0	240 Vac, 60 Hz	C	.03
009	0.5	50 Vdc	B	6	067	8.0	240 Vac, 60 Hz	D	.03
010	0.5	240 Vac,60 Hz	C	6	068	8.0	240 Vac, 400 Hz	E	.06
011	0.5	240 Vac,60 Hz	D	6	069	8.0	240 Vac, 400 Hz	F	.06
012	0.5	240 Vac,400 Hz	E	12	070	8.0	240 Vac, 400 Hz	G	.06
013	0.5	240 Vac,400 Hz	F	12	071	9.0	50 Vdc	A	.018
014	0.5	240 Vac,400 Hz	G	12	072	9.0	50 Vdc	B	.018
015	1.0	50 Vdc	A	2	073	9.0	240 Vac, 60 Hz	C	.02
016	1.0	50 Vdc	B	2	074	9.0	240 Vac, 60 Hz	D	.02
017	1.0	240 Vac, 60 Hz	C	2	075	9.0	240 Vac,400 Hz	E	.05
018	1.0	240 Vac, 60 Hz	D	2	076	9.0	240 Vac,400 Hz	F	.05
019	1.0	240 Vac,400 Hz	E	4	077	9.0	240 Vac,400 Hz	G	.05
020	1.0	240 Vac,400 Hz	F	4	078	10.0	50 Vdc	A	.02
021	1.0	240 Vac,400 Hz	G	4	079	10.0	50 Vdc	B	.02
022	2.0	50 Vdc	A	.5	080	10.0	240 Vac, 60 Hz	C	.02
023	2.0	50 Vdc	B	.5	081	10.0	240 Vac, 60 Hz	D	.02
024	2.0	240 Vac, 60 Hz	C	.5	082	10.0	240 Vac, 400 Hz	E	.04
025	2.0	240 Vac, 60 Hz	D	.5	083	10.0	240 Vac, 400 Hz	F	.04
026	2.0	240 Vac,400 Hz	E	.8	084	10.0	240 Vac, 400 Hz	G	.04
027	2.0	240 Vac,400 Hz	F	.8	085	12.5	50 Vdc	A	.013
028	2.0	240 Vac,400 Hz	G	.8	086	12.5	50 Vdc	B	.013
029	3.0	50 Vdc	A	.3	087	12.5	240 Vac, 60 Hz	C	.015
030	3.0	50 Vdc	B	.3	088	12.5	240 Vac, 60 Hz	D	.015
031	3.0	240 Vac, 60 Hz	C	.3	089	12.5	240 Vac, 400 Hz	E	.03
032	3.0	240 Vac, 60 Hz	D	.3	090	12.5	240 Vac, 400 Hz	F	.03
033	3.0	240 Vac,400 Hz	E	.5	091	12.5	240 Vac, 400 Hz	G	.03
034	3.0	240 Vac,400 Hz	F	.5	092	15.0	50 Vdc	A	.01
035	3.0	240 Vac,400 Hz	G	.5	093	15.0	50 Vdc	B	.01
036	4.0	50 Vdc	A	.1	094	15.0	240 Vac, 60 Hz	C	.011
037	4.0	50 Vdc	B	.1	095	15.0	240 Vac, 60 Hz	D	.011
038	4.0	240 Vac, 60 Hz	C	.1	096	15.0	240 Vac,400 Hz	E	.02
039	4.0	240 Vac, 60 Hz	D	.1	097	15.0	240 Vac,400 Hz	F	.02
040	4.0	240 Vac,400 Hz	E	.3	098	15.0	240 Vac,400 Hz	G	.02
041	4.0	240 Vac,400 Hz	F	.3	099	20.0	50 Vdc	A	.02
042	4.0	240 Vac,400 Hz	G	.3	100	20.0	50 Vdc	B	.02.
043	5.0	50 Vdc	A	.08	101	20.0	240 Vac, 60 Hz	C	.007
044	5.0	50 Vdc	B	.08	102	20.0	240 Vac, 60 Hz	D	.007
045	5.0	240 Vac, 60 Hz	C	.08	103	20.0	240 Vac,400 Hz	E	.01
046	5.0	240 Vac, 60 Hz	D	.08	104	20.0	240 Vac,400 Hz	F	.01
047	5.0	240 Vac,400 Hz	E	.15	105	20.0	240 Vac,400 Hz	G	.01
048	5.0	240 Vac,400 Hz	F	.15	106	25.0	50 Vdc	A	.006
049	5.0	240 Vac,400 Hz	G	.15	107	25.0	50 Vdc	B	.006
050	6.0	50 Vdc	A	.06	108	25.0	240 Vac, 60 Hz	C	.006
051	6.0	50 Vdc	B	.06	109	25.0	240 Vac, 60 Hz	D	.006
052	6.0	240 Vac, 60 Hz	C	.06	110	25.0	240 Vac,400 Hz	E	.007
053	6.0	240 Vac, 60 Hz	D	.06	111	25.0	240 Vac,400 Hz	F	.007
054	6.0	240 Vac,400 Hz	E	.08	112	25.0	240 Vac,400 Hz	G	.007
055	6.0	240 Vac,400 Hz	F	.08	113	30.0	50 Vdc	A	.005
056	6.0	240 Vac,400 Hz	G	.08	114	30.0	50 Vdc	B	.005
057	7.0	50 Vdc	A	.04	115	30.0	240 Vac, 60 Hz	C	.005
058	7.0	50 Vdc	B	.04	116	30.0	240 Vac, 60 Hz	D	.005
					117	30.0	240 Vac, 400 Hz	E	.006
					118	30.0	240 Vac, 400 Hz	F	.006
					119	30.0	240 Vac, 400 Hz	G	.006

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE II. Tripping-time delay. 1/

Tripping-time delay at 25° ±2°C (tripping time in seconds)														
Time delay percent rated current	DC				60 Hz				400 Hz					
	A		B		C		D		E		F		G	
	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min
100	no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour	
125	70	7	7	.5	120	10	17	.7	---	---	---	---	---	---
150	---	---	---	---	---	---	---	---	60	5	5.8	.50	400	40
200	8	.6	1.4	.13	20	2.2	1 6	.13	20	2.1	1.9	.15	150	9.5
400	1.5	.15	.25	.031	2.3	.3	.25	.03	3.2	.4	.19	.02	19	1.9
600	.05	Inst	.12	Inst	.75	Inst	.13	Inst	.19	Inst	.08	Inst	1.6	Inst
800	.051	Inst	.051	Inst	.16	Inst	.07	Inst	.06	Inst	.05	Inst	.06	Inst
1,000	.026	Inst	.026	Inst	.04	Inst	.04	Inst	.045	Inst	.036	Inst	.043	Inst

	Tripping-time delay at high and low temperature ±2°C (tripping time in seconds)													
Time delay percent rated current	DC				60 Hz				400 Hz					
	A		B		C		D		E		F		G	
	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min
100	no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour	
125	500	.5	100	.1	500	1	100	.1	---	---	---	---	---	---
150	---	---	---	---	---	---	---	---	500	.5	100	.1	1500	5
200	100	.1	10	.05	100	.05	10	.05	100	.1	10	.05	500	.5
400	20	Inst	3	Inst	20	Inst	3	Inst	20	Inst	3	Inst	100	Inst
600	5	Inst	1	Inst	5	Inst	1	Inst	5	Inst	1	Inst	5	Inst
800	2	Inst	.5	Inst	.5	Inst	.5	Inst	.5	Inst	.5	Inst	.5	Inst

1/ Circuit breakers shall not trip at 100 percent rated current. Delays A, B, C, and D must trip at 125 percent of rated current and delays E, F, and G must trip at 150 percent of rated current. Between 100 percent and 125 or 150 percent, they may trip. Instantaneous is defined as less than 15 milliseconds.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE III. Supersession and substitution data.

Circuit breakers covered by this specification sheet are substitutable for the manufacturer's part numbers as shown below. This information in no way implies that the manufacturer's part number is substitutable for the military part number.

Superseding military part number	Superseded manufacturers part number	
	FSCM 81541	FSCM 74193
	Type APGH-66 UPGH-66	Type JA2
M55629/10-XXX	The complete part number consists of the type (above) plus identification codes for ccomparable internal connections, auxiliary switch, voltage, frequency, time delay, and current rating. UL recognition and moisture fungus proofing is also superseded by the military circuit breakers.	

NOTE: Revision letters are not used to denote changes due to the extensiveness of the changes.

Custodians:
Army - ER
Navy - EC
Air Force - 85

Review activities:
Army - ME
Navy - OS, AS
Air Force - 17, 99
DLA - ES

User activities:
Army - AV, MI
Navy - MC, SH
Air Force - 19

Agent:
DLA - ES

Preparing activity:
Army - ER

(Project 5925-0158-4)

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.