MILITARY SPECIFICATION

CIRCUIT BREAKERS (AUTOMATIC - ALB-1) AND SWITCH, TOGGLE (CIRCUIT BREAKER, NON-AUTOMATIC - NLB-1) AIR, INSULATED HOUSING, 125 VOLTS AND BELOW, A.C. AND D.C., (NAVAL SHIPBOARD USE)

This amendment forms a part of MIL-C-17588E(SH), dated 26 November 1985, and is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

PAGE 7

3.5.2, Table IV under Time - seconds: Delete "0.028" and substitute "0.400".

PAGE 11

Table VI: Delete and substitute:

"TABLE VI. Sampling for quality conformance inspection.

Number of items in lot offered for inspection	Number of items in sample
8 and under	2
9 - 15	3
16 - 25	5
26 - 40	8
41 - 65	13
66 - 110	20
111 - 180	25
181 - 300	30
301 - 500	40
Over 501	50

"

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

PAGE 11

4.7.3: Delete and substitute:

"4.7.3 Quality conformance production shock testing. Five units of each ampere rating produced during a month shall be selected at random and subjected to production shock testing. If more than 2 ampere ratings are produced during a month, the total number of circuit breakers shocked may be limited to 10 units which will be divided equitably among the production lots."

PAGE 12

4.7.3.1: Delete and substitute:

"4.7.3.1 Test periods shall begin with the first production run circuit breaker. Circuit breakers produced during the time period (month) shall be tested during that month. The manufacturer shall conduct the shock tests on the sample circuit breakers and file the data as production shock test records. Several circuit breakers of different ampere ratings may be tested simultaneously during the same month; for example, the mounting plate may be modified to accommodate one circuit breaker of each ampere rating, and any multiple of one-to-ten circuit breakers of different ampere ratings may be tested simultaneously. The following tests shall apply:

(a) The circuit breaker shall be tested in the closed position.
(b) The circuit breaker shall be tested when mounted in its vertical and closed position and no load voltage is necessary.
(c) The circuit breaker shall be subjected to one hammer blow of a 3-foot drop from each direction--top, back, and side."

PAGE 14

4.8.4.2, line 3 and 4: Delete "The maximum current value test shall be performed followed after a cooling period of at least 15 minutes, by the minimum current value test."


PAGE 24

* Figure 1: Delete and substitute attached figure.

PAGE 26

* Figure 1: Delete and substitute attached figure.

Source: https://assist.dla.mil --Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

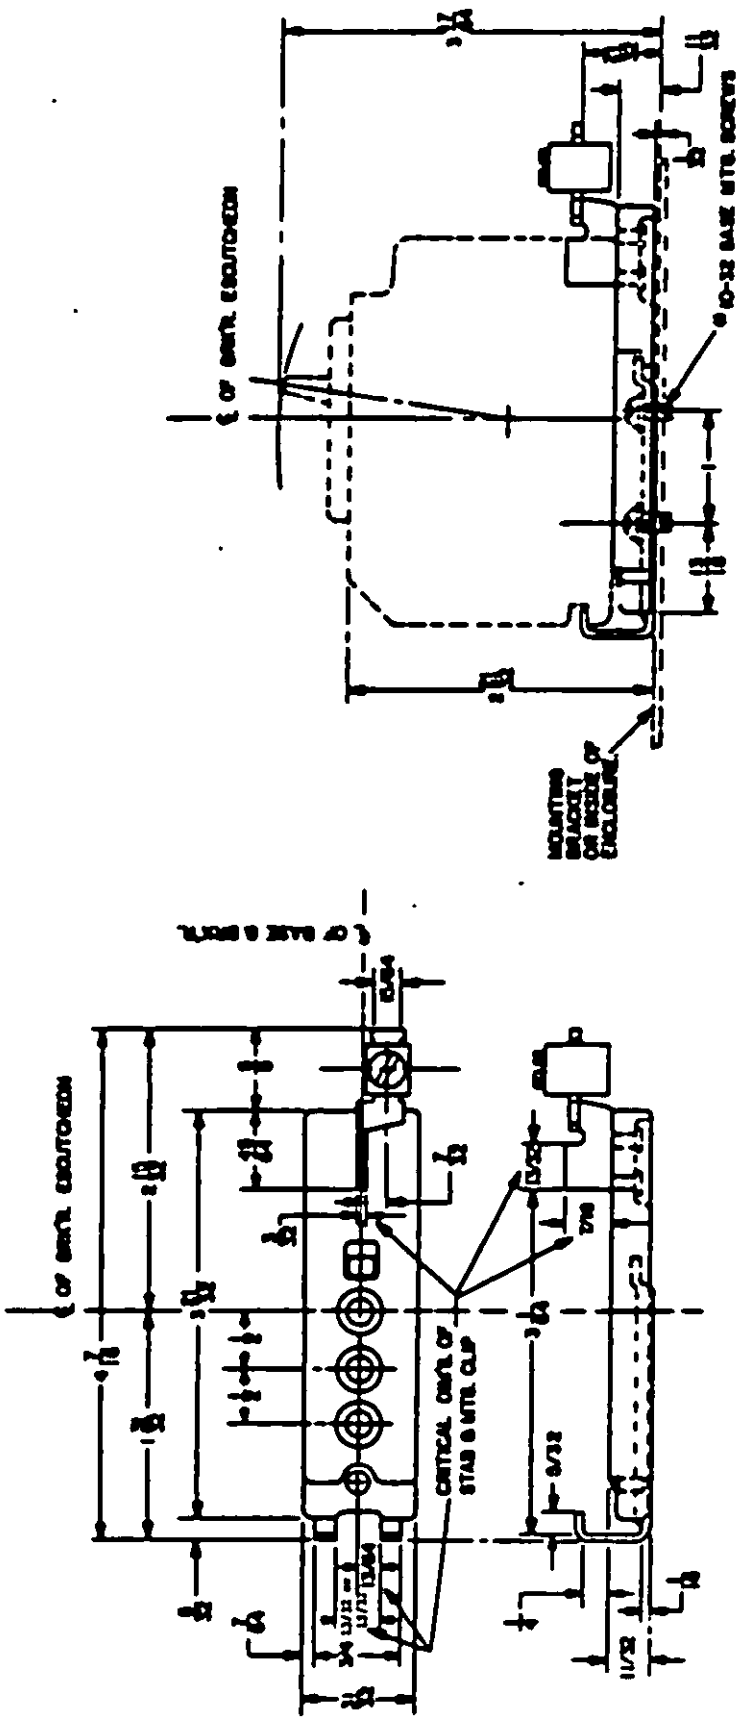

SH 10591

1B. Outline dimensions for mounting bases for one circuit breakers.


FIGURE 1. Type ALB-1 thermal-magnetic, enclosed, trip free (single pole) and type NLB-1, switch, toggle (nonautomatic). - Continued

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

NOTE: The margins of this amendment are marked with an asterisk to indicate where changes (additions, modifications, corrections, deletions) from the previous amendment were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous amendment.

Preparing activity:
Navy - SH
(Project 5925-N119)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

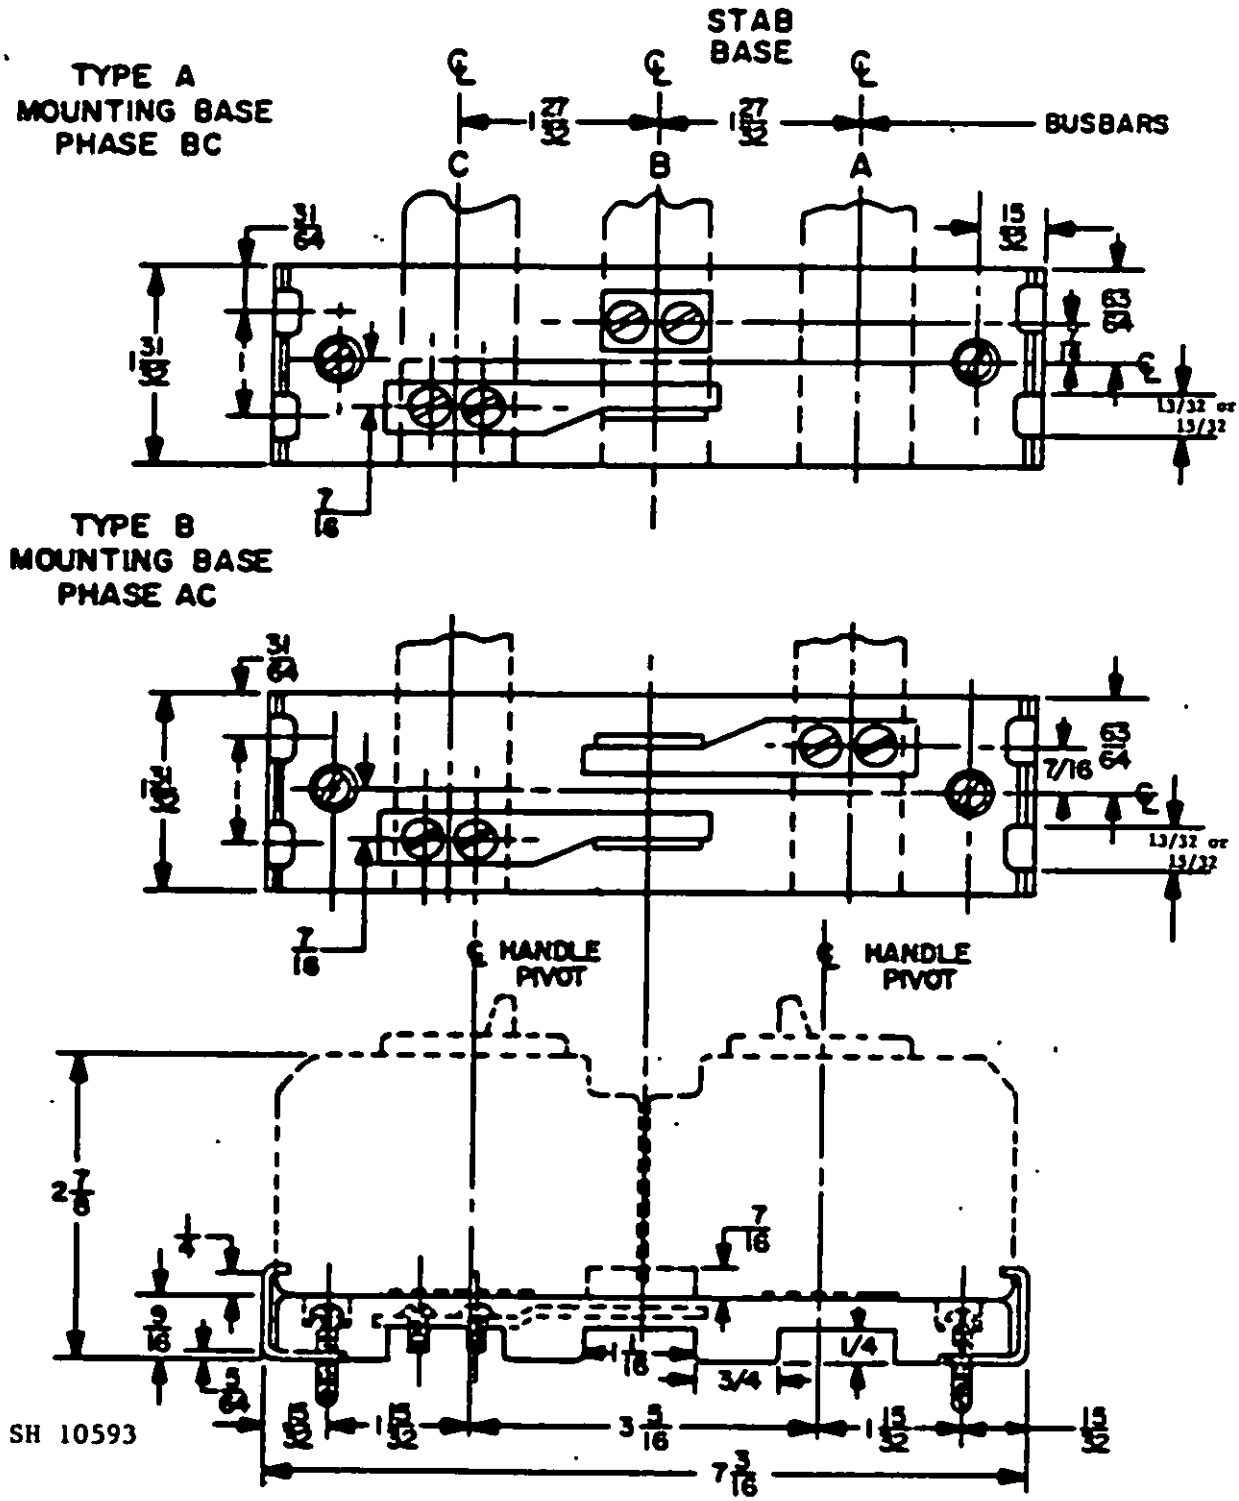

1D. Outline dimensions for mounting bases for circuit breakers.

FIGURE 1. Type ALB-1, thermal-magnetic, enclosed, trip free (single pole) and type NLB-1, switch, toggle (nonautomatic). - Continued

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document*(s)* or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE NAVY

COMMANDER
NAVAL SEA SYSTEMS COMMAND (SEA 5523)
DEPARTMENT OF THE NAVY
WASHINGTON, DC 20362-5101

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATES

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 12503 WASHINGTON D. C.

POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE NAVY

COMMANDER
NAVAL SEA SYSTEMS COMMAND (SEA 5523)
DEPARTMENT OF THE NAVY
WASHINGTON, DC 20362-5101

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR ☐ USER ☐ MANUFACTURER ☐ OTHER *(Specify)*: _____
b. ADDRESS *(Street, City, State, ZIP Code)*	

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

(TO DETACH THIS FORM, CUT ALONG THIS LINE.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.