INCH-POUND

MIL-DTL-17587/5(SH)
28 June 2007

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, ACB, LOW VOLTAGE, ELECTRIC POWER, AIR, REMOVABLE CONSTRUCTION ACB-3200HR

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17587.

LIST OF TABLES

TABLE I. Ratings/features of circuit breakers. 2
TABLE II. Available continuous current ratings and pickup current settings for overcurrent coils and sensors. 3
TABLE III. Electrical endurance and temperature rise test requirements. 4

LIST OF FIGURES

FIGURE 1. Outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 1). 5
FIGURE 2. Cradle outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 1). 6
FIGURE 3. Time current characteristic curve for circuit breaker type ACB-3200HR (PIN 2). 7
FIGURE 4. Outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 2). 8
FIGURE 5. Time current characteristic curve for circuit breaker type ACB-3200HR (PIN 1). 9

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

TABLE I. Ratings/features of circuit breakers.

Circuit breaker type	**ACB-3200HR (PIN 1)**	**ACB-3200HR (PIN 2)**
Rated continuous current (amperes)	3200	3200
Rated maximum voltage (AC volts) /1	500	500
Frequency (hertz)	60	60
Maximum interrupting rating current (symmetrical amperes)	85,000	85,000
Rated short-time current /2 (amperes)	85,000	85,000
Rated short time current duration (seconds)	0.75	0.75
Operating mechanism – manual	STD	STD
Operating mechanism – electric	STD	STD
Maximum weight (lbs) – circuit breaker (removable component)	691	658
Maximum weight (lbs) – cradle (stationary component)	481	495
Number of poles	3	3
Number of overcurrent coils or solid-state sensors	2	3
Attachments		
Electric closing mechanism	STD	STD
Auxiliary switches (number of contacts)	8	10
Undervoltage lockout device	STD	STD
Mechanical position indicator	STD	STD
Secondary disconnecting devices	STD	STD
Cell switch	STD	STD
Indicator light	STD	OPT
Hold-closed mechanism	STD	OPT
Undervoltage release device	STD	OPT
Shunt trip device	STD	STD
Operations counter	STD	STD
Trip on power up (TOPU) device	N/A	N/A
Rack-in/rack-out position indicator	STD	STD

NOTES:

/1 Voltage ratings apply to main current-carrying parts. Operating attachments shall be of voltages specified in 6.2 of MIL-DTL-17587.

/2 Ampere values apply to circuit breakers with overcurrent coils or sensors of maximum current rating within the circuit breaker type.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

TABLE II. Available continuous current ratings and pickup current settings for overcurrent coils and sensors.

Type	Coil or sensor rating /1 (amperes)	Long-time pickup setting (amperes)			Short-time pickup setting (amperes)						Maximum instantaneous trip /2 (amperes)
ACB-3200HR (PIN 1)	2000	3200	4000	4800		4000	4800	6000	8000		68000
	2400	3600	4800	6000		4800	6000	8000	----		68000
	2800	4200	5600	6600		5600	7000	8400	----		68000
	3200	4800	6400	8000		6400	7000	8000	9600		68000
ACB-3200HR (PIN 2)	2000	3000	4000	5000	4000	5000	6000	8000	10000		80000
	2400	3600	4800	6000	4800	6000	7200	9600	12000		80000
	2800	4200	5600	7000	5600	7000	8400	11200	14000		80000
	3200	4800	6400	8000	6400	8000	9600	12800	16000		80000

NOTES:

/1 Continuous current rating.

/2 The instantaneous trip device shall be set at the place of manufacture from five times the coil or sensor rating to the maximum pickup setting specified for mechanical coils and 20 times sensor rating for solid-state sensors with a default at maximum listed rating.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

TABLE III. Electrical endurance and temperature rise test requirements.

Electrical endurance test:

Type	Total number of close-open cycles	Amperes on circuit breaker close	Amperes on circuit breaker open	Maximum AC power factor (lagging) X/R
ACB-3200HR (PIN 1)	1,000	3,200	3,200	0.8
ACB-3200HR (PIN 2)	1,000	3,200	3,200	0.8

Temperature rise test:

Type	Continuous current rating	Cable quantity per terminal /1	Cable size	Bus bar quantity per phase	Bus bar size (inches) /2
ACB-3200HR (PIN 1)	3,200	8	400 MCM	2	6.0 x ¼
ACB-3200HR (PIN 2)	3,200	8	400 MCM	2	6.0 x ¼

NOTES:

/1 Information regarding cable is contained in MIL-DTL-915. If 3-phase cable is used for this test, the cable jacket shall be stripped for a minimum of 2 feet.

/2 Information regarding bus bars is contained in MIL-DTL-16036.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

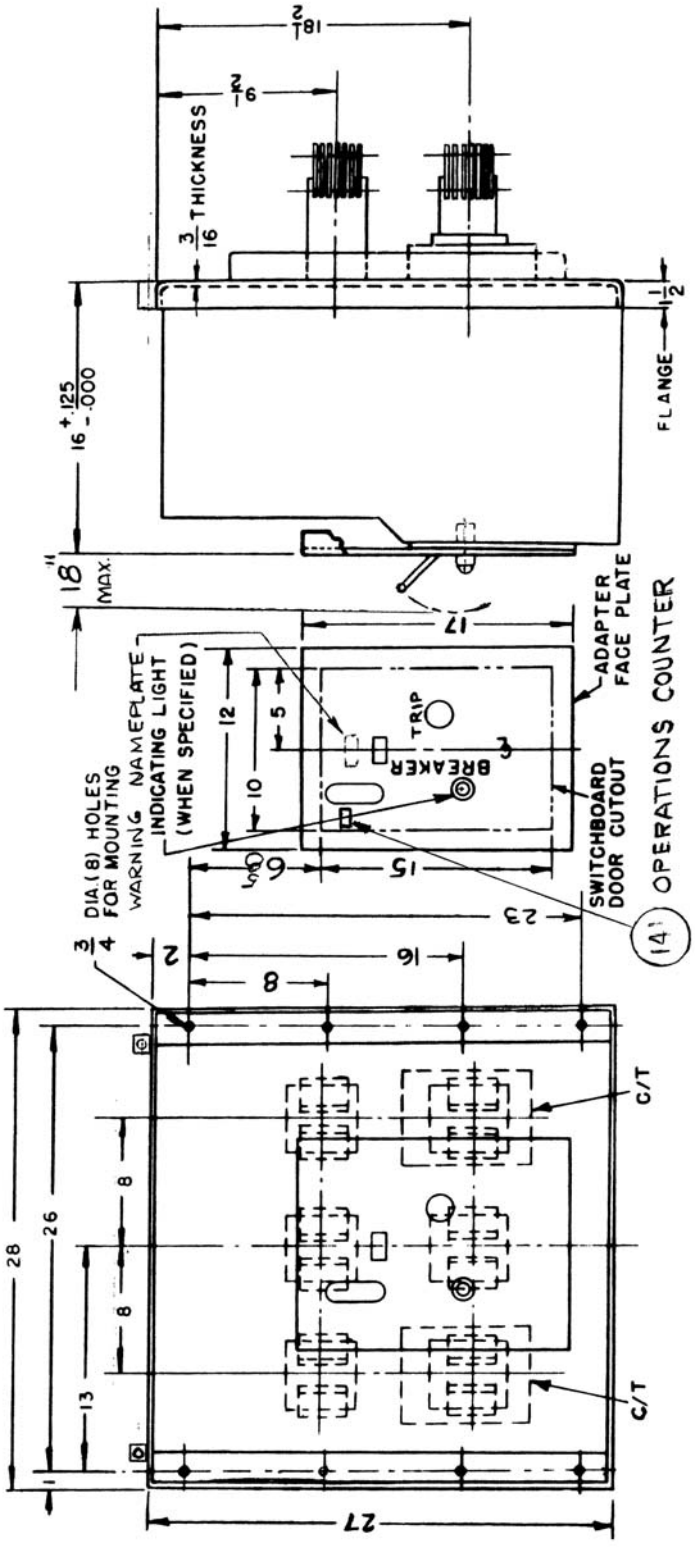


FIGURE 1. Outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

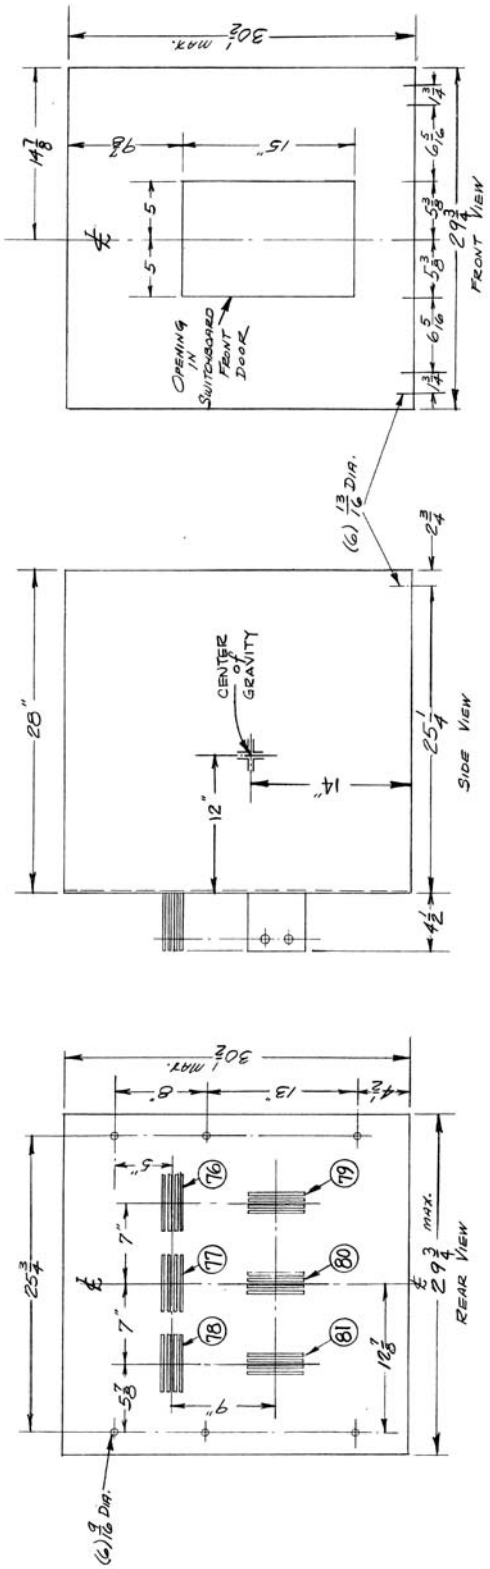


FIGURE 2. Cradle outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

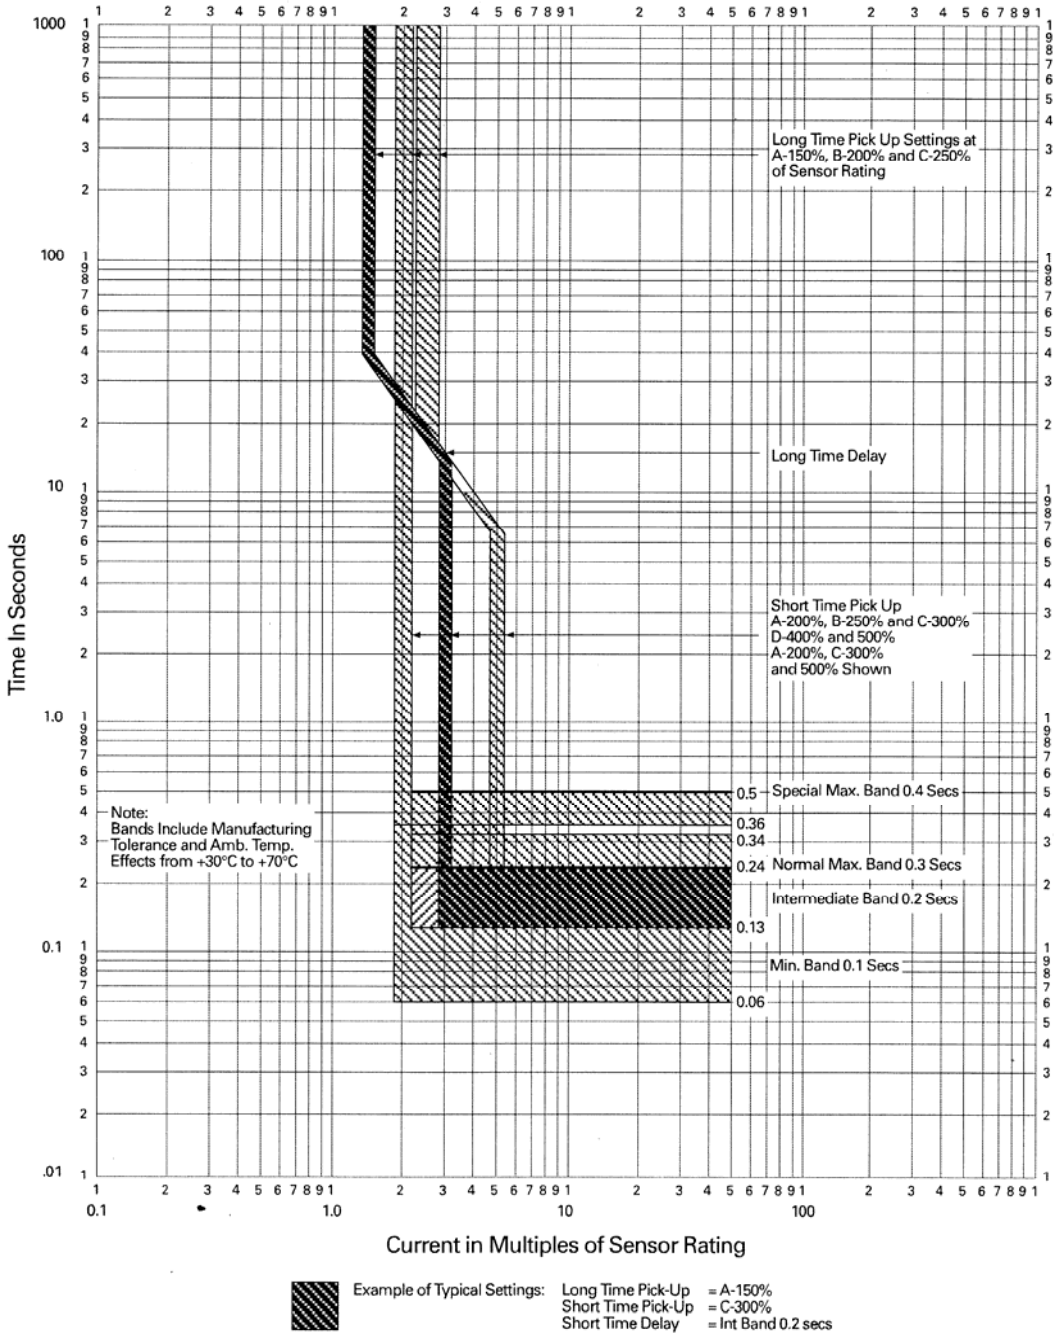


FIGURE 3. Time current characteristic curve for circuit breaker type ACB-3200HR (PIN 2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

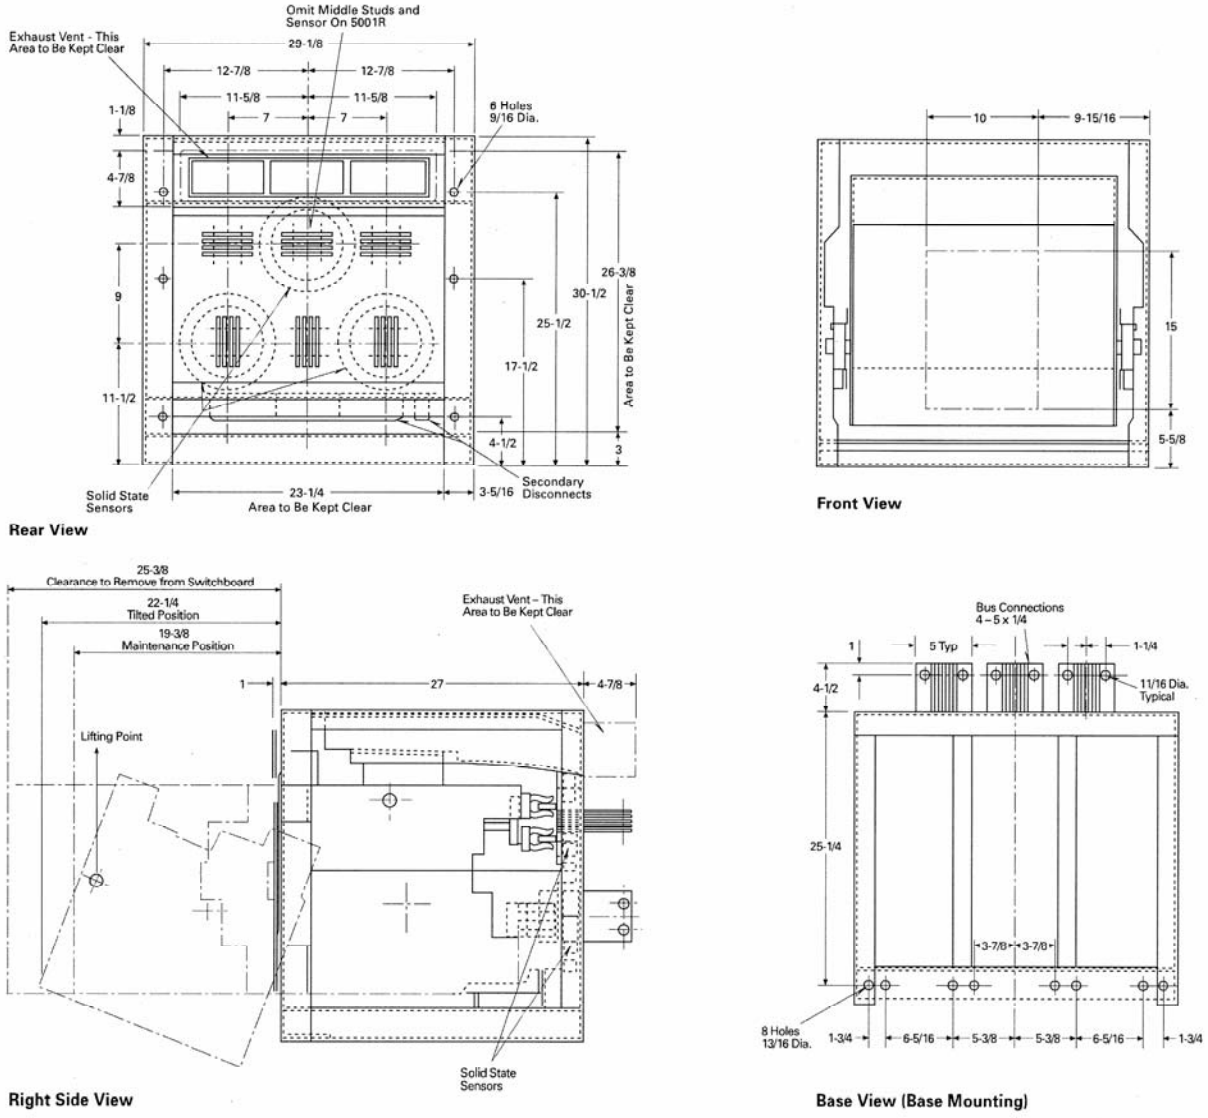


FIGURE 4. Outline and mounting dimensions for circuit breaker type ACB-3200HR (PIN 2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

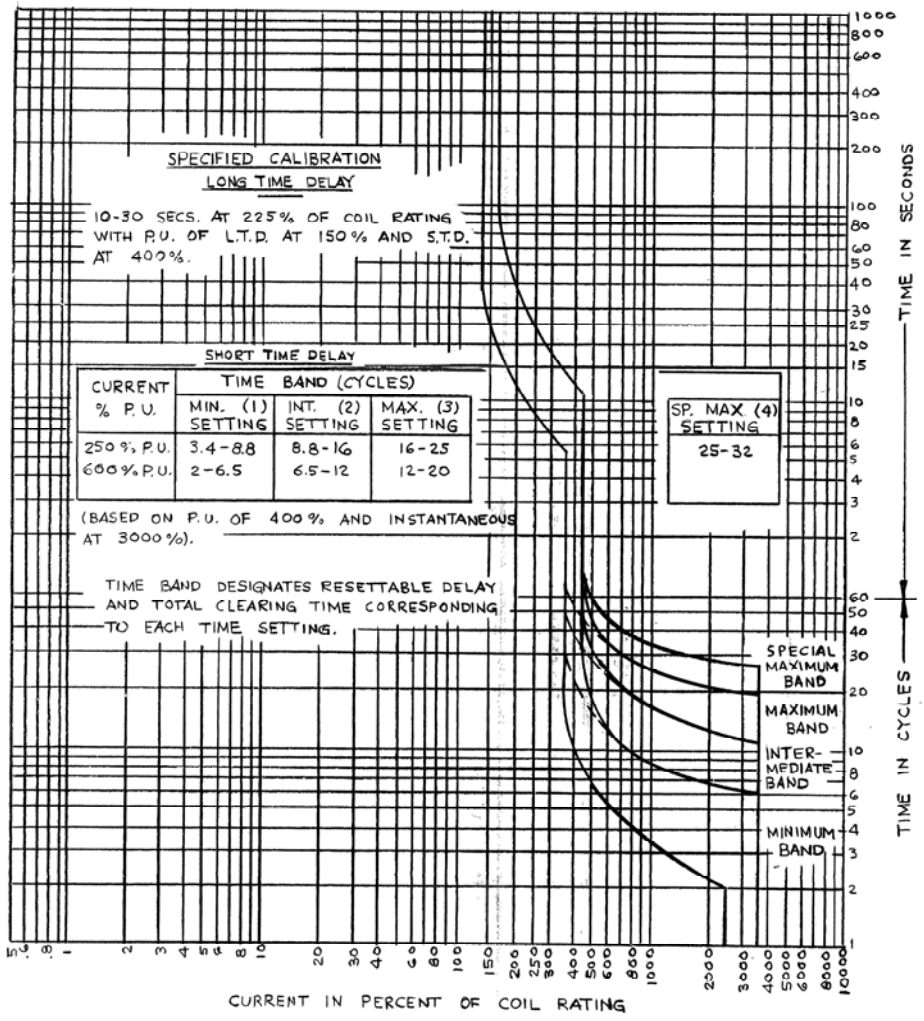


FIGURE 5. Time current characteristic curve for circuit breaker type ACB-3200HR (PIN 1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

Preparing Activity
Navy – SH
(Project 5925-N184-005)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.