INCH-POUND

MIL-DTL-17587/7(SH)
28 June 2007

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, ACB, LOW VOLTAGE, ELECTRIC POWER, AIR, REMOVABLE CONSTRUCTION ACB-6400HR

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17587.

LIST OF TABLES

TABLE I. Ratings/features of circuit breakers. 2
TABLE II. Available continuous current ratings and pickup current settings for overcurrent coils and sensors. 3
TABLE III. Electrical endurance and temperature rise test requirements. 3

LIST OF FIGURES

FIGURE 1. Outline and mounting dimensions for circuit breaker type ACB-6400HR. 4
FIGURE 2. Time-current characteristic curve for circuit breaker type ACB-6400HR. 5

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

TABLE I. Ratings/features of circuit breakers.

Circuit breaker type	**ACB-6400HR**
Rated continuous current (amperes)	6400
Rated maximum voltage (AC volts) /1	500
Frequency (hertz)	60
Maximum interrupting rating current (symmetrical amperes)	100,000
Rated short-time current /2 (amperes)	100,000
Rated short-time current (duration) (seconds)	0.75
Operating mechanism – manual	STD
Operating mechanism – electric	STD
Maximum weight (lbs) – circuit breaker (removable component)	1500
Maximum weight (lbs) – cradle (stationary component)	515
Number of poles	3
Number of overcurrent coils or solid-state sensors	3
Attachments	
Electric closing mechanism	STD
Auxiliary switches (number of contacts)	12
Undervoltage lockout device	STD
Mechanical position indicator	STD
Secondary disconnecting devices	STD
Cell switch	STD
Indicator light	STD
Hold-closed mechanism	STD
Undervoltage release device	STD
Shunt trip device	STD
Operations counter	STD
Trip on power up (TOPU) device	N/A
Rack-in/rack-out position indicator	STD

NOTES:

/1 Voltage ratings apply to main current-carrying parts. Operating attachments shall be of voltages specified in 6.2.

/2 Ampere values apply to circuit breakers with overcurrent coils or sensors of maximum current rating within the circuit breaker type.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

TABLE II. Available continuous current ratings and pickup current settings for overcurrent coils and sensors.

Type	Coil or sensor rating /1 (amperes)	Long-time pickup setting (amperes)			Short-time pickup setting (amperes)				Maximum instantaneous trip /2 (amperes)
ACB-6400HR	4800	7200	9600	12000	9600	14400	19200	24000	72000
	5800	8700	11600	14500	11600	17400	23200	29000	80000
	6400	9600	12800	16000	12800	19200	25600	32000	80000

NOTES:

/1 Continuous current rating.

/2 The instantaneous trip device shall be set at the place of manufacture from five times the coil or sensor rating to the maximum pickup setting specified for mechanical coils and 20 times sensor rating for solid-state sensors with a default at maximum listed rating.

TABLE III. Electrical endurance and temperature rise test requirements.

Electrical endurance test:

Type	Total number of close-open cycles	Amperes on circuit breaker close	Amperes on circuit breaker open	Maximum AC power factor (lagging) X/R
ACB-6400HR	1,000	6,400	6,400	0.8

Temperature rise test:

Type	Continuous current rating	Cable quantity per terminal /1	Cable size	Bus bar quantity per phase	Bus bar size (inches) /2
ACB-6400HR	6,400	16 /3	400 MCM	4	7.0 x ¼

NOTES:

/1 Information regarding cable is contained in MIL-DTL-915. If 3-phase cable is used for this test, the cable jacket shall be stripped for a minimum of 2 feet.

/2 Information regarding bus bars is contained in MIL-DTL-16036.

/3 Connect with bus adapter of minimum length possible.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

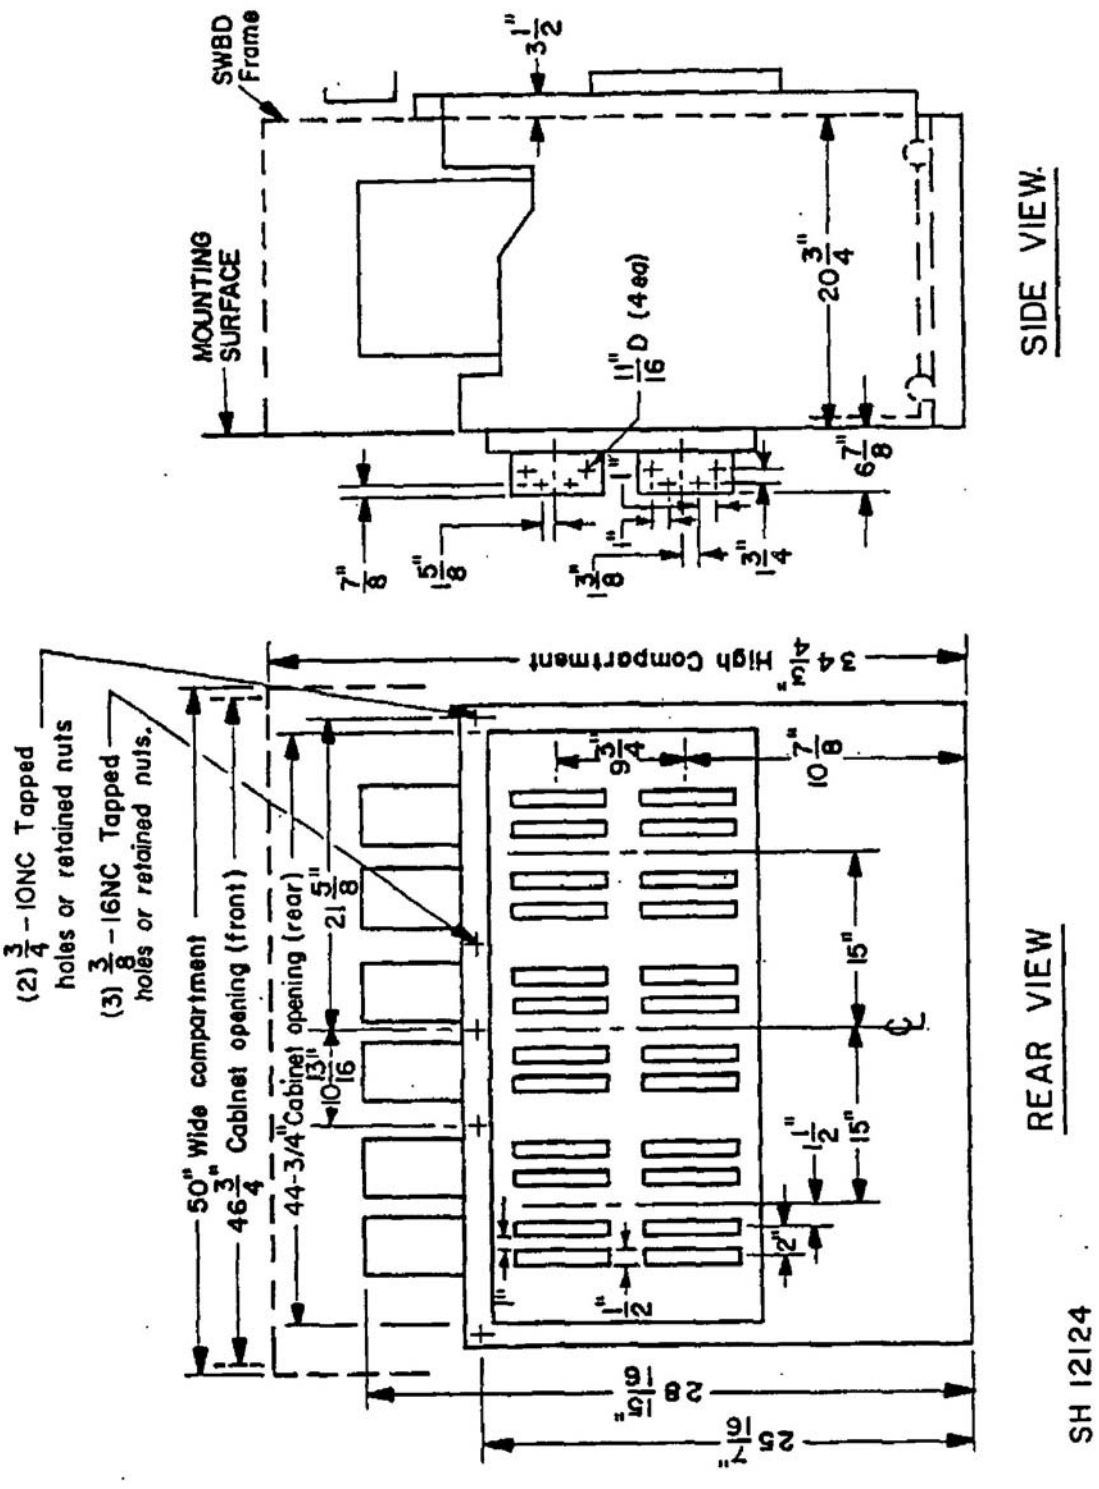


FIGURE 1. Outline and mounting dimensions for circuit breaker type ACB-6400HR.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

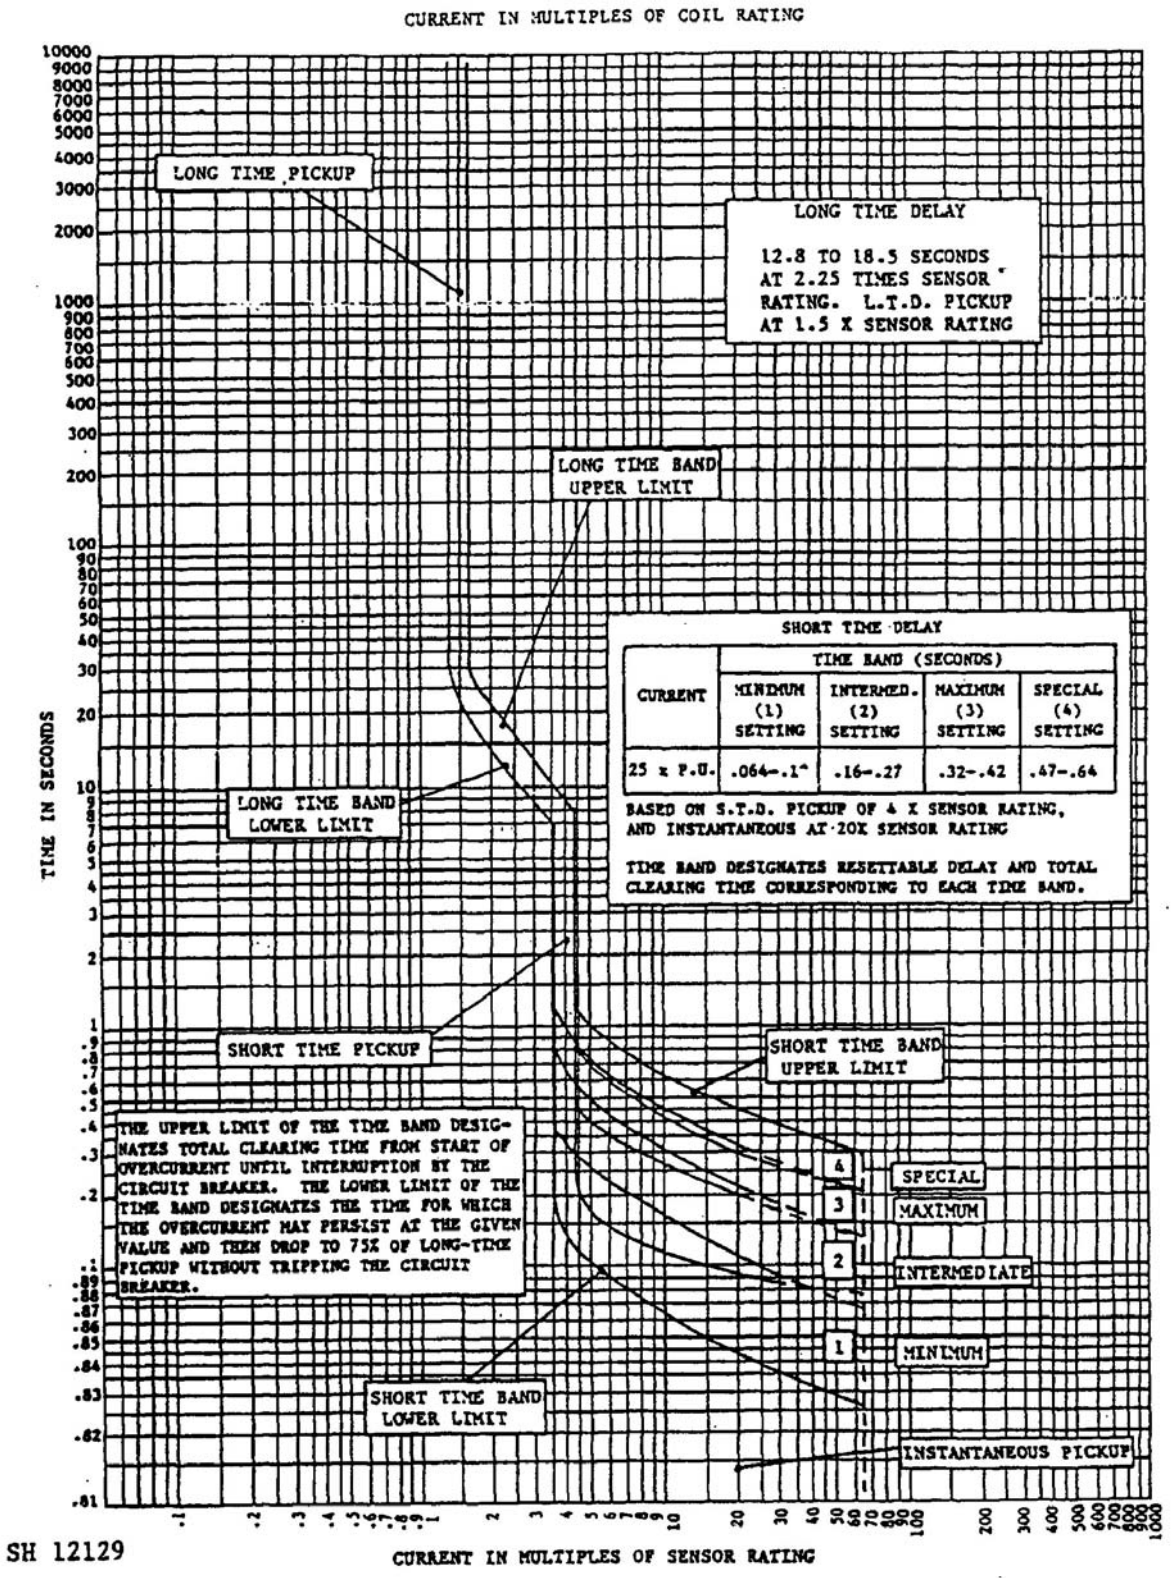


FIGURE 2. Time-current characteristic curve for circuit breaker type ACB-6400HR.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.

Preparing Activity:
Navy – SH
(Project 5925-N184-007)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:21Z
Check the source to verify that this is the current version before use.