INCH-POUND
MIL-S-24686A(SH)
19 May 1992
SUPERSEDING
MIL-S-24686(SH)
4 December 1987
(See 6.6)

MILITARY SPECIFICATION

SPRINKLER, AUTOMATIC, QUICK RESPONSE

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

1.1 SCOPE

1.1 scope. This specification covers automatic, thermo sefisitive, quick response (QR) sprinklers installed in overhead sprinkler systems for shipboard firefighting service. Sprinklers meeting this specification are suitable for use in seawater piping systems.

1.2 Classification. Sprinklers shall be of the frangible bulb type in pendant, upright, or horizontal sidewall configuration as defined in ANSI/UL 199.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications, standards, and handbooks. The following specifications, standards, and handbooks form a part of this document to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation (see 6.2).

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commander, Naval Sea Systems Command, SEA 55Z3, Department of the Navy, Washington, DC 20362-5101 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4210

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

SPECIFICATIONS

FEDERAL

Q-C-390	Copper Alloy Castings (Including Cast Bar) .
QQ-N-286	Nickel-Copper-Aluminum Alloy, Wrought (UNS N05500).

MILITARY

MIL-F-1183	Fitting, Pipe, Cast Bronze, Silver Brazing, General Specification for.
MIL-P-116	Presentation, Methods of.
MIL-S-196	Support Items, Accessories, and Kits, Mechanical; Packaging of.
MIL-R-83248	Rubber Fluorocarbon Elastomer, High Temperature, Fluid, and Compression Set Resistant.
MIL-S-901	Shock Tests, H.I. (High Impact); Shipboard Machinery, Equipment and Systems, Requirements for Navy.

STANDARDS

MILITARY

MIL-STD-167-1 -	Mechanical Vibrations of Shipboard Equipment (Type I - Environmental and Type II - Internally Excited).

(Unless otherwise indicated, copies of federal and military specifications, standards , and handbooks are available from the Standardization Documents Order Desk, BLDG. 4D, 700 Robbins Avenue, Philadelphia , PA 19111-5094.)

2.2 Non-Government publications. The following document(s) form a part of this document to the extent specified herein. Unless otherwise specified, the issues of the documents which are DOD adopted are those listed in the issue of the DODISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents cited in the solicitation (see 6.2).

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

B1.20.1 -	Pipe Threads, General Purpose (Inch). (DoD adopted)
B46 .1	Surface Texture (Surface Roughness, Waviness and Lay) . (DoD adopted)
ANSI/UL 199 -	Automatic Sprinklers for Fire Protection Service.

(Application for copies should be addressed to the American National Standards Institute, 1430 Broadway, New York, NY 10018.)

AMERICAN SOCIETY FOR TESTING AND MATERIALS (ASTM)

A 582 -	Standard Specification for Free-Machining Stainless and Heat-Resisting Steel Bars. Hot-Rolled or Cold-Finished
B 1 6 -	Specification for Free-Cutting Brass Rod, Bar, and Shapes for Use in Machine Screws “

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

ASTM (Continued)

B 3 6 - Standard Specification for Brass Plate, Sheet, Strip, and Rolled Bar. (DoD adopted)
B 6 2 - Standard Specification for Composition Bronze or Ounce Metal Castings. (DoD adopted)
B 103 - Specification for Phosphor Bronze Plate, Sheet, Strip, and Rolled Bar.
B 139 - Specification for Phosphor Bronze Rod, Bar, and Shapes.
B 140 - Specification for Copper-Zinc-Lead (Leaded Red Brass or Hardware Bronze) Rod, Bar, and Shapes.
B 152 - Specification for Copper Sheet, Strip, Plate, and Rolled Bar.
B 176 - Speciflcation for Copper Alloy Die Castings.
B 194 - Specification for Copper-Beryllium Alloy Plate, Sheet, Strip, and Rolled Bar.
B 301 - Specification for Free-Cutting Copper Rod and Bar.
B 443 - Specification for Nickel-Chromium-Molybdenum-Colmbian Alloy (UNS N06625) Plate, Sheet, and Strip.
B 465 - Specification for Copper-Iron Alloy Plate, Sheet, Strip, and Rolled Bar.
B 584 - Specification for Copper Alloy Sand Castings for General Applications.
B 670 - Specification for Precipitation Hardening Nickel Alloy (UNS N07718) Plate, Sheet, and Strip for High-Temperature Service .
B 763 - Specification for Copper Alloy Sand Castings for Valve Application.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 13 - Standard for Installation of Sprinkler Systems.

(Application for copies should be addressed to the National Fire Protection Association Inc. , Batterymarch Park, Quincy, MA 02269.)

(Non-Government standards and other publications are normally available from the organizations that prepare or distribute the documents. These documents also may be available in or through libraries or other informational services.)

2,3 Order of precedence. In the event of a conflict between the text of this document and the references cited herein (except for related associated detail specifications, specifications, specification sheets or MS standards), the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained,

3. REQUIREMENTS

3.1 First article. When specified (see 6.2), a sample shall be subjected to first article inspection (see 6.4) in accordance with 4.3.

Source: https://assist.dla.mil -- Downloaded: 2026t0-20T00:58Z
Check the source to verify that this is the currentversion before use.

3.2 Design.

3.2.1 General. The automatic sprinklers shall be the frangible bulb type. The sprinklers shall meet the sensitivity requirements for quick response sprinklers defined in ANSI/UL 199. The sprinklers shall be leak tight for extended periods of time when pressurized with seawater. The sprinklers shall open as intended and release all parts at pressures of 5 to 175 psig, when the bulb temperature is within the actuating temperature range defined in ANSI/UL 199.

3.2.2 Temperature rating. Automatic sprinkler temperature ratings, temperature classifications, maximum overhead temperatures and colors coding shall be as specified in table I. The temperature classification and frame colors shall be consistent with ANSI/UL 199 for each temperature rating. The maximum overhead temperatures shall be consistent with ANSI/UL 199 for maximum ceiling temperatures. The bulb colors shall be consistent with NFPA 13.

TABLE I. Temperature rating and color coding.

Temperature classification	Temperature rating (“F)	Color coding		Maximum overhead temperature (“F)
		Frame	Bulb	
Ordinary	155	None	Red	100
Intermediate	175	White	Yellow	150
Intermediate	200	White	Green	150

3.2.3 Nominal orifice size. Nominal orifice sizes, corresponding discharge coefficients , and identification features shall be as specified in table II and shall be consistent with ANSI/UL 199 requirements. Dimensional tolerances on orifice sizes shall be consistent with ANSI/UL 199 requirements. The discharge coefficient “K” is defined as:

$$K = \frac{L}{/P}$$

Where:

Q - Flow, gallons per minute (gpm)
P - Supply pressure, lb/in2 gage (psig)

The discharge coefficient shall be determined in accordance with the method of ANSI/UL 199,

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

TABLE II. Nominal orifice size and discharge capac i ty.

Orifice type	Nominal orifice size (in.)	Discharge coefficient "K"	Pintle*	Nominal orifice size marked on frame
small	1/4	1.3 - 1.5	Yes	Yes
small	3/8	2.6 - 2.9	Yes	Yes
Standard	1/2	5.3 - 5.8	No	No
Large	17/32	7.4 - 8.2	Yes	Yes

* A stationary pin or rod used to identify non-standard orifice sizes.

3.2.4 Inlet threads. The sprinkler body shall be constructed with a 1/2 inch NPT male thread in accordance with ANSI B1.20.1. Threads shall be clean cut and true, and free from burrs, scoring, or chatter marks.

3.2.5 Seal desire. The seal between the orifice cap and the sprinkler body shall conform to the design described in 3.2.5.1 or 3.2.5.2. No other seal designs are acceptable.

3.2.5.1 O-Ring seal. The seal shall be provided by a radial O-ring in the orifice bore. The O-ring shall be captive in the O-ring groove in the orifice cap . A wave spring, Belleville washer, or similar ejector or spring device shall be under the shoulder area of the orifice cap, in the counterbore of the sprinkler frame, as applicable. Any lubricant used on the O-ring shall be compatible with the O-ring, orifice cap, and sprinkler body in a seawater environment. The basic design concept is illustrated on figure 1.

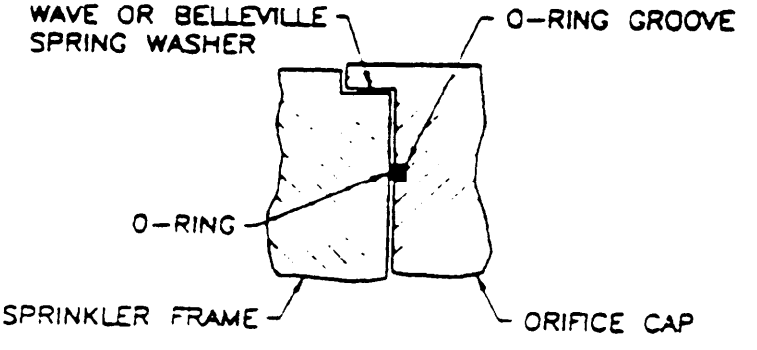


FIGURE 1. O-Ring seal design .

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

3.2.5.2 Washer seal. The seal shall be provided by a teflon coated Belleville spring washer under the shoulder of the orifice cap, in the counterbore in the sprinkler frame. The basic design concept is illustrated on figure 2.

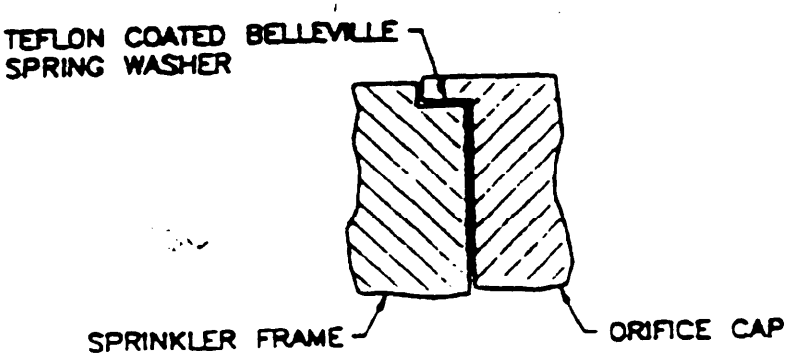


FIGURE 2. Washer seal design.

3.2.6 Preload retention. The automatic sprinkler shall be chemically or mechanically staked to maintain the manufacturer's assembly load. The preload shall not be alterable by the use of common hand tools without causing visible damage to the sprinkler.

3.2.7 Special tools. Special tools shall not be required for installation and routine maintenance of sprinklers. Special tools are defined as those tools not listed in the Federal Supply Catalog (copies of this catalog may be consulted in the office of the Defense Contract Management Area Operations (DCMAO).

3.3 Materials.

3.3.1 Materials of construction. Materials of construction shall conform to table III for each component. If a material is not specified for a particular component, the material selected shall be suitable for the purpose intended. Furthermore, material for internal components in contact with the system fluid shall be compatible with seawater, and materials for external components shall be compatible with a marine atmospheric environment.

3.3.2 Coats and platinings. Automatic sprinklers shall not be plated or coated. Paint shall be permitted only for the purpose of color coding/marking in accordance with 3.6.

3.4 Performance.

3.4.1 General Automatic sprinklers shall meet all of the performance requirements for quick response automatic sprinklers specified in ANSI/UL 199. In addition, automatic sprinklers shall meet all performance requirements for standard automatic sprinklers specified in ANSI/UL 199.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

3.4.2 Shock. Automatic sprinklers shall withstand the shock requirements of grade A, hull mounted, class X, type C as specified In MIL-S-901 (see 4.5.3).

3.4.3 vibration. Automatic sprinklers shall conform to type I vibration requirements specified in MIL-STD-167-1 (see 4.5.4).

TABLE III. Materials of construction.

Component	UNS Number	Description	Applicable Specifications
Frame	C83450	Leaded Red Brass	ASTM B584, B763
	C83600	Cast Leaded Red Brass	ASTM B62, B584, Fed QQ-C-390
	C83800	Cast Leaded Red Brass	ASTM B584, FED QQ-C-390
	C87800	Cast Silicon Bronze	ASTM B176
	C84400	Cast Semi-Red Brass	ASTM B584, B763, Fed-QQ-C-390
Deflector	C11000	Electrolytic Tough Pitch Copper	ASTM B152
	C19400	High Copper Alloy	ASTM B465
	C19500	High Copper Alloy	ASTM B465
	C22000	Commercial Bronze, 90%	ASTM B36
	C23000	Red Brass, 85%	ASTM B36
	C24000	Low Brass, 80%	ASTM B36
	C26000	Cartridge Brass, 70%	ASTM B36
	C51000	Phosphor Bronze, 5%	ASTM B103
Orifice Cap	C11000	Copper	ASTM B152
	C14500	Phosphorus Deoxidized Copper, Tellurium bearing	ASTM B301
	C22000	Commercial Bronze, 90%	ASTM B36
	C23000	Red Brass, 85%	ASTM B36
	C31400	Leaded Commercial Bronze	ASTM B140
	C31600	Leaded Commercial Bronze (Nickel Bearing)	ASTM B140
	C32000	Leaded Red Brass	ASTM B140
	C51000	Phosphor Bronze, 5%	ASTM B103
	C52100	Phosphor Bronze, 8%	ASTM B103
	C54400	Phosphor Bronze B-2	ASTM B103
Load Screw and Bushing	C21000	Gilding, 95%	ASTM B36
	C22000	Commercial Bronze, 90%	ASTM B36
	C32000	Bronze	ASTM B140
	C31400	Leaded Commercial Bronze	ASTM B140
	C31600	Leaded Commercial Bronze (Nickel Bearing)	ASTM B140
	C36000	Free cutting Brass	ASTM B16
	C54400	Phosphor Bronze B-2	ASTM B103, B139
	C67820	Manganese Bronze	No Specification
	C51000	Phosphor Bronze, 5%	ASTM B103
	S03000	Stainless Steel	ASTM 582
Belleville Spring/Wave Washer	C17000	Berylium Copper	ASTM B194
	C17200	Berylium Copper	ASTM B194
	N05500	NiCu Alloy Precipitation Hardenable (Monel K500)	FED QQ-N286
	N06625	Ni-Cr Alloy Solid Solution Strengthened (Inconel 625)	ASTM B443
	N07718	Ni-Cr Alloy Precipitation Hardenable (Inconel 718)	ASTM B670
O-ring	N/A	Flourocarbon Rubber	MIL-R-832488 Type 1, Class 1

Source: https://assist.dla.mil -- Downloaded: 2026l0-20T00:58Z
Check the source to verify that this is the currentversion before use.

The sample shall be installed upright, pendant, or horizontal as required. Tests shall be performed unpressurized and pressurized to 175 psig. Leakage or weeping during test, material failure, loosening or deformation of parts shall be cause for rejection. After completion of test, the sample shall comply with the requirements of the leakage test in ANSI/UL 199 and the oven heat test portion of the sensitivity test.

3.5 Production Manufacturing and production testing shall comply with the requirements of ANSI/UL 199.

3.6 Marking Identification marking shall comply with the requirements of ANSI/UL 199, and the following:

(a) Frangible bulb color coding shall comply with NFPA 13 (same as table I).
(b) The deflector shall be legibly and permanently stamped with the symbol "N" indicating compliance with this specification. The symbol size shall be at least .050 inch and not less than the size (height) of the characters of other markings on the deflector.

3.7 Workmanship. Components shall be free from defects which affect their appearance or which may affect their operation. Casting shall be clean, sound, smoothly cored, true to form, uniform in texture and free from cold shunts, porosity, blow holes and other injurious defects. Casting shall be thoroughly cleaned, both inside and outside, and all fins and roughness shall be removed. Machined surfaces shall not exceed 125 roughness height rating (RHR) as specified in ANSI B46.1, unless a rougher finish is allowed by referenced specifications.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements (examinations and tests) as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in this specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

4.1.1 Responsibility for compliance. All items shall meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of the manufacturing operations, is an acceptable practice to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to accept defective material.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

(a) First article inspection (see 4.3).
(b) Quality conformance inspection (see 4.4).

4.3 First article inspection. When specified (see 6.2), a sample shall be subjected to the first article inspection. The first article inspection shall consist of the requirements specified in table IV. One or more failures of any test shall be cause for rejection.

TABLE IV. First article inspection requirements.

Inspection	Specific requirements	Number of sample units
All applicable ANSI/UL 199 performance tests and inspections	See ANSI/UL 199	See ANSI/UL 199
Visual and dimensional examination	See 4.4.1	See 4.4.3
Shock test	See 3.4.2	4
Vibration test	See 3.4.3	4
Materials Verification	See 3.3	2

4.4 Quality conformance inspection. Quality conformance inspection shall consist of the inspections and tests shown in table V. Quality conformance inspection shall be performed on every lot of sprinklers acquired under this specification.

TABLE V. Quality conformance inspections and tests.

Inspection/test	Requirement	Test	Sampling plan code letter
Visual	3.7		A
Dimensional	3.2.3, 3.2.4, 3.2.5	4.4.1	A
Leakage test	3.5	4.5.1	A
Operating temperature bath test	3.5	4.5.2	A
Marking	3.6	4.4.1	B
Color code painting	3.2.2	4.4.1	B

4.4.1 Visual and dimensional examination. Each sprinkler selected in accordance with 4.4.3 shall be visually and dimensionally examined for compliance with the requirements specified in 3.2.3 through 3.2.5 and 3.7.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

4.4.2 Inspection lot. For the purpose of quality conformance inspection and test sampling, a lot is defined as all the sprinklers of the same material, type, style, size, and temperature rating produced in one facility using the same production processes and offered for delivery at the same time. All sprinklers in the lot must have been manufactured within the preceding 12 months. For the purpose of quality conformance inspection and test sampling of frangible bulbs, a lot is defined as all bulbs of the same material, type, style, and temperature rating produced in one facility and delivered at the same time.

4.4.3 Sampling for Quality conformance inspection. As a minimum, the contractor shall randomly select a sample quantity from each lot of completed sprinklers in accordance with tables V and VI and inspect them in accordance with 4.4, 4.5.1 and 4.5.2. Sample size depends on the sampling plan code letter shown in table V. If one or more defects are found in any sample, the entire lot shall be rejected. The contractor has the option of screening the lot 100 percent for the defective characteristic(s) or providing a new lot which shall be inspected in accordance with sampling plan contained herein. The contractor shall maintain for a period of 3 years after contract completion records of inspections, tests, and any resulting rejections.

TABLE VI. Sample size for Quality conformance inspections and tests.

Lot size	Sample size	
	Sampling plan code letter A	Sampling plan code letter B
1-8	ALL	ALL
9-20	ALL	8
21-90	20	8
91-150	20	12
151-280	20	19
281-500	47	21
501-1200	47	27
1200-OVER	53	35

4.5 Tests.

4.5.1 Leakage test. Each sample shall be subjected to a leakage test to determine compliance to 3.5. The pressure shall be increased to 500 psig and held for 1 minute. During this test, there shall be no weeping or leakage. Test shall be conducted using clean fresh water.

4.5.2 Operating temperature bath test. Each sample shall be subjected to a test to verify the actuating temperature range to determine compliance with 3.5. The test shall be performed in accordance with the requirements of the ANSI/UL 199 operating temperature bath test, except that the frangible bulbs (as opposed to the assembled sprinklers) may be tested.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

4.5.3 Shock. The sprinklers shall be tested to determine compliance with 3,4.2. The sample shall be test-mounted in the upright, pendant, or horizontal position, as required, and installed in an assembly of two pieces of pipe joined to a silver-brazing bronze reducing tee in accordance with MIL-F-1183. Normal installation practice using teflon tape applied to sprinkler head threads shall be used and the sprinkler tightened using the manufacturer's specified torque. Tests shall be performed with the sprinkler head unpressurized and pressurized to 175 psig. Momentary leakage during shock is acceptable. Loosening of parts, material failure or deformation that causes maloperation shall be cause for rejection. After completion of the test, the sample shall comply with the requirements of 3.5 for leakage test (see 4.5.1) and the oven heat test portion of the sensitivity tests in ANSI/UL 199.

4.5.4 Vibration. The sprinkler shall be tested to determine compliance with 3.4.3. Automatic sprinklers shall conform to type I vibration requirements specified in MIL-STD-167-1. The sample shall be installed in an assembly of two pieces of pipe joined to a silver-brazing bronze reducing tee in accordance with MIL-F-1183. As normal installation practice, teflon tape shall be applied to the sprinkler head threads and the sprinkler shall be tightened using the manufacturer's specified torque. The sample shall be installed upright, pendant, or horizontal as required. Tests shall be performed unpressurized and pressurized to 175 psig. Leakage or weeping during tests, material failure, loosening or deformation of parts shall be cause for rejection. After completion of test, the sample shall comply with the requirements of the leakage test in ANSI/UL 199 and the oven heat test portion of the sensitivity test.

4.6 Inspection of Packa-. Sample packs and the inspection of packaging (preservation, packing and marking), for shipment, stowage, and storage shall be in accordance with the requirements of section 5 and the documents specified therein.

5. PACKAGING

(The packaging requirements specified herein apply for direct Government acquisition. For the extent of applicability of the packaging or preparation for delivery of referenced documents listed in Section 2, (see (6.6).

5.1 Presentation. Presevation shall be level A, C or commercial as specified (see 6.2).

5.1.1 Level A. Automatic sprinklers shall be individually unit protected in accordance with method III of MIL-P-116. Cushioning or wrapping materials shall conform to the material specified in MIL-S-196. Sprinklers destined for shipboard stowage shall be cushioned or wrapped with fire retardant materials as noted under the special requirements for cushioning and wrapping materials specified in MIL-S-196. Loose-fill cushioning material shall not be used.

5.1.1.1 unit and intermediate container. Unit containers, and when specified (see 6.2), intermediate containers, shall conform to the unit and intermediate containers specified in MIL-S-196.

5.1.2 Level C Automatic sprinklers shall be individually unit protected as specified for level A, except that unit and intermediate containers may be of the domestic non-waterproof type or class.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

5.1.3 Commercial. Automatic sprinklers shall be individually unit prote in accordance with MIL-S-196.

5.2 Packing Automatic sprinklers preserved as specified in 5.1 shall be packed level A, B, C or commercial as specified (see 6.2), in accordance with MIL-S-196.

5.3 Marking In addition to any special marking required (see 6.2), unit, intermediate and exterior shipping containers for levels A, B, C and commercial shall be marked in accordance with MIL-S-196.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The thermo-sensitive automatic sprinklers covered by this specification are intended for shipboard firefighting by reacting at a predetermined temperature, automatically releasing a stream of water In a specified pattern and density over a designated area when installed on the appropriate sprinkler piping. Sprinklers may be installed in wet and dry sprinkling systems. Sprinklers installed in wet systems will be exposed to stagnant seawater for extended periods of time.

6.1.1 Damaged or actuated units. Any automatic sprinkler that is damaged deformed, actuated by ambient temperature, or operated due to fire, should be replaced. Sprinklers are not capable of being repaired or operating parts replaced or adjusted.

6.2 Acquisition requirements. Acquisition documents must specify the following:

(a) Title, number, and date of this specification.
(b) Configuration (upright, pendant, or horizontal sidewall), size, and temperature rating of sprinkler head.
(c) Quantity required.
(d) First article test (see 3.1 and 4.3).
(e) Levels of preservation-packaging and packing required (see 5.1 and 5.2).
(f) When intermediate containers are required (see 5.1.1.1) .
(g) Marking required (see 5.3).

6.3 Consideration of data requirements. The following data requirements should be considered when this specification is applied on a contract. The applicable Data Item Descriptions (DID's) should be reviewed in conjunction with the specific acquisition to ensure that only essential data are requested/provided and that the DID's are tailored to reflect the requirements of the specific acquisition. To ensure correct contractual application of the data requirements, a Contract Data Requirements List (DD Form 1423) must be prepared to obtain the data, except where DoD FAR Supplement 27.475-1 exempts the requirement for a DD Form 1423.

Source: https://assist.dla.mil -- Downloaded: 202640-20T00:58Z
Check the source to verify that this is the current version before use.

Reference Paragraph	DID Number	DID Title	Suggested Tailoring
4.4	DI-NDTI-80809	Test, reports	----

The above DID's were those cleared as of the date of this specification. The current issue of DoD 5010.12-L, Acquisition Management Systems and Data Requirements Control List (AMSDL), must be researched to ensure that only current, cleared DID's are cited on the DD Form 1423.

6.4 First article. When first article inspection is required, the contracting officer should provide specific guidance to offerors whether the item(s) should be a preproduction sample, a first article sample, a first production item, a sample selected from the first production items, a standard production item from the contractor's current inventory (see 3.1), and the number of items to be tested as specified in 4.3. The contracting officer should also include specific instructions in acquisition documents regarding arrangements for examinations , approval of first article test results, and disposition of first articles. Invitations for bids should provide that the Government reserves the right to waive the requirement for samples for first article inspection to those bidders offering a product which has been previously acquired or tested by the Government , and that bidders offering such products, who wish to rely on such production or test, must furnish evidence with the bid that prior Government approval is presently appropriate for the pending contract. Bidders should not submit alternate bids unless specifically requested to do so in the solicitation.

6.5 Subject term (key word) listing.

Discharge capacity
Firefighting equipment, shipboard
Hydrostatic strength
Overhead
Quick response

6.6 Sub-contracted material and parts. The packaging or preparation for delivery requirements of referenced documents listed in Section 2 don not apply when material and parts are procured by the supplier for incorporation into the equipment and lose their separate identity when the equipment is shipped.

6.7 Changes from Previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 4210-N448)

Source: https://assist.dla.mil -- Downloaded: 202640-20T00:58Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:58Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	1. DOCUMENT NUMBER	2. DOCUMENT DATE (YYMMDD)
	MIL-S-24686A(SH)	18 MAY 1992

3. DOCUMENT TITLE

SPRINKLER, AUTOMATIC, QUICK RESPONSE

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER		
a. NAME (Last, First, Middle initial)	b. ORGANIZATION	
c. ADDRESS (Include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (2) AUTOVON (If applicable)	7. DATE SUBMITTED (YYMMDD)

8. PREPARING ACTIVITY	
a. NAME COMMANDER NAVAL SEA SYSTEMS COMMAND (SEA 55Z3)	b. TELEPHONE (Include Area Code) (1) Commercial: (703) 602-0347 (2) AUTOVON: (AV) 332-0347
c. ADDRESS (Include Zip Code) WASHINGTON, DC 20362-5101	IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT: Defense Quality and Standardization Office 5203 Leesburg Pike, Suite 1403, Falls Church, VA 22041-3466 Telephone (703) 756-2340 AUTOVON 289-2340

Source: https://assist.dla.mil - Downloaded: 2026-04-20T00:58Z
Check the source to verify that this is the current version before use.