O-E-918A
March 12, 1970
SUPERSEDING
Int. Fed. Spec. O-E-00918 (GSA-FSS)
July 11, 1968 and
MIL-E-22345 (WEP)
October 11, 1960

FEDERAL SPECIFICATION

EXTINGUISHER, FIRE, DRY CHEMICAL (WHEELED, 150-POUND CAPACITY)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification covers dry chemical fire extinguishers mounted on a wheeled carriage and designed for use on class B and class C fires.

1.1.1 Federal specification coverage. Federal specifications do not include all varieties of the commodity as indicated by the title of the specification, or which are commercially available, but are intended to cover only those generally used by the Federal Government.

1.2 Classification.

1.2.1 Types. The extinguishers covered by this specification shall be of the following types:

Type I - 36-inch wheels.
Type II - 16-inch wheels.

2. APPLICABLE DOCUMENTS

2.1 The following documents of the issues in effect on date of invitation for bids, or request for proposal, form a part of this specification to the extent specified herein:

Federal Specifications:

PPP-B-601 - Boxes, Wood, Cleated-Plywood.
PPP-B-621 - Boxes, Wood, Nailed and Lock-Corner.
PPP-B-636 - Box, Fiberboard.
PPP-C-650 - Crates, Wood, Open and Covered.

Federal Standards:

Fed. Std. 123 - Marking for Domestic Shipment (Civilian Agencies).

(Activities outside the Federal Government may obtain copies of Federal Specifications, Standards, and Handbooks as outlined under General Information in the Index of Federal Specifications and Standards and at the prices indicated in the Index. The Index, which includes cumulative monthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U. S. Government Printing Office, Washington, D. C. 20402.

(Single copies of this specification and other Federal Specifications required by activities outside the Federal Government for bidding purposes are available without charge from Business Service Centers at the General Services Administration Regional Offices in Boston, New York, Washington, D.C., Atlanta, Chicago, Kansas City, Mo., Fort Worth, Denver, San Francisco, Los Angeles, and Seattle, Washington.

(Federal Government activities may obtain copies of Federal Specifications, Standards, and Handbooks and the Index of Federal Specifications and Standards from established distribution points in their agencies.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

Military Specifications:

MIL-P-116 - Preservation, Methods of.

Military Standards:

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.

(Copies of Military Specifications and Standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless a specific issue is identified, the issue in effect on date of invitation for bids, or request for proposal shall apply:

Underwriters' Laboratories (UL), Inc. Standards For Safety:

No. 299 - Dry Chemical, Hand Fire Extinguishers.
No. 711 - Classification, Rating and Fire Testing.

(Application for copies should be addressed to the Underwriters' Laboratories, Inc., 207 East Ohio Street, Chicago, Illinois 60611; Walt Whitman Road, Melville, Long Island, New York 11746; or 1655 Scott Boulevard, Santa Clara, California 95050.)

Compressed Gas Association (CGA) Standard:

No. 580

(Application for copies should be addressed to the Compressed Gas Association, Inc., 500 Fifth Avenue, New York, N.Y. 10035.)

National Classification Board:

National Motor Freight Classification.

(Application for copies should be addressed to the American Trucking Associations, Inc., Attention: Tariff Order Section, 1616 P Street, N. W., Washington, D. C. 20036.)

Uniform Classification Committee:

Uniform Freight Classification.

(Application for copies should be addressed to the Uniform Classification Committee, 202 Union Station, Chicago, Illinois 60606.)

3. REQUIREMENTS

3.1 Label of Underwriters' Laboratories, Inc. Each contractor shall submit to the contracting agency proof that the extinguisher he proposes to supply under this specification conforms to the requirements of UL299. The label, or listing with reexamination of the UL, may be accepted as evidence that the extinguishers conform to this requirement. In lieu of the label, the contractor may submit independent proof, satisfactory to the contracting agency, that extinguishers conform to the applicable requirements of the published standards, including methods of tests of UL299.


3.1.1 Compliance with the above requirements does not absolve the contractor from complete compliance with the requirements of this specification in order to secure acceptance of his material.

3.2 First article. Unless otherwise specified (see 6.2), the supplier shall furnish, within the time limit specified in the contract or order, a complete fire extinguisher for first article inspection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

The first article may be either a preproduction mode or an initial production item which conforms to all requirements of this specification. Inspection of the first article shall consist of the examination and tests specified in 4.3.1 and 4.3.2 which shall be conducted prior to the submission for acceptance of the remainder of the fire extinguishers furnished under the contract. The unit subjected to first article inspection shall be identical to the units the supplier proposes to furnish in the fulfillment of the contract. Following acceptance by the Government, the first article may be delivered after required servicing and adjustment as the last unit of supply under the contract. Approval of the first article on the basis of the specified inspection shall not relieve the supplier of his obligation to meet the requirements of the specification for the remaining units delivered under the contract or order.

3.3 Design and construction. The extinguisher shall be a complete, portable unit, fully charged and ready for use. The extinguisher shall consist essentially of the following: chemical tank charged with dry chemical, nitrogen cylinder, pressure regulator, discharge hose with nozzle, towing handle and wheels. The design shall be such as to permit recharging with dry chemical and expellent gas without the use of special tools. The overall dimensions shall not exceed the dimensions shown on figure 1.

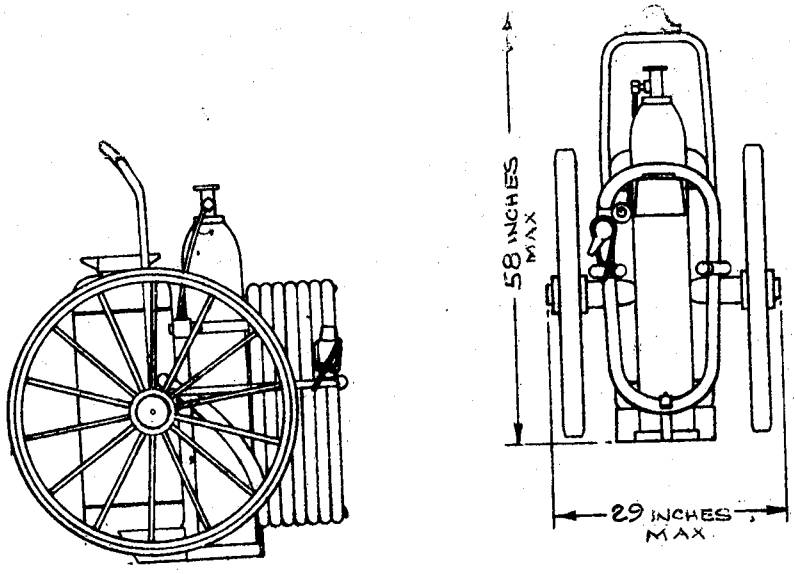

Note. For wheel size and construction data, see 3.3.9.

FIGURE 1. Fire extinguisher.

3.3.1 Classification rating. Extinguishers furnished under this specification shall be capable of successfully extinguishing UL711 test fires for a minimum classification of 120B:C.

3.3.2 Materials. Materials shall be as specified herein and if not specified, shall conform to the manufacturer's standard. All exposed steel surfaces shall be primed with a red oxide or zinc chromate primer and painted with red enamel or acrylic paint.

3.3.3 Chemical tank. The chemical tank shall be of welded steel construction with a fill opening of at least 3 inches in diameter. The tank shall be capable of withstanding a hydrostatic test of 600 pounds per square inch (p.s.i.) and shall have a rupture strength of not less than five times its normal operating pressure. The tank shall be equipped with a gas tube which includes a check valve to prevent syphoning of the dry chemical back into the gas tube and pressure regulator. The fill cap of the tank shall contain holes to permit venting when a minimum of 3-1/2-threads are engaged.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.3.3.1 Dry chemical. The chemical tank shall be charged with potassium base bicarbonate dry chemical conforming to MIL-F-22287 (WEP). The dry chemical charge shall be 150 pounds, ± 20 percent, without packing or rodding of the chemical in the tank.

3.3.4 Nitrogen cylinder. The nitrogen cylinder shall have a capacity of 110 cubic feet at 2215 p.s.i. and shall conform to the applicable specifications of the Department of Transportation. The cylinder shall be equipped with a gage to indicate gas pressure in the cylinder.

3.3.4.1 Nitrogen cylinder valve. Nitrogen cylinder valve shall be constructed in accordance with CGA-580 for cylinder valve outlet connection for water pumped nitrogen. A 3000 p.s.i. pressure gage shall be provided indicating cylinder pressure with the valve in either the open or shut position.

3.3.5 Pressure regulator. The nitrogen pressure regulator shall be mounted adjacent to the dry chemical tank in a position where it is protected from mechanical injury. The regulator shall be set by the manufacturer to the desired working pressure and secured in that position by a suitable sealing mechanism. Fittings between the discharge side of the regulator and the dry chemical tank shall have a rupture pressure of not less than 2500 p.s.i. Connections between the gas cylinder and the regulator shall have a rupture pressure of not less than 6000 p.s.i. Gas flow capacity of the regulator shall insure the full working pressure in the dry chemical tank within 20 seconds of opening of the cylinder valve. Regulator shall be provided with a spring loaded relief valve set to discharge at 300 p.s.i. and handle the full flow of the regulator.

3.3.6 Discharge hose. The discharge hose shall be a 50 foot length of 3/4-inch Underwriters' Laboratories, Incorporated labeled chemical engine hose. The hose shall be connected to the chemical tank by the use of a swivel coupling. The hose and coupling shall withstand a hydrostatic pressure of 600 p.s.i. for a period of 5 minutes without rupture or apparent leakage.

3.3.6.1 Hose rack. The discharge hose shall be coiled on a rack that shall confine the hose and prevent uncoiling when the extinguisher is in transit. The rack shall be designed to permit the hose to be removed quickly, when required.

3.3.7 Nozzle and nozzle holder. A nozzle shall be attached to the end of the hose to permit intermittent discharge. The nozzle shall be normally closed and shall be capable of discharging a straight pattern. A holder shall be provided to confine the nozzle and permit removal of the nozzle when required.

3.3.8 Towing handle. The towing handle shall be similar to figure 1 and shall be adequate for one man to maneuver the extinguisher. The handle shall include a towing loop to permit attaching the extinguisher to the pintles of the towing vehicle.

3.3.9 Wheels. The wheels shall be mounted on the steel axles located near the center of balance of the charged extinguisher. The hub shall be equipped with a lubrication fitting.

3.3.9.1 Type I. The wheels of the type I extinguisher shall be made of steel with a solid rubber tire moulded to the rim. The outside diameter of the wheel shall be not less than 36 inches. The thickness of the rubber tire shall be 5/8 inch, minimum and the width of the rim of the wheel shall be 2-1/2 inches, minimum.

3.3.9.2 Type II. The wheels of the type II extinguisher shall be either the disc or spoked type with semi-pneumatic or pneumatic rubber tires. The wheels shall be not less than 16 inches in diameter and have a tread of not less than 4 inches.

3.4 Weight. The total weight of the complete extinguisher, fully charged, shall not exceed 500 pounds.

3.5 Markings. Each extinguisher shall be marked in accordance with the marking requirements of UL-299, and shall include the class identification by means of shape-symbol coding for class B and class C fires.

3.6 Record tag. Each extinguisher shall be provided with a tag securely attached to the tank for recording recharging and inspection dates.

3.7 Workmanship. The extinguisher shall be constructed, assembled, and finished in a thoroughly workmanlike manner to assure good quality equipment of a neat general appearance.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements, as specified herein. Except as otherwise specified, the supplier may utilize his own facilities or any commercial laboratory acceptable to the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure that supplies and services conform to prescribed requirements.

4.2 Classification of inspection. Inspection shall be classified as follows:

(a) First article inspection of the fire extinguisher (see 4.3).

(b) Quality conformance inspection of the fire extinguisher (see 4.4).

(c) Inspection of preparation for delivery (see 4.6).

4.3 First article inspection.

4.3.1 Examination. The extinguisher shall be examined, as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.3.2 Tests. The extinguisher shall be tested, as specified in 4.5.2. Failure of any test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for inspection shall be in accordance with MIL-STD-105, inspection level S-1.

4.4.2 Examination. Each extinguisher shall be examined, as specified in 4.5.1. Presence of one or more defects shall be cause for rejection.

4.5 Inspection procedure.

4.5.1 Examination. The extinguishers shall be examined for the following defects:

1. Materials not as specified.
2. Capacity of the tanks not as specified.
3. Dimensions not as specified.
4. Painting not as specified.
5. Marking not as specified.
6. Record tag missing.
7. Chemical charge not as specified.
8. Workmanship not as specified.

4.5.2 Tests. Except as noted, the test procedures and test equipment shall conform to the applicable requirements and provisions of UL299 and UL711.

4.5.2.1 Roadability test. The extinguisher shall discharge acceptably after being towed for 5 miles at a rate of 5 to 7 miles per hour over concrete, macadam or gravel roads, or a combination thereof. The wheels, axles, and carriage assembly shall not be damaged during this test to the extent of impairing easy mobility by one man, nor should any welds be broken.

4.5.2.2 Rough-usage test. The extinguisher shall show no signs of damage or impairment of mobility after being dropped 3 times to a concrete surface from a 12-inch high platform so as to land on the wheels; and after being pulled at a speed of 5 miles per hour and allowing one wheel to strike a vertical concrete curb 6 inches high. The nozzle shall be capable of functioning properly after being dropped 3 times to a concrete surface from a height of 5 feet.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

4.6 Inspection of preparation for delivery. An inspection shall be made to determine that the packaging, packing, and marking comply with the requirements in section 5 of this specification. Defects shall be scored in accordance with table I. The sample unit shall be one shipping container fully prepared for delivery. Sampling shall be in accordance with MIL-STD-105. The lot size shall be the number of shipping containers in the end item inspection lot. The inspection level shall be S-2 and the Acceptable Quality Level (AQL)shall be 4.0 defects per hundred units.

TABLE I. Classification of preparation for delivery defects

Examine	Defects
Markings (exterior and interior)	Omitted; incorrect; illegible; improper size, location, sequence, or method of application.
Materials	Any component missing or damaged.
Workmanship	Inadequate application of components such as incomplete closure of container flaps, loose strapping, inadequate stapling. Distortion of container.

5. PREPARATION FOR DELIVERY

5.1 Preservation and packaging. Preservation and packaging shall be level A or C, as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Disassembly. Disassembly shall be the minimum necessary to safeguard parts known to be subject to damage or loss, or that would otherwise increase cubage in accordance with the recommendations of the equipment manufacturer. Removed bolts, nuts, washers, and pins shall be replaced in one of the mating parts and secured to prevent their loss or preserved together in accordance with MIL-P-116, method IC-1 and placed in the box with the discharge hose.

5.1.1.2 Unprotected surfaces. Unprotected metal surfaces requiring the application of a contact preservative in accordance with MIL-P-116 shall be coated with type P-1 preservative. The preservative shall conform to the applicable specification listed in and shall be applied in accordance with MIL-P-116.

5.1.1.3 Record tag. The record tag shall be preserved in accordance with MIL-P-116, method IC-1 and placed in the box with the discharge hose.

5.1.1.4 Discharge hose. The discharge hose with fittings and nozzle attached shall be coiled; secured with cotton tape and packaged in a close-fitting box conforming to PPP-B-636, W5c.

5.1.2 Level C. Each complete extinguisher shall be disassembled, preserved, and packaged in a manner to provide protection against deterioration and damage from the supplier to the initial destination in accordance with the recommendations of the equipment manufacturers.

5.2 Packing. Packing shall be level A, B, or C,as specified (see 6.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

5.2.1 Level A. Each complete extinguisher shall be packed in a close-fitting box conforming to PPP-B-601, overseas type or PPP-B-621, class 2. Anchoring, blocking, and bracing shall be provided. The box shall be closed and strapped in accordance with the appendix to the box specification. When the gross weight exceeds 250 pounds, skids shall be provided in accordance with applicable box specification.

5.2.2 Level B. Each complete extinguisher shall be packed as specified in 5.1.1 for level A except boxes shall be domestic type or class as applicable, or when specified (see 6.2), packed in a crate conforming to PPP-C-650, style B. Crated components shall be protected with a shroud, fabricated in accordance with the appendix to the crate specification.

5.2.3 Level C. The extinguisher shall be packed to insure carrier acceptance and safe delivery at destination in containers complying with the rules and regulations applicable to the mode of transportation. Containers shall conform to the requirements of the Uniform Freight Classification or National Motor Freight Classification, as applicable.

5.3 Marking.

5.3.1 Civil agencies. In addition to markings required by the contract or order, the shipping containers shall be marked in accordance with Fed. Std. No. 123.

5.3.2 Military agencies. In addition to markings required by the contract or order, the shipping containers shall be marked in accordance with MIL-STD-129.

6.1 Intended use. The fire extinguishers covered by this specification are for use on class B (flammable liquids) and class C (electrical equipment) fires. The fumes created within the fire, by the dry chemical, are non-toxic and fires are reluctant to reflash in those areas previously extinguished.

6.2 Ordering data. Purchasers should select the preferred options permitted herein and include the following information in procurement documents.

(a) Title, number, and date of this specification.
(b) Type required (see 1.2.1).
(c) Levels of preservation, packaging, and packing required (see 5.1 and 5.2).
(d) Whether extinguishers are to be packed in crates (see 5.2).
(e) Special markings required (see 5.3.1 and 5.3.2).

MILITARY CUSTODIANS:

Army - ME
Navy - YD
Air Force - 84

Review activities:

Army - CE

User activities:

Navy - MC

Preparing activity:

GSA-FSS

CIVIL AGENCY INTEREST:

COM
DOT
VA

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of this specification to obtain extra copies and other documents referenced herein. Price 15 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

GENERAL SERVICES ADMINISTRATION - FEDERAL SUPPLY SERVICE

SPECIFICATION COMMENT SHEET

BUDGET BUREAU NO. 29-R0175

INSTRUCTIONS

This form provides a way for users of this specification to inform the originator of problems encountered in its use. It is not to be used to request changes to accommodate proprietary features. All comments will be considered and appreciated, but please do not expect a reply. To comment: detach, complete, and mail to: GSA, FSS, Stdzn. Div. (FMSK), Wash., D.C. 20406.

NOTE: Comments on this form do not constitute or imply authorization to waive any part of the document or serve to amend contractual requirements.

1. SPECIFICATION

O-E-918A, Federal Specification, EXTINGUISHER, FIRE, DRY CHEMICAL (WHEELED, 150-POUND CAPACITY)

2. CONTRACT NO. *(If any)*	3. QUANTITY ON CONTRACT *(Optional)*	4. DOLLAR VALUE *(Optional)*

5. GENERAL NATURE OF PROBLEM *(e.g., inspection difficulties, manufacturers unable to meet tolerances, containers collapse under normal warehousing conditions, etc.)*

6. SPECIFIC REQUIREMENTS AFFECTED *(Include paragraph number and lines of wording)*

7. SPECIFIC PROBLEMS *(e.g. tests in 4.2.2 will not assure that the battery will last required time; temperature ranges in table 2 do not conform to commercially available items.)*

8. RECOMMENDATIONS

9. NAME OF MANUFACTURER, ASSOCIATION, GOVT., AGENCY, ETC.	10. ADDRESS *(Number, Street, City, State and Zip Code)*

11. NAME AND TITLE OF SUBMITTER	12. DATE

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.