O-E-940C
May 8, 1981
SUPERSEDING
Fed. Spec. O-E-940B
June 9, 1975

FEDERAL SPECIFICATION

EXTINGUISHERS, FIRE, WATER

HAND-PUMP, TANK, PORTABLE

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification covers three types of portable fire extinguishers capable of discharging a stream of water by means of an integral hand-operated pump.

1.2 Classification.

1.2.1 Types. The extinguishers shall be of the following types, as specified (see 6.2):

Type I. Cylindrical tank, 2-1/2-gallon capacity.
Type II. Cylindrical tank, 4-gallon capacity.
Type III. Conical tank (demountable, nestable), 4-gallon capacity.

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issues in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

FSC 4210

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

Federal Specifications:

O-C-240	-	Charge, Fire Extinguisher, Antifreeze and Charge, Fire Extinguisher, Soda-Acid.
QQ-B-750	-	Bronze, Phosphor; Bar, Plate, Rod, Sheet, Strip, Flat Wire, and Structural and Special Shaped Sections.
QQ-C-591	-	Copper-Silicon, Copper-Zinc-Silicon, and Copper-Nickel-Silicon Alloys: Rod, Wire, Shapes, Forgings, and Flat Products (Flat Wire, Strip, Sheet, Bar, and Plate).
QQ-S-766	-	Steel Plates, Sheets, and Strip - Corrosion Resisting.
PPP-B-585	-	Boxes, Wood, Wirebound.
PPP-B-601	-	Boxes, Wood, Cleated-Plywood.
PPP-B-621	-	Boxes, Wood, Nailed and Lock-Corner.
PPP-B-636	-	Boxes, Shipping, Fiberboard.
PPP-B-640	-	Boxes, Fiberboard, Corrugated, Triple-Wall.

Federal Standards:

FED. TEST METHOD STD. No. 601 - Rubber: Sampling and Testing.

(Activities outside the Federal Government may obtain copies of Federal specification, standards, and commercial item descriptions, as outlined under General Information in the Index of Federal Specifications, Standards, and Commercial Item Descriptions. The Index, which includes cumulative monthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

(Single copies of this specification, other Federal specifications, and commercial item descriptions required by activities outside the Federal Government for bidding purposes are available without charge from General Services Administration Business Service Centers in Boston; New York; Washington, DC; Philadelphia; Atlanta; Chicago; Kansas City, MO; Fort Worth; Houston; Denver; San Francisco; Los Angeles; and Seattle, WA.

(Federal Government activities may obtain copies of Federal specifications, standards, and commercial item descriptions, and the Index of Federal Specifications, Standards, and Commercial Item Descriptions from established distribution points in their agencies.)

Military Specifications:

MIL-P-116	-	Preservation-Packaging, Methods of.
MIL-G-1149	-	Gasket Materials, Synthetic Rubber, 50 and 65 Durometer Hardness.
MIL-C-52155	-	Charges, Fire Extinguisher, Antifreeze, Calcium-Lithium Chloride Base and Lithium Chloride Base.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

Military Standards:

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129 - Marking for Shipment and Storage.
MIL-STD-130 - Identification Marking of US Military Property.
MIL-STD-1188 - Commercial Packaging of Supplies and Equipment.

(Copies of Military Specifications and Standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless a specific issue is identified, the issue in effect on date of invitation for bids or request for proposal shall apply:

American Society for Testing and Materials (ASTM) Standards:

A 153 - Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
D 380 - Rubber Hose, Standard Method of Testing.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

National Fire Protection Association (NFPA):

NFPA No. 10 - Installation of Portable Fire Extinguishers.

(Application for copies should be addressed to the National Fire Protection Association, 470 Atlantic Avenue, Boston, MA 02210.)

Society of Automotive Engineers (SAE):

J429 - Mechanical and Material Requirements for Externally Threaded Fasteners.

(Application for copies should be addressed to the Society of Automotive Engineers, 400 Commonwealth Drive, Warrendale, PA 15086.)

Underwriters' Laboratories, Inc., (UL):

UL 626 - 2-1/2 Gallon Stored-Pressure, Water-Type Fire Extinguishers.
UL 711 - Fire Extinguishers, Rating and Fire Testing of.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

(Application for copies should be addressed to the Underwriters' Laboratories, Inc., 207 East Ohio Street, Chicago, IL 60611; 333 Pfingsten Road, Northbrook, IL 60062; 1285 Walt Whitman Road, Melville, L.I., NY 11746; or 1655 Scott Boulevard, Santa Clara, CA 95050.)

National Motor Freight Traffic Association, Inc., Agent:

National Motor Freight Classification.

(Application for copies should be addressed to the American Trucking Associations, Inc., Traffic Department, 1616 P Street, NW, Washington, DC 20036.)

Uniform Classification Committee, Agent:

Uniform Freight Classification.

(Application for copies should be addressed to the Uniform Classification Committee, ATTN: Tariff Publishing Officer, Room 1106, 222 South Riverside Plaza, Chicago, IL 60606.)

3. REQUIREMENTS

3.1 Description. Extinguishers shall consist of a tank, hand-operated pump, hose, nozzle, hose clamp, hanger loop for wall-mounting, and all other parts and components necessary for proper operation as specified herein.

3.2 First article (first produced extinguisher). The contractor shall furnish one or more extinguishers as specified (see 6.2), for examination and testing within the time frame specified (see 6.2), to prove prior to starting production that his production methods and choice of design detail will produce extinguishers that comply with the requirements of this specification. Examination and tests shall be as specified in section 4 and shall be subject to surveillance and approval by the Government (see 6.3).

3.3 Material. Material shall be as specified herein. Materials not specified shall be selected by the contractor and are subject to all provisions of this specification (see 6.5).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.3.1 Plastics. All plastic parts or components shall be in accordance with the applicable requirements of UL 626. Approval of the plastic components by Underwriters' Laboratories, Inc., for the use intended, shall be acceptable in lieu of performance of the applicable test procedures set forth in UL 626.

3.4 Performance. The extinguishers shall project a compact, nonpulsating stream of water over a horizontal distance of not less than 30 feet when the pump is operated at the rate of 60 full double strokes per minute and the nozzle is held at an angle of 45 degrees, plus or minus 1.0 degree, to the horizontal at a distance of 36 inches, plus or minus 1/2-inch, above the floor or ground.

3.4.1 UL performance requirements. The extinguishers shall meet all performance requirements set forth in UL 711 for rating 2-A (2-1/2-gallon) or 3-A (4-gallon) extinguishers, as applicable. Prior to approval of the first produced extinguisher, the contractor shall submit to the contracting officer or to his authorized representative satisfactory evidence that the extinguishers he proposes to furnish under this specification meet the requirements of UL 711. Acceptable evidence of meeting the requirements of this standard will be the UL label, a listing in the UL Fire Protection Equipment List or a certification of compliance acceptable to the Government, indicating that the extinguishers have been tested and conform to UL 711.

3.5 Rough handling. The extinguishers shall operate as specified in 3.4, and shall not leak after being subjected to the drop test specified in 4.5.2.1.

3.6 Tank. The tank shall be sheet steel not less than 0.0359-inch thick, except that, when specified (see 6.2), the tank shall be of one of the following materials:

(a) Phosphor-bronze conforming to QQ-B-750, composition A, not less than 0.030-inch thick.
(b) Copper-silicon conforming to QQ-C-591, not less than 0.030-inch thick.
(c) Corrosion-resistant steel conforming to QQ-S-766, type 302, not less than 0.025-inch thick (see 6.4).

3.6.1 Shell.

3.6.1.1 Ferrous shells. Ferrous shells shall be electrically welded or shall have locked seams sealed with solder. Spot-welded joints, when used, shall be soldered on the inside.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.6.1.2 Nonferrous shells. The vertical seams of nonferrous shells shall have a double lock-joint. The bottom may have a single lock-joint. Both double and single lock-joints shall be soldered.

3.6.2 Bottom. The bottom of the tank shall be recessed not less than 1/2-inch and shall fit within the shell so that the lower edge of the flange will be flush with the end of the shell. The bottom shall be secured in place by electric welding or with a locked seam. When spot-welded, the joint between the bottom and the shell shall be soldered on the inside after welding. Lock seams shall be soldered. When a single lock seam is used, the outer surface of the lower edge shall be reinforced by a 3/4-inch wide band of the same material as the tank, not less than 0.015-inch thick, secured in place by welding or by rivets spaced not less than 3 inches on centers.

3.6.3 Top. The top shall be provided with openings for insertion of the pump and for filling. The opening for the pump shall be reinforced on the underside by a plate not less than 1/8-inch thick and of a diameter to provide rigid support for the pump. The top shall be reinforced in such manner as to prevent its flexing when the pump is being operated. Reinforcement not necessary when pump is shell mounted and braced. A 1/2-inch hole may be provided for retaining the end of the nozzle. The edges of the fill and nozzle holes shall be turned in to make a smooth edge. An air vent shall be provided to prevent the formation of a vacuum when the extinguisher is operated.

3.6.4 Cover. The cover for the fill opening shall be attached to the extinguisher by a hinge, ring or chain and shall remain closed when the extinguisher is being carried. Means shall be provided to facilitate opening.

3.6.5 Foothold. A hinged foothold shall be provided for steadying the extinguisher while being operated. The foothold shall be located at the vertical seam at the lower edge of the extinguisher. The foothold shall remain in a vertical position when not in use, shall not fall below a horizontal position, and lie flat on the floor when in use. The foothold shall be not less than 3 inches wide and shall extend at least 2-1/2 inches from the extinguisher when in a horizontal position. The foothold shall be attached to the shell below the tank bottom by means of an anchored hinge or loop.

3.6.6 Handle. A carrying handle shall be attached to the tank by mechanical means and not by solder alone, and shall be located so as to not interfere with the operation of the other components.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.7 Gaskets. Gaskets shall be material conforming to MIL-G-1149, type and class optional, and shall be cemented in place to prevent leakage.

3.8 Pump. A manually operated single-suction, double-discharge pump shall be furnished. Valves shall be provided to assure positive operation. The pump shall be placed in the tank in a vertical position through the opening provided in the tank top. The pump shall be attached to the tank top by not less than three machine screws. The screws shall extend through the flange of the pump head and into the plate used for reinforcing the tank top. The pump shall be so constructed that it can be readily disassembled for purposes of cleaning and repair. Construction shall be such that the corrosion of any component will not cause the pump to become inoperative.

3.8.1 Cylinder. The cylinder of the pump shall be brazed or seamless drawn brass tubing having a smooth interior. The walls of the tubing shall be not less than 0.040-inch in nominal thickness with an outside diameter of not more than 1-1/4 inches. The tube shall be threaded for assembly into the pump head. An antisiphon hole shall be provided at a point just below the discharge head.

3.8.2 Foot-valve assembly. The foot valve shall be installed in the lower end of the pump cylinder or in a separate brass fitting attached to the pump cylinder by threads or by spinning. The foot-valve assembly shall be not more than 1-1/4 inches in diameter. The ball chamber shall be machined so that the ball will seat without sticking or failing to make a complete contact when seated. The ball shall be made of chemically hardened, full tempered soda-lime glass and shall be spherical. A screen or strainer, made of perforated brass or copper sheet not less than 0.020-inch in nominal thickness and having holes not more than 3/32-inch in diameter, shall be provided at the lower end of the foot valve. The strainer or screen shall have an effective area of not less than 20 times the area of the nozzle orifice. The screen shall be securely attached to the bottom of the foot valve.

3.8.3 Piston tube. The piston tube shall be brazed or seamless brass tubing having an outside diameter of 3/4-inch. The walls of the tubing shall be not less than 0.040-inch in nominal thickness. The exterior surface of the tube shall be smooth and free from imperfections.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.8.4 Piston. The piston shall be an integral part of, or securely attached to, the lower end of the piston tube and shall be brass. The packing ring shall be of commercially pure lead, brass, or other material of equal effectiveness.

3.8.5 Pump head. The head shall be brass or nonferrous metal and shall be threaded for the attachment of a packing nut. The head shall be provided with a discharge outlet for attachment, by means of a metal clamp, of a 3/8-inch hose. The inside diameter of the discharge outlet shall be not less than 1/4-inch. The packing recess shall be located in the pump head above the discharge outlet and shall be machined to provide a smooth bearing surface for the packing. The packing glands and nut shall be brass. The packing glands shall have clearance to prevent wear of the plunger tube. The packing nut shall be knurled, serrated, or otherwise arranged for ready hand adjustment. The packing shall be such quality and quantity that commercial packing nut pressure will prevent leakage. The packing nut and glands may be omitted when an equally effective self-adjusting "C" ring packing is utilized.

3.8.6 Pump handle. A handle shall be securely attached to the upper end of the piston tube. Attachment may be by threading, silver soldering, or other mechanical means. The handle shall be malleable iron or brass, D-shaped, with a horizontal clearance for the hand of not less than 3-1/2 inches and a vertical clearance of not less than 1-1/2 inches.

3.9 Hose. The hose shall be not less than 30 inches in length and shall withstand the tests specified in 4.5.2.3 without damage or leakage under pressure.

3.10 Nozzle. The nozzle shall be lead-tin alloy or other material having equal corrosion-resisting properties. The nozzle shall be free from blowholes or other imperfections, and the liquid passageway shall be smooth and tapered. The orifice shall be not less than 1/8-inch in diameter. The orifice shall be smoothly and concentrically chamfered to a depth of 1/16 $\pm$1/64-inch. The 1/4-inch opening at the entrance to the nozzle shall be rounded to provide a smooth approach to the taper bore.

3.11 Hose clamp. The hose shall be secured to the pump head by a brass or galvanized steel clamp, with a galvanized steel or brass bolt and nut for tightening. The hose shall be secured to the nozzle either by a clamp or by a brass ferrule.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.12 Record tag. Each extinguisher shall be provided with a record tag attached to the carrying handle by a metal ring or hook. The tag shall be in accordance with UL 626.

3.13 Antifreeze. When specified (see 6.2), an antifreeze charge shall be furnished with each extinguisher not fabricated of corrosion-resistant steel. The charge shall be separately packaged and shall be shipped together with the extinguisher.

3.13.1 Carbon-steel tanks. Antifreeze for carbon-steel extinguishers shall conform to one of the following, at the option of the contractor:

(a) O-C-240, type I. 2-1/2-gallon extinguishers shall have the class A charge, and 4-gallon extinguishers shall have the class B charge.
(b) MIL-C-52155. 2-1/2-gallon extinguishers shall have the type I, size 1, or type II, size 1 charge, and 4-gallon extinguishers shall have the type II, size 2 charge.

3.13.2 Phosphor-bronze and copper-silicon tanks. Antifreeze charges for phosphor-bronze and copper-silicon extinguishers shall be at the option of the contractor. When mixed with 2-1/2- or 4-gallons of water, as applicable, the antifreeze charge shall prevent freezing to minus 40° F and shall cause no chemical reaction with metal or plastic parts of the extinguisher.

3.14 Protection against corrosion. The entire interior and exterior of non-corrosion-resisting steel surfaces and other parts of the extinguisher subject to corrosion shall be zinc coated in accordance with ASTM A 153, class B-2. The zinc coating shall be applied after fabrication. Zinc coating prior to fabrication is acceptable where a water-resistant plastic coating system is applied after fabrication directly on the zinc-coated sheets forming the interior of the extinguisher. The plastic coating shall be evenly and continuously applied and shall conform to the applicable aging requirements of UL 626.

3.15 Identification marking. The extinguishers shall be identified in accordance with MIL-STD-130. In addition, each extinguisher shall be plainly marked by embossing or etching the tank front, or by attachment of an embossed or etched metal plate, or pressure sensitive nameplate. The markings shall be as follows:

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

(a) Operating instructions. Instructions for operating shall be in letters not less than 1/2-inch in height and of a different color than the background so that they will be conspicuous.
(b) Capacity in gallons. Capacity in gallons shall be clearly indicated.
(c) Maintenance. A statement to the effect that the extinguisher pump should be operated frequently by discharging back into the tank and that the piston tube should be oiled if necessary.
(d) Caution. Caution against use on live electrical equipment shall be in large distinct letters.
(e) Directions for charging. Directions for charging with antifreeze solution shall be in legible letters (see 3.15.1).
(f) Identification. The name and address of the manufacturer or his exclusive and generally recognized trademark or trade device.

3.15.1 Corrosion-resistant steel. In lieu of direction for charging, corrosion-resistant steel extinguishers shall be marked as follows: "Install only in heated areas. Do not add antifreeze."

3.15.2 Shape-symbol marking. Unless otherwise specified (see 6.2), the extinguishers shall be identified as appropriate for use on class A fires in accordance with NFPA No. 10, appendix B.

3.16 Finish. Unless otherwise specified (see 6.2), the exterior metal surfaces of the extinguisher which are not of corrosion-resistant metal shall be painted or enameled in red.

3.17 Type I extinguishers. The type I extinguisher shall have a cylindrical tank, 8-1/2-inch maximum diameter, with a capacity of not less than 2-1/2 gallons of liquid with a free air space of 2-1/2 inches minimum between the liquid surface and the underside of the tank top. A hanger loop shall be attached to the tank by mechanical means and not by solder alone and shall be located diametrically opposite the nameplate. The carrying handle may be used as the hanger loop, or the pump handle may be used as the carrying handle if a quick-opening device is provided that locks the pump handle in the down position. A metal bracket with screws shall be furnished with each extinguisher for wall mounting the extinguisher by the hanger loop or the carrying handle.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.17.1 Discharge duration. When operated as specified in 3.4, not less than 95 percent of the tank contents shall be discharged in 60 seconds.

3.17.2 Fill opening. The fill opening in the type I extinguisher shall have an area of not less than 3.4 square inches when the top is recessed at least 3/8-inch and not less than 5 square inches when the top is even with the shell edge. The long dimension of the fill opening shall be not less than 2-3/4 inches.

3.18 Type II extinguishers. The type II extinguisher shall have a cylindrical tank, 10-1/2-inch maximum diameter, with a capacity of not less than 4 gallons of liquid with a free air space of 2 inches minimum between the liquid surface and the underside of the tank top. The pump handle may be used as the carrying handle if a quick-opening device is provided that locks the pump handle in the down position.

3.18.1 Discharge duration. When operated as specified in 3.4, not less than 95 percent of the tank contents shall be discharged in 120 seconds.

3.18.2 Fill opening. The fill opening in the type II extinguisher shall have an area of not less than 9 square inches.

3.19 Type III extinguishers. The type III extinguisher shall have a conical tank conforming to the dimensions shown in figure 1. The tank shall have a capacity of not less than 4 gallons of liquid with a free air space of 2 inches minimum, between the liquid surface and the underside of the tank top. The extinguisher shall be furnished disassembled and packaged as shown in figure 2. The handle of the type III extinguisher shall be the bail type and constructed in accordance with figure 2.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

3.19.1 Discharge duration. When operated as specified in 3.4, not less than 95 percent of the tank contents shall be discharged in 120 seconds.

3.20 Workmanship.

3.20.1 Metal fabrication. Metal used in fabrication shall be free from kinks and sharp bends. The straightening of material shall be done by methods that will not cause damage to the material. Corners shall be square and true. All bends shall be made with controlled means to insure uniformity of size and shape. Precaution shall be taken to avoid overheating. Heated steel shall be allowed to cool slowly. External surfaces shall be free of burrs, sharp edges and corners, except when sharp edges or corners are required or where they are not detrimental to safety.

3.20.2 Bolted connections. Boltholes shall be accurately formed and shall have the burrs removed. Washers or lockwashers shall be provided where necessary. Matching thread areas securing bolts conforming to SAE J429 or capscrews shall be of sufficient strength to withstand the tensile strength of the bolt. All fasteners shall be tight, and shall have full thread engagement. Bolts shall not protrude more than two full threads.

3.20.3 Riveted connections. Rivets shall fill the holes completely. The upset rivet heads shall be full, neatly made, concentric with the rivet holes, and in full contact with the surface of the member.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements specified herein. Except as otherwise specified in the contract or order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to prescribed requirements.

4.1.1 Component and material inspection. The contractor is responsible for insuring that components and materials used are manufactured, examined and tested in accordance with referenced specifications and standards.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

4.2 Classification of inspections. The inspection requirements specified herein are classified as follows:

(a) First produced extinguisher inspection (see 4.3).
(b) Quality conformance inspection (see 4.4).
(c) Inspection of preparation for delivery (see 4.6).

4.3 First produced extinguisher inspection.

4.3.1 Examination. The extinguishers shall be examined as specified in 4.5.1. Presence of one or more defect shall be cause for rejection.

4.3.2 Tests. The extinguishers shall be tested as specified in 4.5.2. Failure of one or more test shall be cause for rejection.

4.4 Quality conformance inspection.

4.4.1 Sampling. Sampling for examination and tests shall be in accordance with MIL-STD-105, inspection level S-2.

4.4.2 Examination. Samples selected in accordance with 4.4.1 shall be examined as specified in 4.5.1. AQL shall be 2.5 percent defective for major defects and 4.0 percent defective for minor defects.

4.4.3 Test. Samples selected in accordance with 4.4.1 shall be tested as specified in 4.5.2.2. AQL shall be 2.5 percent defective.

4.5 Inspection procedure.

4.5.1 Examination. The extinguisher shall be examined as specified herein for the following defects:

Major

101. Incorrect type extinguisher.
102. Materials not as specified.
103. Satisfactory evidence of compliance with UL requirements not provided.
104. Tank assembly incomplete or incorrect.
105. Outside dimensions not as specified.
106. Leaks at joints, seams, or edges.
107. Gasket not as specified.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

108. Pump assembly incomplete or incorrect.
109. Hose less than 30 inches in length.
110. Nozzle not as specified.
111. Hose clamp or ferrule not as specified.
112. Antifreeze charge incorrect or not provided when specified.
113. Corrosion protection not as specified.
114. Finish not as specified.
115. Type I, II, or III dimensions or assembly not as specified.

Minor

201. Record tag missing or not as specified.
202. Identification marking not as specified.
203. Workmanship not as specified.

4.5.2 Tests.

4.5.2.1 Drop. The extinguisher, filled with water and complete with all components and ready for operation, shall be dropped five times from a height of 12 inches onto a solid concrete surface. This shall be accomplished with the extinguisher in a vertical position. Any evidence of leakage shall constitute failure of this test. If no leakage is observed, the extinguisher shall then be tested in accordance with 4.5.2.2.

4.5.2.2 Performance. The extinguisher equipped with all components shall be filled to capacity with water. The extinguisher shall be operated, and discharge characteristics observed and recorded. Nonconformance to 3.4, 3.17.1, 3.18.1, or 3.19.1 as applicable, shall constitute failure of this test.

4.5.2.3 Hose. The hose shall be tested for flexibility at minus 40° C in accordance with FED. TEST METHOD STD. No. 601, Test Method 5211. After completion of this test, the hose shall be returned to room temperature and hydrostatically tested in accordance with ASTM D 380. The test pressure shall be 400 pounds per square inch (psi) and shall be maintained for a period of 5 minutes. Evidence of damage due to low-temperature flection or of leakage under hydrostatic test pressure shall constitute failure of this test.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

4.5.2.4 Plastics. Plastic coating and components not given prior approval for use intended by Underwriters' Laboratories, Inc., shall be tested in accordance with the applicable aging test procedures set forth in UL 626. Noncompliance with UL 626 shall constitute failure of this test.

4.6 Inspection of preparation for delivery. An inspection shall be made to determine compliance with the requirements of section 5. The sample unit shall be one shipping container fully prepared for delivery. Sampling shall be in accordance with MIL-STD-105. The inspection level shall be S-2 with an AQL of 4.0 expressed in terms of percent defective.

5. PREPARATION FOR DELIVERY

5.1 Packaging. Packaging shall be level A or commercial, as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Types I and II extinguishers. Types I and II extinguishers shall be individually packaged in accordance with MIL-P-116, method III, using a box conforming to PPP-B-636, type CF, class weather resistant. The box shall be closed and sealed as specified for method V in the appendix to the box specification. The bracket and screws furnished with each type I extinguisher shall be packaged together, in accordance with MIL-P-116, method IC-1, and placed in the box with the extinguisher.

5.1.1.2 Type III extinguishers. The unassembled components comprising four complete type III extinguishers shall be packaged in accordance with MIL-P-116, method III, using a box conforming to PPP-B-636, type CF, class weather resistant. The box shall be closed and sealed as specified for method V in the appendix to the box specification. Nesting of the tanks and arrangement of the components shall be generally as shown on figure 2, however the figure is included for guidance only and is not to be considered the only acceptable method of arrangement. The components within the box shall be blocked or cushioned to prevent movement and damage.

5.1.1.3 Antifreeze charges. The antifreeze charges shall be packaged in accordance with the level A requirements of O-C-240.

5.1.2 Commercial.

5.1.2.1 Military agencies. Commercial packaging shall be in accordance with MIL-STD-1188.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

5.1.2.2 Civil agencies. The extinguisher shall be packaged in accordance with normal commercial practice. The complete package shall be designed to protect the extinguisher against damage during multiple shipments, handling, and storage.

5.2 Packing. Packing shall be level A, level B, or commercial specified (see 6.2).

5.2.1 Level A. Fire extinguishers of like description and the required antifreeze charges (when furnished) packaged as specified in 5.1, shall be packed together in a close-fitting box conforming to PPP-B-621, class 2, style optional; PPP-B-601, overseas type, grade B, style optional; or PPP-B-585, class 3, style optional. The boxes shall be closed and strapped in accordance with the appendix to the applicable box specification.

5.2.2 Level B. Fire extinguishers of like description and the required antifreeze charges, (when furnished) packaged as specified in 5.1, shall be packed as specified for level A except that domestic containers shall be used or packed in a close-fitting box conforming to PPP-B-636, or PPP-B-640, class 2, weather resistant, style optional. The box shall be closed and strapped in accordance with the appendix to the box specification.

5.2.3 Commercial.

5.2.3.1 Military agencies. The extinguishers and charges, packaged as specified in 5.1, shall be packed in accordance with MIL-STD-1188.

5.2.3.2 Civil agencies. The extinguishers and antifreeze charges of like description, packaged as specified in 5.1, shall be packed in containers to insure delivery at destination, provide for redistribution by the initial receiving activity, and be acceptable by common carrier under the National Motor Freight Classification and Uniform Freight Classification.

5.3 Marking.

5.3.1 Military agencies. Marking for military levels of protection shall be in accordance with MIL-STD-129. Commercial marking shall be in accordance with MIL-STD-1188.

5.3.2 Civil agencies. Marking shall be as specified in the contract or purchase order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

6. NOTES

6.1 Intended use. Extinguishers covered by this specification are suitable for use on class A fires, i.e., rubbish, textiles, wood, and paper.

6.2 Ordering data. Purchasers should select the preferred options permitted herein and include the following information in procurement documents:

(a) Title, number and date of this specification.
(b) Type(s) of extinguisher required (see 1.2.1).
(c) The time frame required for submission of first produced extinguisher(s) and number of extinguishers required (see 3.2).
(d) Tank material required, if other than sheet steel (see 3.6).
(e) Antifreeze charge required (see 3.13).
(f) When shape-symbol marking is not required (see 3.15.2).
(g) Finish required if other than red paint or enamel (see 3.16).
(h) Degree of packaging and degree of packing required (see 5.1 and 5.2).
(i) Whether civil agency or Military marking is required (see 5.3).

6.3 First produced extinguisher. Any changes or deviations of production extinguishers from the approved first produced extinguishers during production will be subject to the approval of the contracting officer. Approval of the first produced extinguisher will not relieve the contractor of his obligation to furnish extinguishers conforming to this specification.

6.4 Corrosion-resistant steel. Corrosion-resistant steel tanks should be ordered only for heated areas where antifreeze is not required.

6.5 Recycled material. It is encouraged that recycled material be used, when practical, as long as it meets the requirements of this specification.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

O-E-940C

MILITARY INTERESTS:

Custodians:
Army - ME
Air Force - 99

Review activity:

Army - CE
DLA - CS

User activities:

Army - AT
Navy - YD, MC

CIVIL AGENCY COORDINATING ACTIVITIES:

GSA - FSS
HHS - FEC
DC GOV'T - DCG
DOT - SMS
TVA

Preparing activity:

Army - ME

Project 4210-0335

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See Section 2 of this specification to obtain extra copies and other documents referenced herein. Price cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

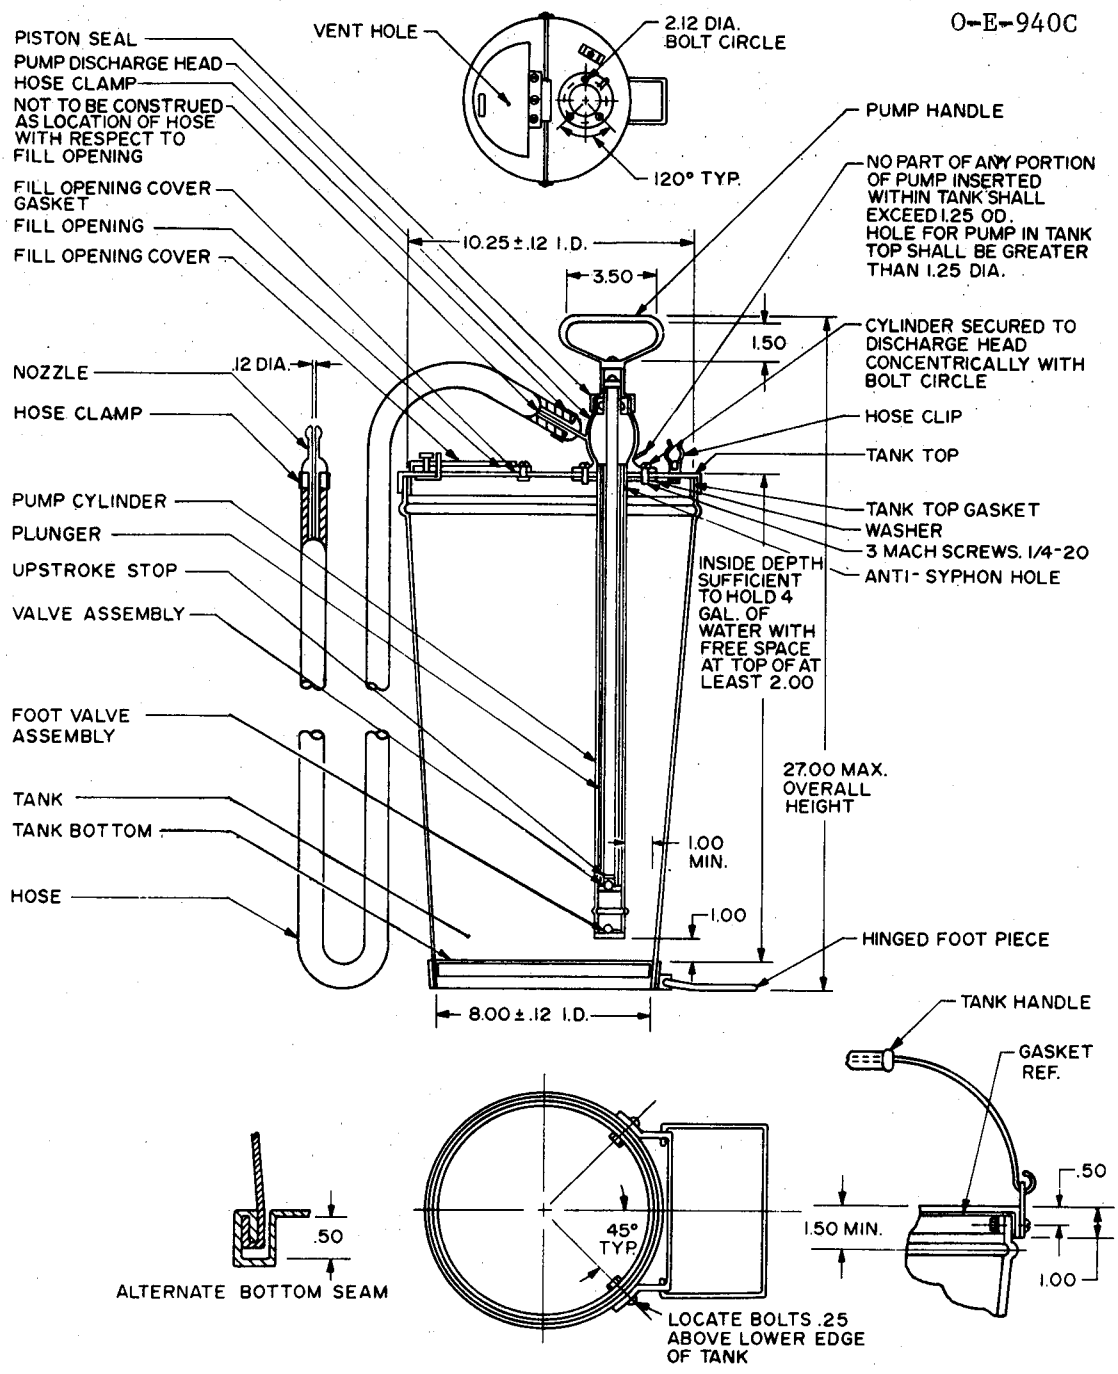


FIGURE I. Type III, demountable, nestable, fire extinguisher.

X-2722

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

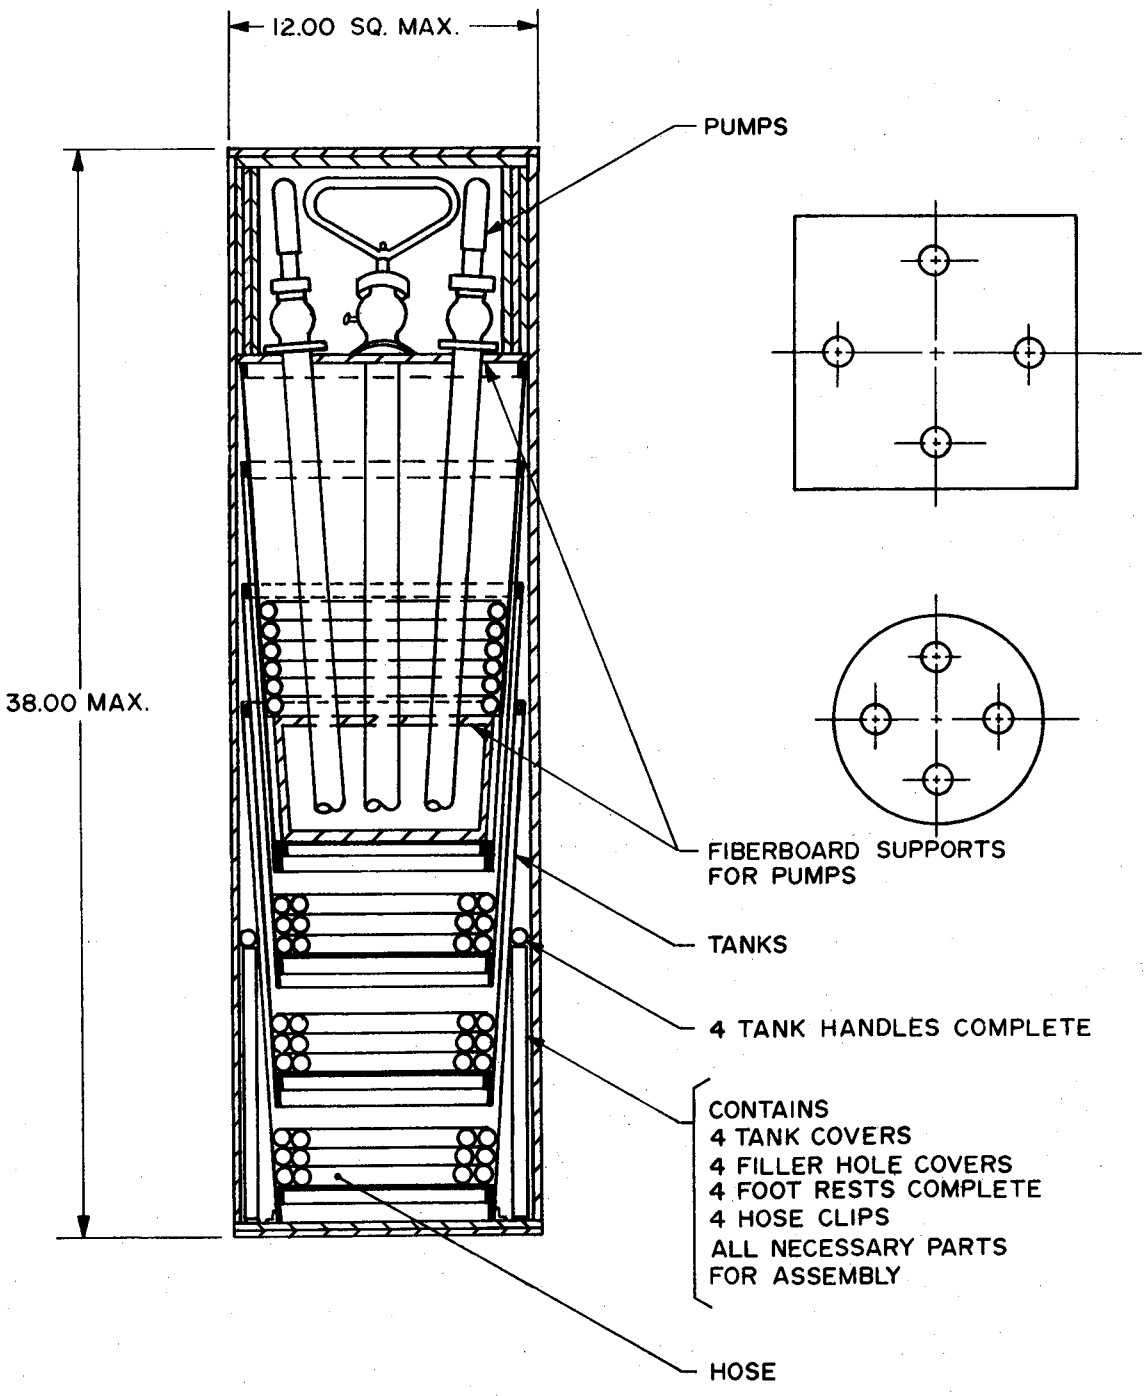


FIGURE 2. Packing for Type III, demountable, nestable fire extinguisher.

X-2787

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS: This form is provided to solicit beneficial comments which may improve this document and enhance its use. DoD contractors, government activities, manufacturers, vendors, or other prospective users of the document are invited to submit comments to the government. Fold on lines on reverse side, staple in corner, and send to preparing activity. Attach any pertinent data which may be of use in improving this document. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity. A response will be provided to the submitter, when name and address is provided, within 30 days indicating that the 1426 was received and when any appropriate action on it will be completed.
NOTE: This form shall not be used to submit requests for waivers, deviations or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

DOCUMENT IDENTIFIER *(Number)* AND TITLE

O-E-940C Extinguishers, Fire, Water, Hand-Pump, Tank, Portable

NAME OF ORGANIZATION AND ADDRESS OF SUBMITTER

☐ VENDOR ☐ USER ☐ MANUFACTURER

1. ☐ HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE? ☐ IS ANY PART OF IT TOO RIGID, RESTRICTIVE, LOOSE OR AMBIGUOUS? PLEASE EXPLAIN BELOW.

A. GIVE PARAGRAPH NUMBER AND WORDING

B. RECOMMENDED WORDING CHANGE

C. REASON FOR RECOMMENDED CHANGE(S)

2. REMARKS

SUBMITTED BY *(Printed or typed name and address — Optional)*

TELEPHONE NO.

DATE

DD FORM 1426 1 OCT 76

EDITION OF 1 JAN 72 WILL BE USED UNTIL EXHAUSTED.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.

FOLD

POSTAGE AND FEES PAID



OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

Commander
USA Mobility Equipment R&D Command
ATTN: DRDME-DE/DS
Ft. Belvoir, VA 22060

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:15Z
Check the source to verify that this is the current version before use.