[INCH-POUND]
A-A-59413
11 February 2000
SUPERSEDING
MIL-F-11712F
26 September 1990

COMMERCIAL ITEM DESCRIPTION

FLOODLIGHT, ELECTRIC, WEATHERPROOF

The General Services Administration has authorized the use of this commercial item description as a replacement for MIL-F-11712F for all federal agencies.

1. SCOPE. This commercial item description (CID) covers weatherproof electric floodlights (luminaires) intended for illuminating recreational and industrial areas and for military utility lighting.

2. CLASSIFICATION. The floodlights shall be of the following types, styles, and sizes. The floodlight type is determined by the lamp type. Style is determined by the shape of the reflector or enclosure at its widest point. Size is determined by the lamp wattage. The type, style, and size to be furnished shall be as specified (see 7.2(b)).

Type I - Incandescent
Type II - Halogen (quartz or tungsten)
Type III - Metal halide
Type IV - High-pressure sodium
Type V - Mercury vapor
Type VI - Fluorescent

Style A - Rectangular (length-to-width ratio less than 2)
Style B - Long rectangular (length-to-width ratio greater than 2)
Style C - Circular
Style D - Elliptical

Size - Sizes are shown in table I

Beneficial comments, recommendations, additions, deletions, clarifications, etc. and any other data which may improve this document should be sent to: Defense Supply Center Richmond (DSCR), ATTN: DSCR-VBD, 8000 Jefferson Davis Highway, Richmond, VA 23297-5610.

AMSC N/A FSC 6230

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

TABLE I. Sizes of floodlights.

Size, watts	Type I	Type II	Type III	Type IV	Type V	Type VI
20						X
25			X	X	X	
30						X
35				X		X
40						X
50			X	X		X
60						X
70			X	X		
75	X					X
100	X		X		X	X
150	X	X	X			
175			X		X	
200	X					
250	X	X	X	X	X	X
300	X	X				
400			X	X	X	
440						X
500	X	X				X
600				X		
750	X					
1000		X	X	X	X	X
1500	X	X	X			X

Note: The "X" denotes size availability.

3. SALIENT CHARACTERISTICS

3.1 General requirements. The floodlight (also called "luminaire") shall be new and one of the manufacturer's current models capable of operation in accordance with the requirements herein. All parts subject to wear, breakage, or distortion shall be accessible for adjustment, replacement, and repair.

3.2 Components. The floodlight shall include, as a minimum, the following components:

3.2.1 Housing. The housing shall be metal (e.g., aluminum, bronze, steel, stainless steel) or acrylic material as specified (see 7.2(c)). The housing shall hold and protect the ballast (when provided), lamp base(s), lamp(s), reflector, electrical circuitry, and lens. The housing shall provide access to the lamp(s) for replacement during floodlight use.

3.2.2 Ballast. Unless otherwise specified (see 7.2(d)), the ballast, when provided as part of the floodlight assembly, shall be that considered by the manufacturer as standard.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

3.2.3 Lamp base. The floodlight lamp base shall conform to the requirements of the American National Standards Institute (ANSI) C81.61, "American National Standard for Electrical Lamp Bases".

3.2.4 Lamp. Unless otherwise specified (see 7.2(e)), the lamp for the floodlight type and size selected shall conform to the requirements of the appropriate standard(s) in the ANSI C78 and National Electrical Manufacturers Association (NEMA) C78 series of lamp standards.

3.2.5 Reflector. The reflector shall be made of metal or acrylic as specified (see 7.2(f)). Unless otherwise specified (see 7.2(g)), the reflector shall have a reflectance factor of at least 70 percent when measured in accordance with Society of Automotive Engineers (SAE) J964, "Test Procedure for Determining Reflectivity of Rear View Mirrors".

3.2.6 Lens. If required, the floodlight shall be equipped with a lens of either the diffusing or the spreading type as specified (see 7.2(h)). When provided, the lens shall be clear, colorless, and heat resistant and be removable for floodlight maintenance and repair.

3.2.7 Mounting hardware. The floodlight housing shall have a bracket, trunnion, or other support compatible with the mounting surface hardware (e.g., flat surface, rounded surface, pendant, pole, pole top, crossarm, wall, or self-supporting free-standing) as specified (see 7.2(i)). If required, the housing and mounting shall permit horizontal and vertical angular adjustment of the light direction as specified (see 7.2(j)). When light direction adjustment is provided, the floodlight shall have a means to be locked in position after adjustment.

3.2.8 Electrical circuit. The floodlight shall operate from either a 120-, 208-, 240-, or 277-volt, single-phase, 60-hertz electrical circuit as specified (see 7.2(k)). If required for portability, the floodlight shall have a weatherproof, 6-foot, 3-conductor, cable and plug assembly as specified (see 7.2(l)).

3.2.9 Nameplate or label. Unless otherwise specified (see 7.2(m)), the floodlight shall have a nameplate or label affixed that shall include, as a minimum, the following information:

a. Manufacturer's name
b. Manufacturer's catalog number
c. Input voltage
d. Maximum line voltage
e. Ballast type (when provided) and tap voltage(s)
f. Lamp type, wattage, and voltage
g. Descriptive wiring diagram

3.2.10 Optional photometric characteristics. If required, the floodlight shall have optional photometric characteristics as specified (see 7.2(n)).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

3.3 Performance. Unless otherwise specified (see 7.2(o)), the lamp shall meet the average life and initial efficacy shown in tables II and III, respectively, for the floodlight type and size selected.

TABLE II. Floodlight lamp average life.

Lamp	Type I incandescent	Type II halogen	Type III metal halide	Type IV high-pressure sodium	Type V mercury vapor	Type VI fluorescent
Average life, hours	750	2,500 to 4,000	7,500 to 20,000	24,000	24,000	10,000 to 20,000

TABLE III. Floodlight lamp efficacy.

Size, watts	Type I incandescent		Type II halogen		Type III metal halide		Type IV high-pressure sodium		Type V mercury vapor		Type VI fluorescent	
	Avail-ability	Efficacy, lumens per watt	Avail-ability	Efficacy, lumens per watt	Avail-ability	Efficacy, lumens per watt	Avail-ability	Efficacy, lumens per watt	Avail-ability	Efficacy, lumens per watt	Avail-ability	Efficacy, lumens per watt
20											X	40
25					X	50	X	75	X	25		
30											X	50
35							X	80			X	55
40											X	60
50					X	60	X	85			X	65
60											X	70
70					X	70	X	90				
75	X	13									X	75
100	X	14			X	75			X	35	X	75
150	X	15	X	16	X	75						
175					X	80			X	40		
200	X	16										
250	X	17	X	20	X	85	X	115	X	45	X	80
300	X	18	X	22								
400					X	90	X	125	X	50		
440											X	85
500	X	19	X	24							X	85
600							X	135				
750	X	22										
1000			X	27	X	110	X	140	X	60	X	90
1500	X	25	X	30	X	115					X	90

3.3.1 Position retention. The floodlight shall retain the set and locked position of light direction within its horizontal and vertical range of angular adjustment under conditions normally encountered with the installation.

3.3.2 Weatherproofing. The floodlight shall meet Underwriters Laboratory (UL) 153, "Electric Portable Lamps", 1570, "Florescent Lighting Fixtures", 1571, "Incandescent Lighting Fixtures", or 1572, "High Intensity Discharge Lighting Fixtures", for wet locations for the type of floodlight selected. The floodlight shall be capable of withstanding 2 hours of exposure to simulated rainfall

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

(water spray of small droplets, not fine mist) intensity of 4 inches per hour without evidence of water penetration, water damage, loss of operation, or degradation of illumination.

3.4 Safety and health requirements. Type I and II floodlights shall conform to the requirements of UL 1571; type III, IV, and V floodlights shall conform to the requirements of UL 1572; and type VI floodlights shall conform to the requirements of UL 1570. A portable floodlight of any type shall conform to the requirements of UL 153. When specified (see 7.2(p)), the floodlight shall conform to the requirements of International Electrotechnical Commission (IEC) 60598-1, "Luminaires - Part 1: General requirements and tests", and 60598-2-5, "Luminaires - Part 2-5: Particular requirements - Floodlights". If a conflict arises between the UL and IEC standards, the IEC standards apply when specified.

4. REGULATORY REQUIREMENTS

4.1 Recovered materials. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4.2 Environmental protection. The item shall meet all applicable Environmental Protection Agency (EPA) restrictions in effect on the date of the contract. These regulations apply to the emission of materials hazardous to the environment or the user's health and shall be adhered to during the manufacturing, service, transportation, storage, and operation/use of the item.

5. QUALITY ASSURANCE PROVISIONS

5.1 Product conformance. The products shall meet the salient characteristics of this commercial item description; conform to the manufacturer's own drawings, specifications, standards, and quality assurance practices; and be the same item offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.1.1 Verification of conformance. Suitable verification of conformance to UL 153, UL 1570, UL 1571, and UL 1572 shall be either the UL label or certification of such conformance by an accredited testing laboratory satisfactory to the Government.

6. PACKAGING

6.1 Preservation, packing, and marking. For acquisition purposes, the products shall be preserved, packed, and marked as specified in the acquisition order (see 7.2(q)).

7. NOTES

7.1 Sources of documents.

7.1.1 FAR. The FAR may be obtained from the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402-0001.

7.1.2 ANSI standards. Copies of ANSI standards may be obtained from the American National Standards Institute, 11 West 42nd Street, New York, NY 10036.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

7.1.3 IEC standards. Copies of IEC standards may be obtained from the American National Standards Institute, 11 West 42nd Street, New York, NY 10036.

7.1.4 NEMA standards. Copies of NEMA standards may be obtained from the National Electrical Manufacturers Association, 1300 North 17th Street, Suite 1847, Rosslyn, VA 22209.

7.1.5 SAE standards. Copies of SAE standards may be obtained from the Society of Automotive Engineers, Inc., 400 Commonwealth Drive, Warrendale, PA 15096

7.1.6 UL standards. Copies of UL standards may be obtained from Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

7.2 Ordering data. Acquisition documents must specify the following:

a. Title, number, and date of this document
b. Type, style, and size of floodlight required (see 2)
c. Housing material, as specified (see 3.2.1)
d. Ballast, if different (see 3.2.2)
e. Lamp industry standard(s), if different (see 3.2.4)
f. Reflector material, as specified (see 3.2.5)
g. Reflectance factor, if different (see 3.2.5)
h. Lens, as specified (see 3.2.6)
i. Mounting hardware, as specified (see 3.2.7)
j. Angular adjustment of light direction, as specified (see 3.2.7)
k. Electrical circuit voltage, as specified (see 3.2.8)
l. Portable floodlight cable, as specified (see 3.2.8)
m. Nameplate or label, if different (see 3.2.9)
n. Optional photometric characteristics, as specified (see 3.2.10)
o. Performance, if different (see 3.3)
p. IEC safety standard, if required (see 3.4)
q. Packaging, as specified (see 6.1)

7.3 Sources of supply. The manufacturers and/or suppliers listed below are known to supply products which meet the salient characteristics requirements of this document. Competition is not limited to the listed firms.

Acculite Manufacturing
W. W. Grainger, Inc.
Hubbell Lighting
Killark Electrical
Magnaray International
McMaster-Carr Supply
MSC Industrial Supply
Multi Electrical
O-Z/Gedney

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.

7.4 Part identification number (PIN). The following part identification numbering procedure is for Government purposes and does not constitute a requirement for the contractor.

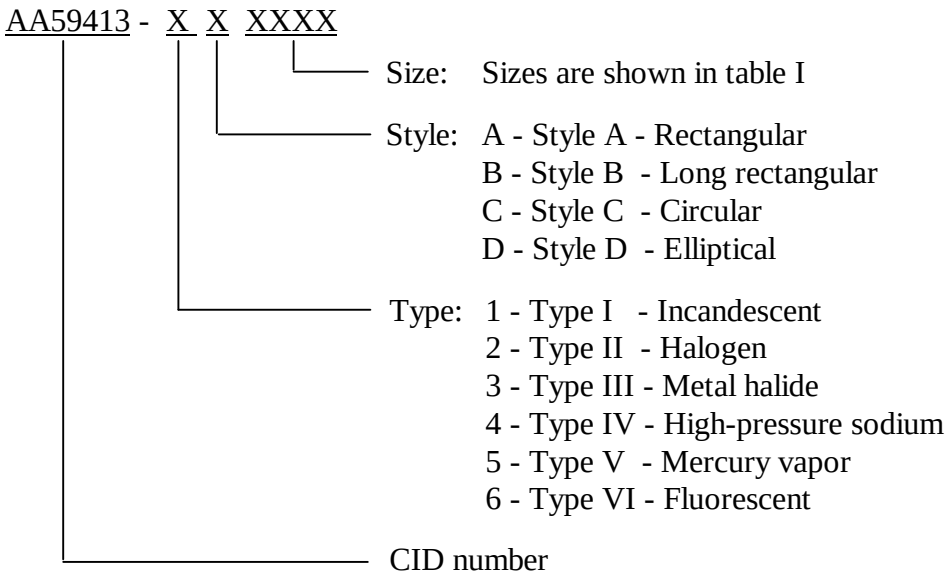

7.6 Subject terms (keywords).

Incandescent
Halogen (quartz or tungsten)
Metal halide
High-pressure sodium
Mercury vapor
Flourescent

MILITARY INTERESTS:

Custodians:
Army - CR4
Navy - YD
Air Force - 99

Reviewer:
Air Force - 82

CIVIL AGENCY
COORDINATING ACTIVITY:

GSA - 7FXE

Preparing activity:
DLA - GS

(Project 6230-1060)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:13Z
Check the source to verify that this is the current version before use.