INCH-POUND
MIL-DTL-23928/4E
24 October 2013
SUPERSEDING
MIL-DTL-23928/4D
28 November 2012

DETAIL SPECIFICATION SHEET

PANEL, ELECTRICAL, POWER DISTRIBUTION FOR DOUBLE AQB-A101, AQB-A102, AQB-A103 AND NQB-A101, NQB-A250 CIRCUIT BREAKERS, 2-12 CIRCUITS, WITH AND WITHOUT MANUAL TRANSFER, DRIPPROOF, TOTALLY ENCLOSED AND WATERTIGHT

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-23928.

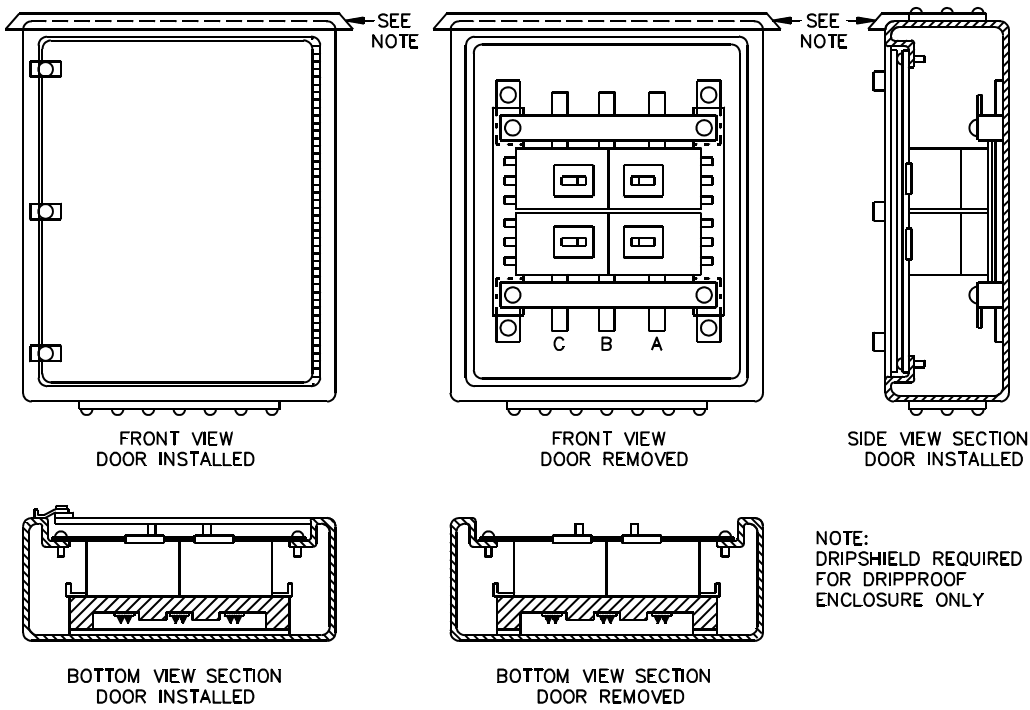


FIGURE 1. Distribution panel for AQB-A101, AQB-A102, AQB-A103, NQB-A101, NQB-A250 circuit breakers, dripproof and totally enclosed enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.



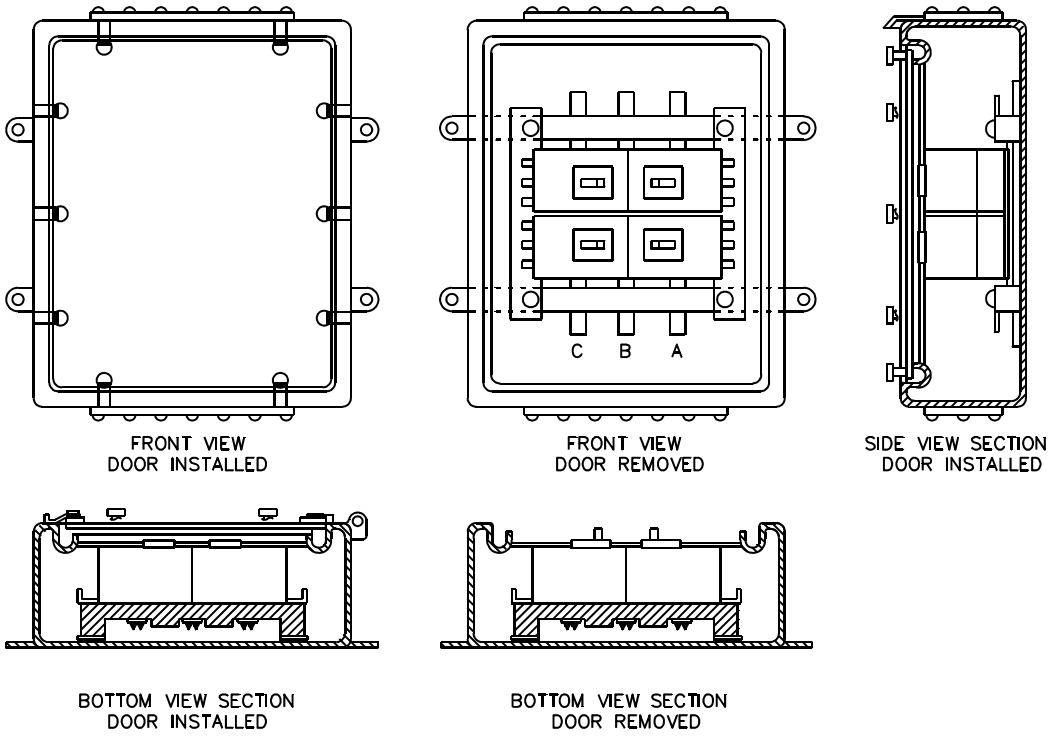


FIGURE 2. Distribution panel with double AQB-A101, AQB-A102, AQB-A103, NQB-A101, NQB-A250 circuit breakers watertight enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

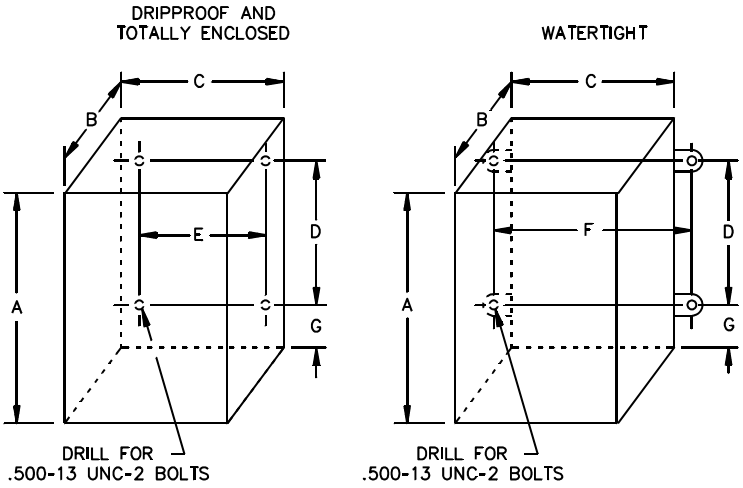

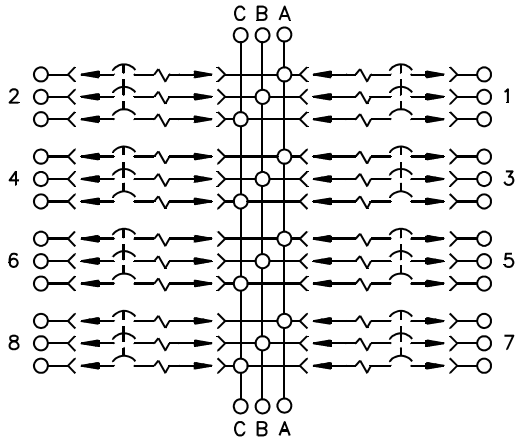

WIRING DIAGRAM,FRONT VIEW
(TYPICAL)

No. of dist ckts	Distribution only with and without split bus						
	A (max.)	B (max.)	C (max.)	D	E	F	G
2	22.13	7.13	20.00	10.63	13.31	22.00	5.75
4	26.25	"	"	14.75	"	"	"
6	30.37	"	"	18.87	"	"	"
8	34.50	"	"	23.00	"	"	"
10	38.62	"	"	27.12	"	"	"
12	42.75	"	"	31.25	"	"	"
14	47.00	"	"	35.50	"	"	"

PANEL MOUNTING DIMENSIONS IN INCHES

NOTE: Unless otherwise specified herein, tolerances shall be 0.02 for two place decimals and 0.005 for three place decimals.

FIGURE 3. Panel mounting dimensions and wiring diagram for figures 1 and 2.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

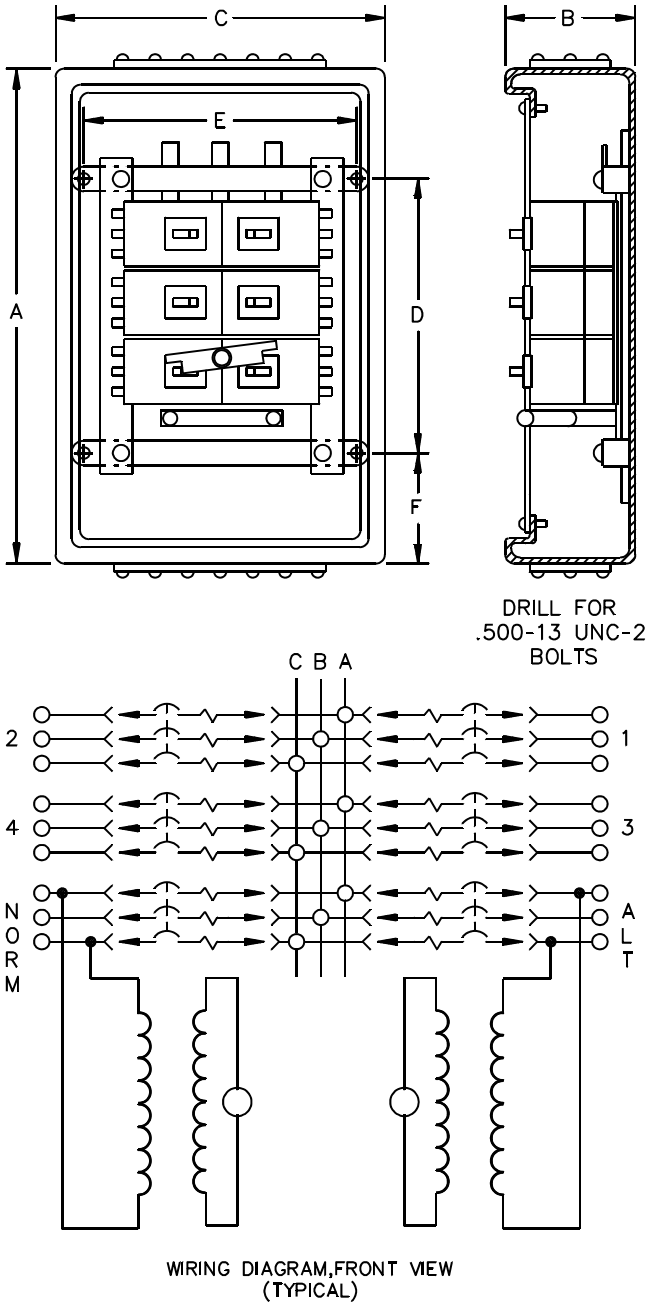


FIGURE 4. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 2-way 100 amp NQB circuit breaker transfer switches (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

No. of dist ckts	Distribution with one two-way 100A bus transfer					
	A (max.)	B (max.)	C (max.)	D	E	F
2	26.25	7.13	20.00	14.75	13.31	5.75
4	30.37	"	"	18.87	"	"
6	34.50	"	"	23.00	"	"
8	38.62	"	"	27.12	"	"
10	42.75	"	"	31.25	"	"
12	47.00	"	"	35.50	"	"

PANEL MOUNTING DIMENSIONS IN INCHES

NOTE: Unless otherwise specified herein, tolerances shall be 0.02 for two place decimals and 0.005 for three place decimals.

FIGURE 4. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 2-way 100 amp NQB circuit breaker transfer switches (typical) - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

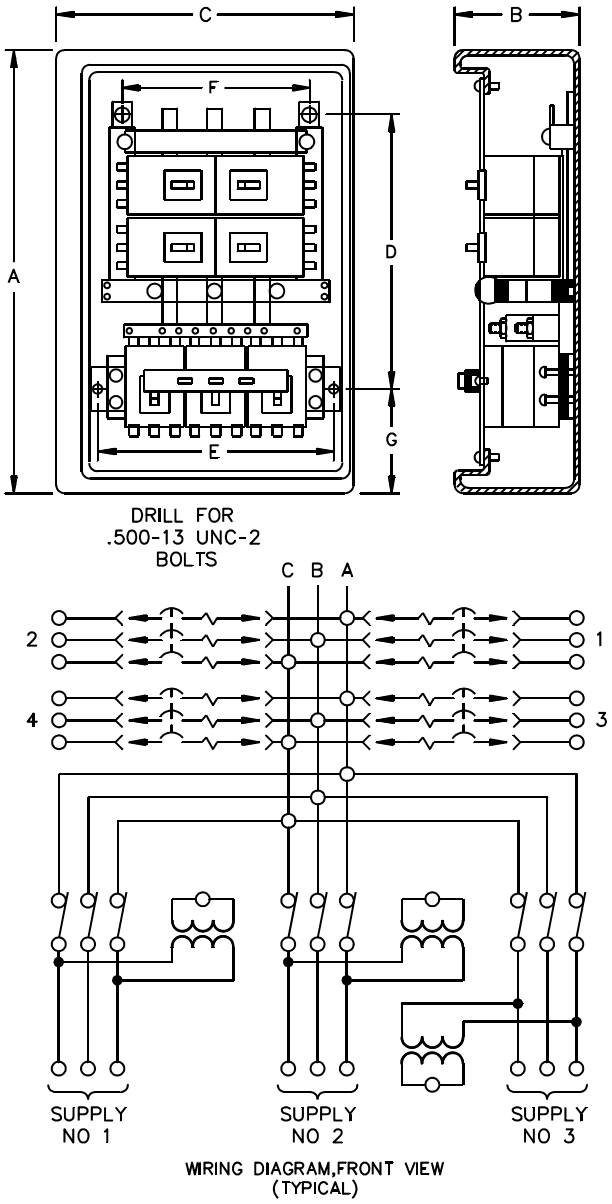


FIGURE 5. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 3-way 100 amp NQB circuit breaker transfer switches (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

No. of dist ckts	Distribution with one three-way 100A bus transfer						
	A (max.)	B (max.)	C (max.)	D	E	F	G
4	34.87	7.56	24.00	19.62	21.25	13.31	7.25
6	39.12	"	"	23.75	"	"	"
8	43.37	"	"	27.87	"	"	"
10	47.62	"	"	32.00	"	"	"
12	53.37	"	"	36.12	"	"	"

PANEL MOUNTING DIMENSIONS IN INCHES

NOTE: Unless otherwise specified herein, tolerances shall be 0.02 for two place decimals and 0.005 for three place decimals.

FIGURE 5. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 3-way 100 amp NQB circuit breaker transfer switches (typical) - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

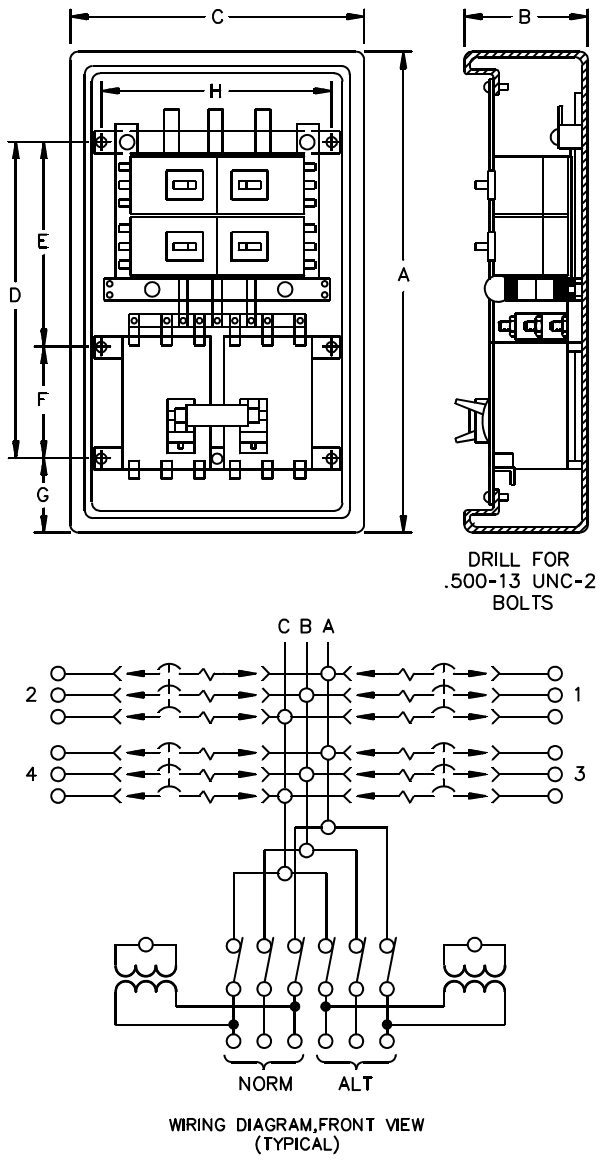


FIGURE 6. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 2-way 250 amp NQB circuit breaker transfer switches (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

No. of dist ckts	Distribution with two-way 250A bus transfer							
	A (max.)	B (max.)	C (max.)	D	E	F	G	H
4	39.13	9.125	26.00	24.38	10.00	14.38	7.31	20.75
6	43.38	"	"	28.63	14.25	"	"	"
8	47.63	"	"	32.88	18.50	"	"	"
10	53.38	"	"	38.83	24.25	"	"	"
12	57.63	"	"	42.88	28.50	"	"	"

PANEL MOUNTING DIMENSIONS IN INCHES

NOTE: Unless otherwise specified herein, tolerances shall be 0.02 for two place decimals and 0.005 for three place decimals.


FIGURE 6. Distribution panel with double AQB-A101, AQB-A102, AQB-A103 circuit breakers with 2-way 250 amp NQB circuit breaker transfer switches (typical). - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

TABLE I. Part or identifying numbers (PIN's).

Dash number	Number of circuits	Symbol number and enclosure type			Panel type
		Dripproof (DP)	Totally enclosed (TE)	Watertight (WT)	
01	2	2521	2521.1	2521.2	Distribution panel
02	4	2522.2	2522.3	2522.4	
03	6	2523.2	2523.3	2523.4	
04	8	2531.2	2531.3	2531.4	
05	10	2532.2	2532.3	2532.4	
06	12	2533.2	2533.3	2533.4	
11	4	2511	2511.1	2511.2	Distribution panel with (two) NQB-A101 circuit breakers for two-way 100A bus transfer
12	6	2511.3	2511.4	2511.5	
13	8	2511.6	2511.7	2511.8	
14	10	2511.9	2511.10	2511.11	
15	12	2511.12	2511.13	2511.14	
21	4	2512	2512.1	2512.2	Distribution panel with (three) NQB-A101 circuit breakers for three-way 100A bus transfer
22	6	2512.3	2512.4	2512.5	
23	8	2512.6	2512.7	2512.8	
24	10	2512.9	2512.10	2512.11	
25	12	2512.12	2512.13	2512.14	
31	4	2513	2513.1	2513.2	Distribution panel with (two) NQB-A250 circuit breakers for two-way 250A bus transfer
32	6	2513.3	2513.4	2513.5	
33	8	2513.6	2513.7	2513.8	
34	10	2513.9	2513.10	2513.11	
35	12	2513.12	2513.13	2513.14	

Example: The full PIN for an 8-circuit distribution panel with (two) watertight, 8-circuit panel is:

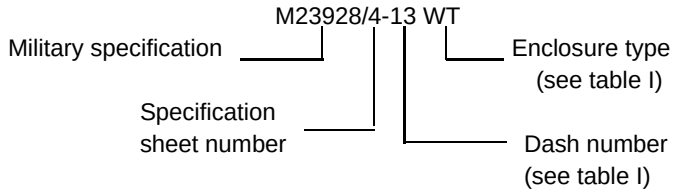

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Class: 1 - Dripproof (see note 1).
Class: 2 - Totally enclosed (see note 2).
Class: 3 - Watertight (see note 3).

Dimensions and configuration: See figures.

Composition: Steel or aluminum (see note 6).

Current rating: 400 amperes.

Voltage rating: 500 V ac and 250 V dc.

Short circuit capacity: 100,000 amperes.

Bus bar sizes (minimum): 400 amperes - 1 x 0.250 inch.

Circuit breakers: AQB-A101, AQB-A102, AQB-A103 and NQB-A101, NQB-A250 (see MIL-DTL-17361).

NOTES:

1. Class 1 panels with doors shall meet the 45 degree dripproof requirements, and panels without doors shall meet the 15 degree dripproof requirements in accordance with MIL-STD-108. When used, drip shield dimensions shall be as required to provide the specified degree of enclosure. Panels shall be furnished without doors only when specified in acquisition documents.
2. Class 2 panels shall meet the totally enclosed requirements as specified in MIL-STD-108.
3. Class 3 panels, with doors, gaskets, and drain opening, shall meet the watertight requirements as specified in MIL-STD-108.
4. A power available indicator light shall be provided for each circuit breaker used for bus transfer switching. The indicator light shall be placed in close proximity to the circuit breaker to which it refers and shall illuminate when power is available.
5. A split bus arrangement shall be provided when specified in the acquisition documents. The current rating shown shall apply to each separate bus grouping.
6. Panels shall be of aluminum construction unless steel is specified in the acquisition document.

Referenced documents. In addition to MIL-DTL-23928, this document references the following:

MIL-DTL-17361 MIL-STD-108

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

Custodians:
Navy - SH
DLA - CC

Preparing activity:
DLA - CC

(Project 5925-2013-005)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.