INCH-POUND


MIL-DTL-23928/5C
28 November 2012
SUPERSEDING
MIL-DTL-23928/5B
2 April 2004

DETAIL SPECIFICATION SHEET

PANEL, ELECTRICAL, MANUAL TRANSFER FOR DOUBLE AQB-A102, AQB-A103, NQB-A101 CIRCUIT BREAKERS, DRIPPROOF, TOTALLY ENCLOSED AND WATERTIGHT

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-23928.

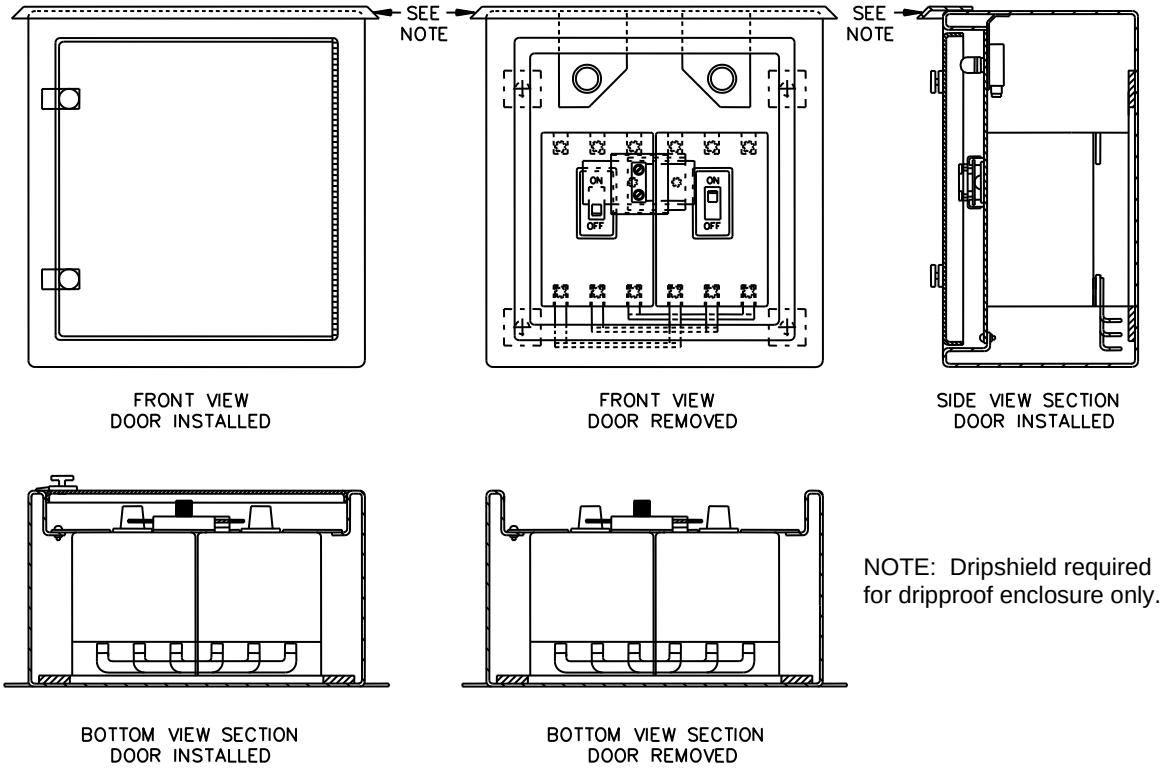

NOTE: Dripshield required for dripproof enclosure only.

FIGURE 1. Panel interlock arrangement of double AQB-A102, AQB-A103, NQB-A101 circuit breakers for manual transfer function, totally enclosed and dripproof enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.


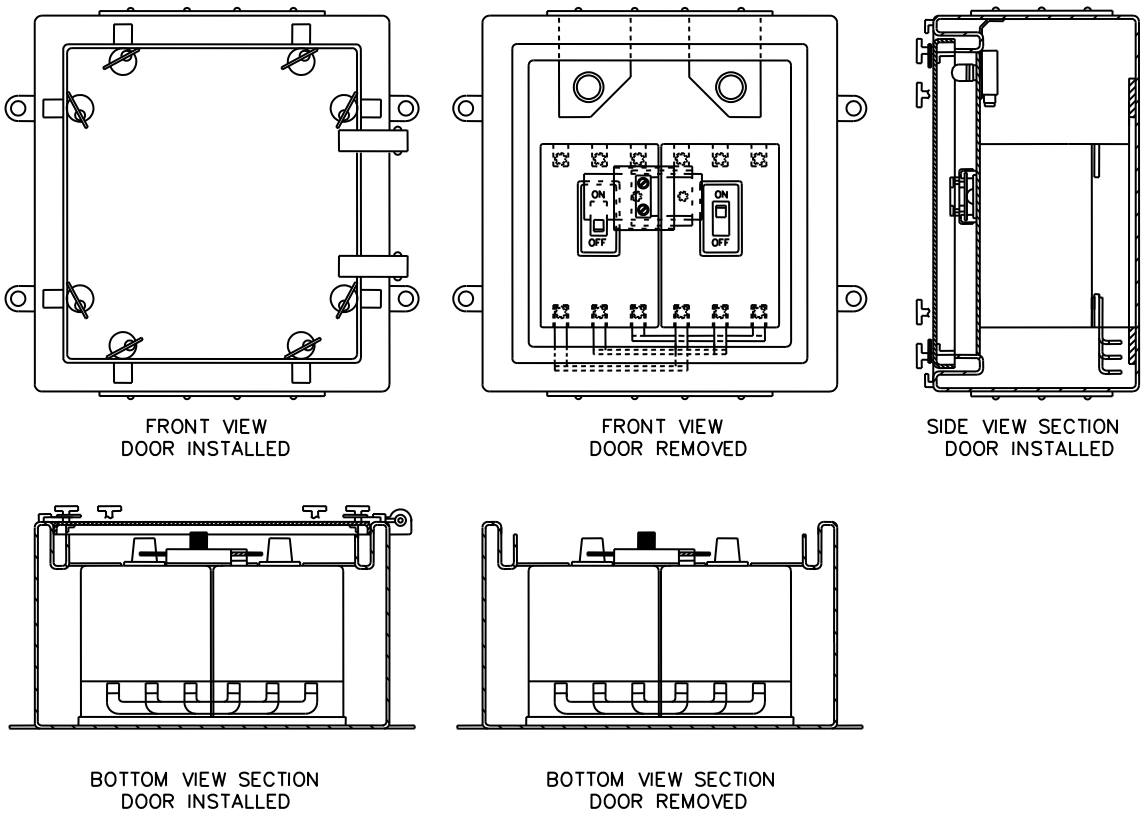


FIGURE 2. Panel interlock arrangement of double AQB-A102, AQB-A103, NQB-A101 circuit breakers for manual transfer function, watertight enclosure.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

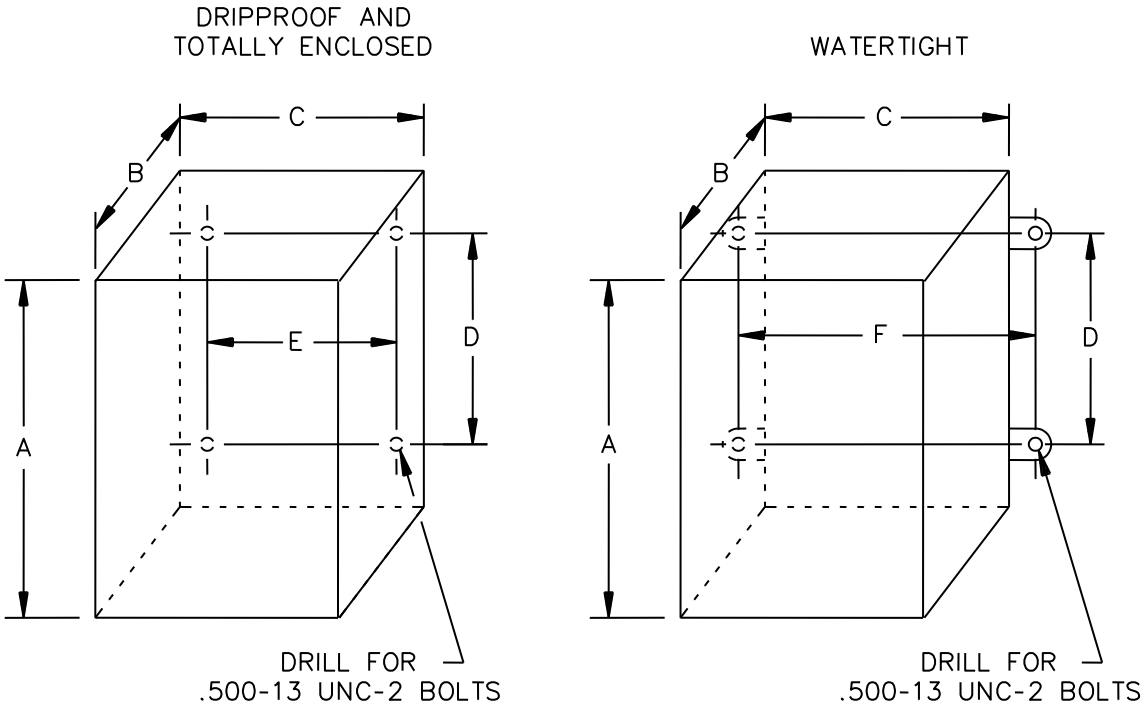

Letter	Inches
A	17.50 Max
B	7.31 Max
C	13.75 Max
D	13.50
E	11.25
F	15.75

NOTES: Unless otherwise specified herein, tolerances shall be as follows:

Two place decimals - plus or minus 0.02.
Three place decimals - plus or minus 0.005.

FIGURE 3. Panel and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.


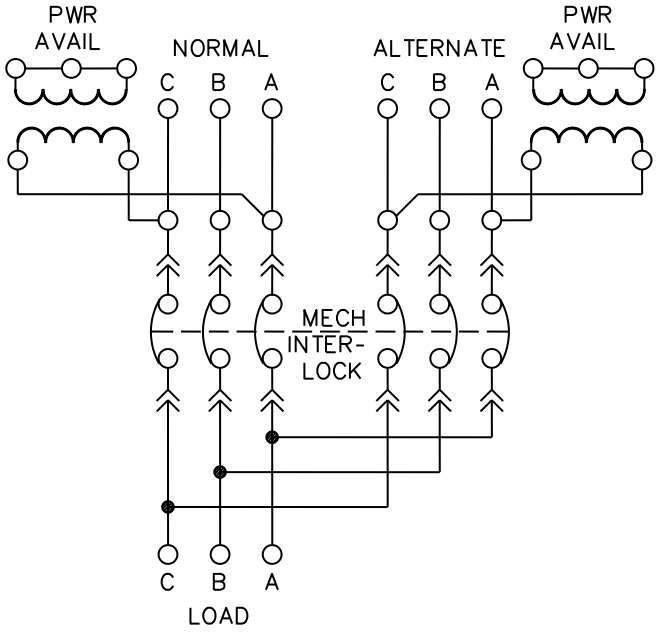


FIGURE 4. Wiring diagram, front view (typical).

TABLE I. Part or identifying numbers (PIN).

Dash number	Symbol number and enclosure type		
	Dripproof (DP)	Totally enclosed (TE)	Watertight (WT)
01	2471	2471.1	2471.2

Example: The full PIN for a watertight, manual bus transfer is:

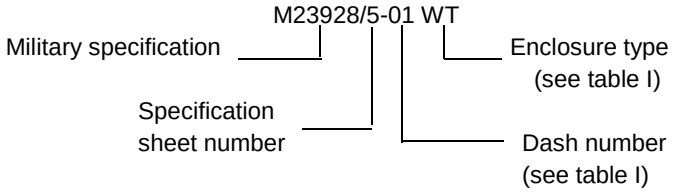

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Class:1: Dripproof (see note 1).
Class 2: Totally enclosed (see note 2).
Class 3: Watertight (see note 3).

Dimensions and configuration: See figures.

Composition: Steel or aluminum (see note 5).

Current rating: 100 amperes (A).

Voltage rating: 500 volts alternating current and 250 volts direct current.

Short circuit capacity: 100,000 A.

Bus bar size (min0imum): 1 x 1/4 inch.

Circuit breakers: AQB-A102, AQB-A103, NQB-A101 (see MIL-DTL-17361).

NOTES:

1. Class 1 panels with doors shall meet the 45 degree dripproof requirements and panels without doors shall meet the 15 degree dripproof requirements as defined by MIL-STD-108. When used, drip shield dimensions shall be as required to provide the specified degree of enclosure. Panels shall be furnished without doors only when specified in acquisition documents.
2. Class 2 panels shall meet the totally enclosed requirements as defined in MIL-STD-108.
3. Class 3 panels, with doors, gaskets, and drain opening, shall meet the watertight requirements as defined in MIL-STD-108.
4. A power available indicator light shall be provided for each circuit breaker used for bus transfer switching. The indicator light shall be placed in close proximity to the circuit breaker to which it refers and shall illuminate when power is available.
5. Unless steel is specified in the acquisition document, panels shall be of aluminum construction.

Referenced documents. In addition to MIL-DTL-23928, this document references the following:

MIL-DTL-17361 MIL-STD-108

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:
Navy - SH
DLA - CC

Preparing activity:
DLA - CC

(Project 5925-2011-008)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:20Z
Check the source to verify that this is the current version before use.