MIL-P-23928/8A(SH)
11 May 1979
SUPERSEDING
MIL-P-23928/8(SHIPS)
15 July 1969

MILITARY SPECIFICATION SHEET


PANEL, ELECTRICAL, MANUAL TRANSFER FOR DOUBLE NQB-A250

CIRCUIT BREAKERS, DRIPPROOF, TOTALLY ENCLOSED

AND WATERTIGHT

This specification sheet is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the panel described herein shall consist of this document and the latest issue of MIL-P-23928.

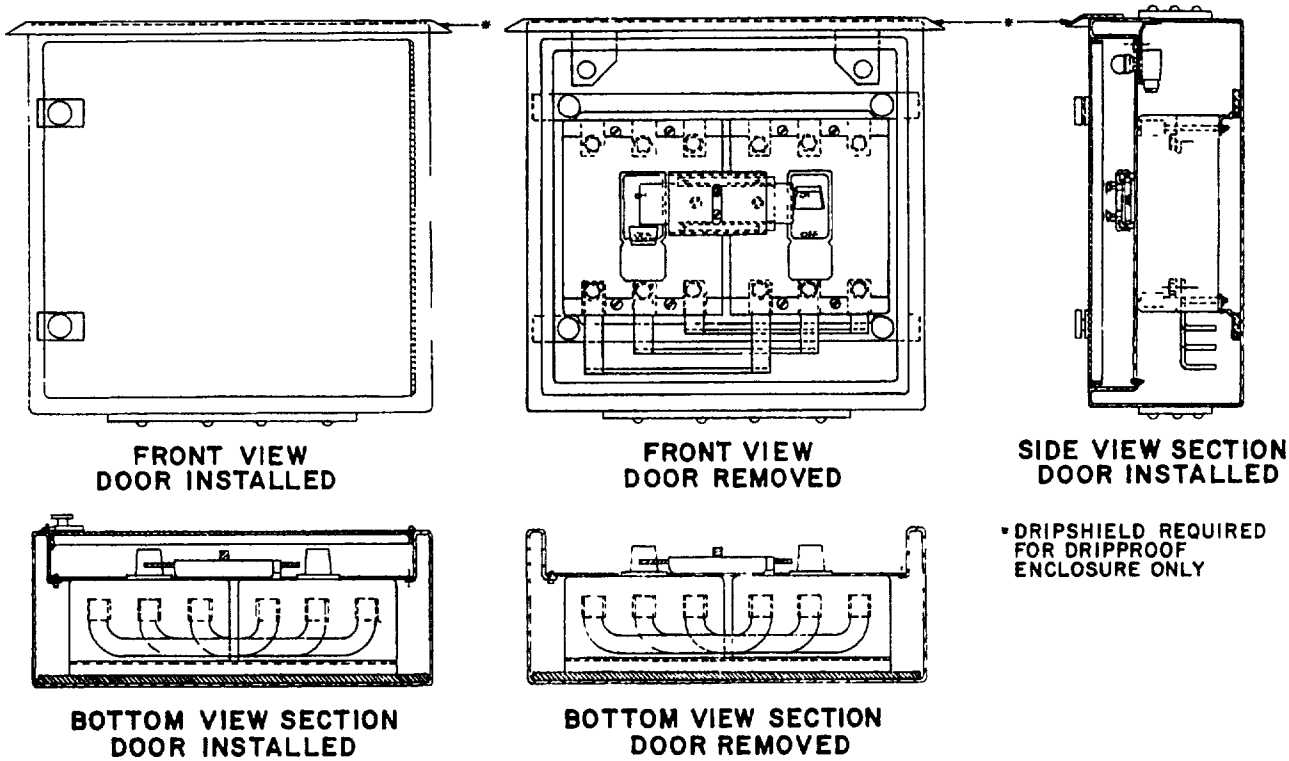

SH 11371

FIGURE 1. Manual transfer panel for double NQB-A250 circuit breakers, totally enclosed and dripproof enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.


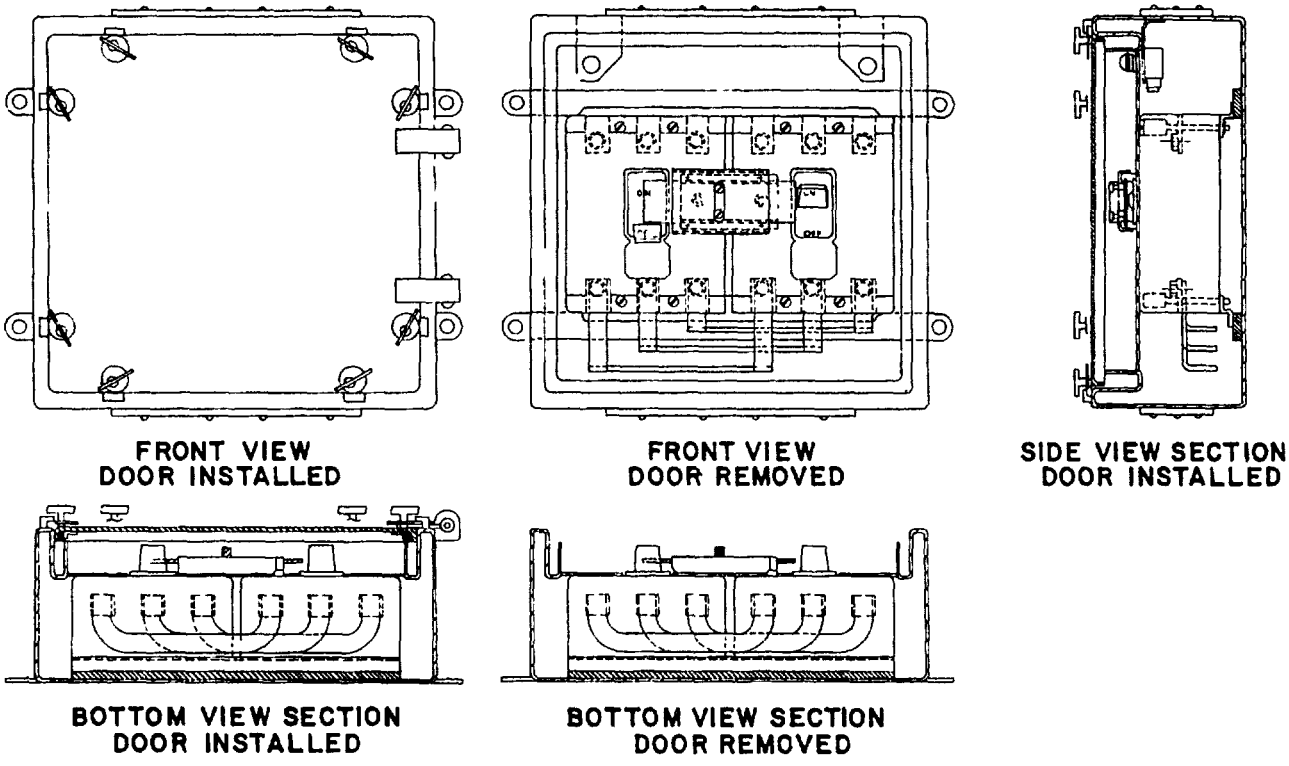



FIGURE 2. Manual transfer panel for double NQB-A250 circuit breakers, watertight (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

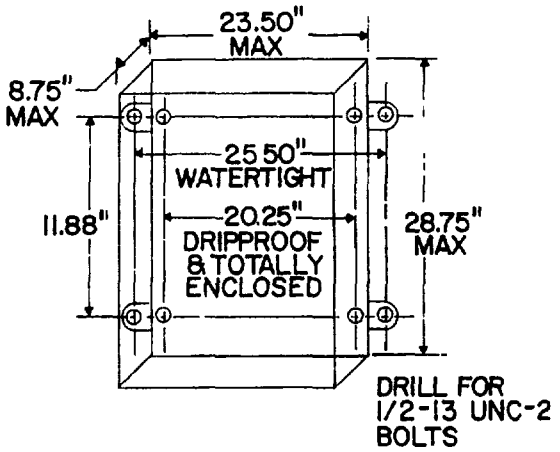

SH 11373

FIGURE 3. Panel and mounting dimensions.

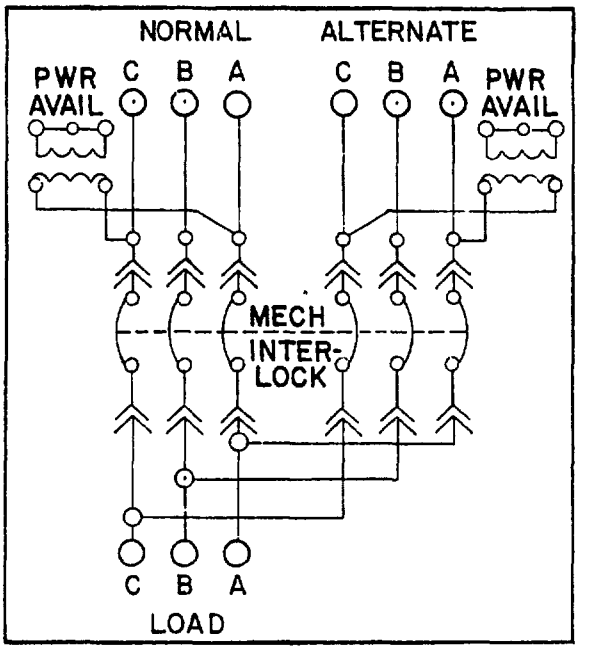

SH 11374

FIGURE 4. Wiring diagram, front view (typic

TABLE I. Part numbers.

Dash number	Symbol number and enclosure type		
	Dripproof (DP)	Totally enclosed (TE)	Watertight (WT)
01			

Example: The full part number for a double circuit breaker, watertight, manual transfer panel is:

M23928/8-01 WT

- M23928/8 — Military specification
- 8 — Specification sheet number
- 01 — Dash number (see table I)
- WT — Enclosure type (see table I)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Class: 1 - Dripproof (See note 1).
Class: 2 - Totally enclosed (See note 2).
Class: 3 - Watertight (See note 3).
Dimensions and configuration: See figures.
Composition: Steel or aluminum (See note 4).
Current rating: 400 amperes (A).
Voltage rating: 500 volts alternating current and 250 volts direct current.
Short circuit capacity: 100,000 A.
Bus bar size (minimum): 1 x 1/4 inch.
Circuit breakers: NQB-A250 (See MIL-C-17361).

NOTES:

1. Class 1 panels with doors shall meet the 45 degree dripproof requirements and panels without doors shall meet the 15 degree dripproof requirements as defined by MIL-STD-108. When used, drip shield dimensions shall be as required to provide the specified degree of enclosure. Panels shall be furnished without doors only when specified in acquisition documents.
2. Class 2 panels shall meet the totally enclosed requirements as defined in MIL-STD-108. Panels shall be furnished without doors only when specified in acquisition documents.
3. Class 3 panels with doors, gaskets and drain opening shall meet the watertight requirements as defined in MIL-STD-108.
4. Panels shall be of aluminum construction unless steel is specified in the acquisition document.
5. A power available indicator light shall be provided for each circuit breaker used for bus transfer switching. The indicator light shall be placed in close proximity to the circuit breaker to which it refers and shall illuminate when power is available.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 5925-N083-8)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS This form is provided to solicit beneficial comments which may improve this document and enhance its use DoD contractors, government activities, manufacturers, vendors, or other prospective users of the document are invited to submit comments to the government Fold on lines on reverse side, staple in corner, and send to preparing activity Attach any pertinent data which may be of use in improving this document If there are additional papers, attach to form and place both in an envelope addressed to preparing activity. A response will be provided to the submitter, when name and address is provided, within 30 days indicating that the 1426 was received and when any appropriate action on it will be completed

NOTE This form shall not be used to submit requests for waivers, deviations or clarification of specification requirements on current contracts Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

DOCUMENT IDENTIFIER *(Number)* AND TITLE

MIL-P-23928/8A(SH)

NAME OF ORGANIZATION AND ADDRESS OF SUBMITTER

☐ VENDOR ☐ USER ☐ MANUFACTURER

1 ☐ HAS ANY PART OF THE DOCUMENT CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE? ☐ IS ANY PART OF IT TOO RIGID, RESTRICTIVE, LOOSE OR AMBIGUOUS? PLEASE EXPLAIN BELOW.

A GIVE PARAGRAPH NUMBER AND WORDING

B RECOMMENDED WORDING CHANGE

C REASON FOR RECOMMENDED CHANGE(S)

2 REMARKS

SUBMITTED BY *(Printed or typed name and address — Optional)*

TELEPHONE NO

DATE

DD FORM 1 OCT 76 1426 Replaces edition of 1 Jan 72 which may be used S/N 0102-LF-001-4260

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

FOLD

POSTAGE AND FEES PAID
DEPARTMENT OF THE NAVY
DoD-316



OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

Commander
Naval Sea Systems Command (SEA 3112S)
Department of the Navy
Washington, DC 20362

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.