
INCH-POUND
MIL-P-23928/9C(SH)
5 December 1988
SUPERSEDING
MIL-P-23928/9B(SH)
18 August 1982

MILITARY SPECIFICATION SHEET

(C) PANEL, ELECTRICAL, SYMBOL 579, SUBMERSIBLE ENCLOSURE (15 FEET)

This specification sheet is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-P-23928(SH).

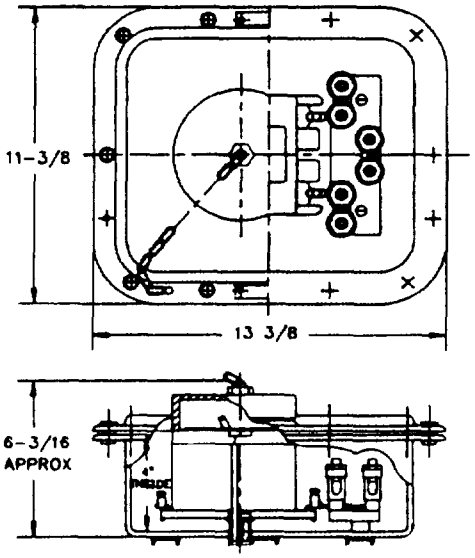


NOTE: Basic enclosure is the same as Military part or identifying number (PIN) M24142/6-001 of MIL-E-24142, except that the inside box depth is 4 inches.

FIGURE 1. Electrical panel for single AQB-A50 circuit breaker submersible enclosure (15 feet).


(C) denotes changes.

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

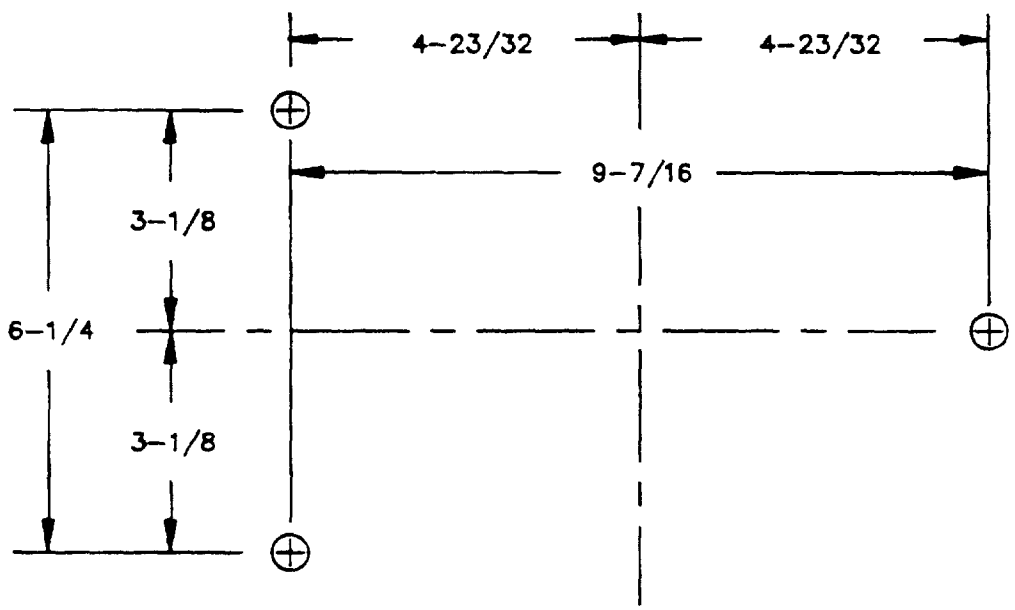



DRILL FOR
1/2-13 UNC-2 MOUNTING BOLTS

SH13231822

FIGURE 2. Mounting dimensions.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.

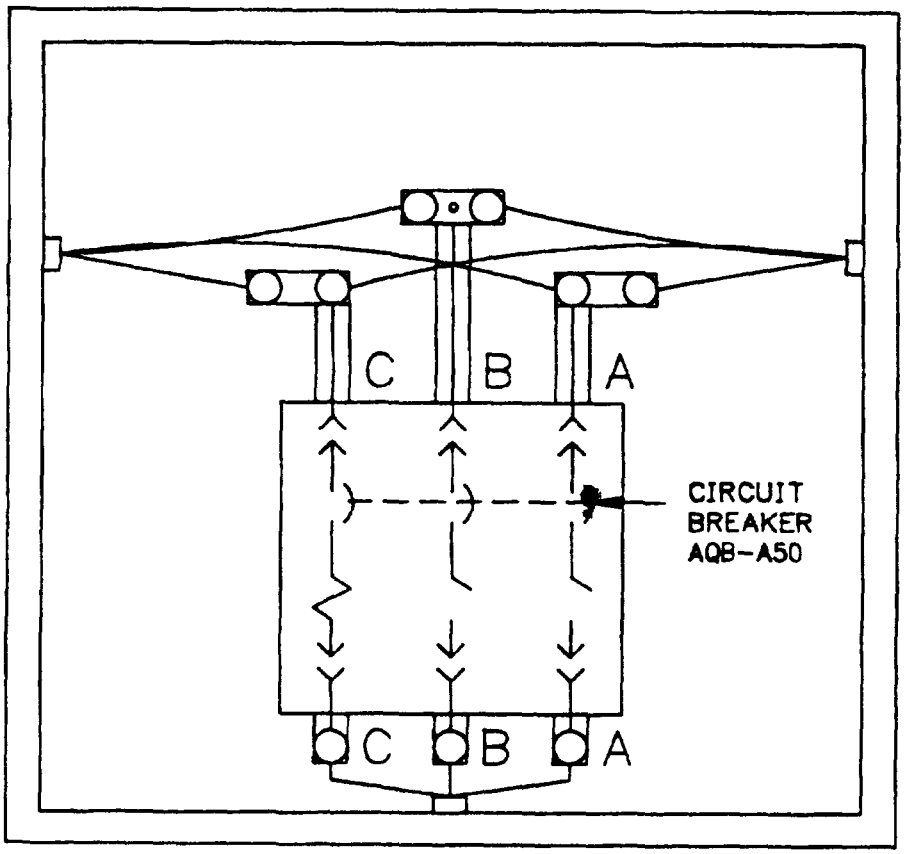


MAIN TERMINAL DESIGNED FOR MAXIMUM OF 75,000 C.M. CONDUCTOR. BRANCH TERMINALS DESIGNED FOR MAXIMUM OF 23,000 C.M. CONDUCTOR.

SH13231823

FIGURE 3. Wiring diagram, front view (typical).



Source: https://assist.dla.mil -- Downloaded: 202610-19T18:22Z
Check the source to verify that this is the current version before use.

Part or identifying number (PIN): The full PIN for a single circuit breaker in a submersible enclosure is: M23928/9-01.

REQUIREMENTS:

Class: 4 - Submersible (see note 1).
Dimensions and configuration: See figures.
Composition: Brass, steel or aluminum (see note 2).
Current rating: 50 amperes.
(C) Voltage: 500 Vac and 250 Vdc.
Short circuit capacity: 100,000 amperes.
Circuit breakers: AQB-A50 (see MIL-C-17361).

NOTES:

1. Class 4 panels shall meet the submersible enclosure requirement to 15 feet (6.5 pounds per square inch) in accordance with MIL-STD-108.
2. Panels shall be of brass construction unless steel or aluminum is specified in the acquisition document.

Preparing activity:
Navy - SH
(Project 5925-N118-04)



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:22Z
Check the source to verify that this is the current version before use.