| INCH-POUND |

MIL-V-18433C
3 January 1989
SUPERSEDING
MIL-V-18433B(YD)
22 March 1974

MILITARY SPECIFICATION

VALVES, TEMPERATURE-REGULATING (THERMOSTATICALLY CONTROLLED)

This specification is approved for use by all Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 Scope. This specification covers temperature-regulating valves designed to maintain fairly constant temperatures in heaters and storage tanks by regulation of the inlet fluid flow of the heating or cooling medium.

1.2 Classification. The temperature-regulating valves shall be of the following types, styles, and classes, as specified (see 6.2):

Type I - Temperature regulator.

Style A - Direct acting (closes with a temperature increase).
Style B - Reverse acting (opens with a temperature increase).
Style C - 3-way.

Class 1 - Self-operated.
Class 2 - Pilot-operated.
Class 3 - Electric-operated.

Type II - Combination pressure and temperature regulator.

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commanding Officer (Code 156), Naval Construction Battalion Center, Port Hueneme, CA 93043-5000, by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4820

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 202610-18T11:32Z
Check the source to verify that this is the current version before use.

2. APPLICABLE DOCUMENTS

2.1 Government documents.

2.1.1 Specifications and standards. The following specifications and standards form a part of this specification to the extent specified herein. Unless otherwise specified, the issues of these documents are those listed in the issue of the Department of Defense Index of Specifications and Standards (DODISS) and supplement thereto, cited in the solicitation (see 6.2).

SPECIFICATION

MILITARY

MIL-E-17555 - Electronic and Electrical Equipment, Accessories, and Provisioned Items (Repair Parts); Packaging of.

STANDARD

MILITARY

MIL-STD-129 - Marking for Shipment and Storage.

(Unless otherwise indicated, copies of federal and military specifications, standards, and handbooks are available from the Naval Publications and Forms Center, (ATTN: NPODS), 5801 Tabor Avenue, Philadelphia, PA 19120-5099.)

2.3 Non-Government publications. The following document(s) form a part of this specification to the extent specified herein. Unless otherwise specified, the issues of the documents which are DOD adopted are those listed in the issue of the DODISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DODISS are the issues of the documents which is current on the date of the solicitation (see 6.2).

AMERICAN NATIONAL STANDARDS INSTITUTE, INC. (ANSI)

ANSI B1.1 - Unified Inch Screw Threads (UN and UNR Thread Form).
ANSI B1.20.1 - Pipe Threads, General Purpose (Inch).
ANSI B1.20.3 - Dryseal Pipe Threads (Inch).
ANSI B31.1 - Power Piping.

(Application for copies should be addressed to the American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.)

MANUFACTURERS' STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS-SP-25 - Standard Marking System for Valves, Fittings, Flanges and Unions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

(Application for copies should be addressed to the Manufacturer's Standardization Society of the Valve and Fitting Industry, 127 Park Street, N.E., Vienna, VA 22180.

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA ICS 6 - Enclosures for Industrial Controls and Systems

(Application for copies should be addressed to the National Electrical Manufacturers Association, 2101 L Street, N.W., Washington, DC 20037.)

(Non-Government standards and other publications are normally available from the organizations which prepare or which distribute the documents. These documents also may be available in or through libraries or other informational services.)

2.3 Order of precedence. In the event of a conflict between the text of this specification and the references cited herein (except for associated detail specifications, specification sheets or military standards), the text of this specification takes precedence. Nothing in this specification, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

3. REQUIREMENTS

3.1 Description. Within the range indicated in table I, the valves shall automatically regulate fluid temperature by varying the flow of the heating or cooling medium. The valve assembly shall include a remote thermostatic bulb having flexible capillary tubing, a bellows, diaphragm, or other mechanical actuating device, a pilot valve, as required, and provisions that protect against overheating. The valve operating pressure, temperature, fluid service, and end connections shall be as specified (see 6.2). Valves of size 2-1/2-inch and larger shall be flanged. The type II unit shall be furnished with a pressure-regulating override to limit and regulate the maximum outlet pressure of the temperature-regulating valve. The type I, class 3, valve electrical characteristics shall be as specified in 3.8.5.

3.2 First article. When specified (see 6.2.1), the contractor shall furnish a valve for first inspection (see 4.2.2 and 6.4).

3.3 Standard commercial product. The valves shall, as a minimum, be in accordance with the requirements of this specification and shall be the manufacturer's standard commercial product. Additional or better features which are not specifically prohibited by this specification but which are a part of the manufacturer's standard commercial product, shall be included in the valves being furnished. A standard commercial product is a product which has been sold or is being currently offered for sale on the commercial market through advertisements or manufacturer's catalogs, or brochures, and represents the latest production model.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

3.3.1 Repair parts and service. Replacement, or repair parts, and service for the standard commercial product provided under this specification shall be available from the manufacturer's regular, or through commercial, parts distribution or service organizations.

3.4 Interchangeability. All valves of the same classification furnished with similar options under a specific contract shall be identical to the extent necessary to insure interchangeability of component parts, assemblies, accessories, and spare parts.

3.5 Materials. Materials used shall be free from defects which would adversely affect the performance or maintainability of individual components or of the overall assembly. Materials not specified herein shall be of the same quality used for the intended purpose in commercial practice. Unless otherwise specified herein, all equipment, material, and articles incorporated in the work covered by this specification are to be new and fabricated using materials produced from recovered materials to the maximum extent possible without jeopardizing the intended use. The term "recovered materials" means materials which have been collected or recovered from solid waste and reprocessed to become a source of raw materials, as opposed to virgin raw materials. Unless otherwise specified, none of the above shall be interpreted to mean that the use of used or rebuilt products are allowed under this specification.

3.6 Design. The unit shall be designed to conform to the requirements of ANSI B31.1. The design shall be such as to prevent conditions hazardous to personnel or deleterious to equipment. Screw threads and pipe threads shall be in conformance with ANSI B1.1, B1.20.1, or B1.20.3, as applicable. Valves shall be so designed, where feasible, that interior wearing parts may be repaired without removal of the valve assembly from its piping. Over-all valve dimensions shall be kept to a minimum consistent with the manufacturer's standard practice. Fluid-containing, thermostatic elements shall be hermetically sealed to preclude any mixing with the controlled medium. Unless otherwise specified (see 6.2), temperature calibration shall be accomplished at the mid-point of the temperature range specified.

3.7 Performance. Valves shall be capable of maintaining the controlled fluid temperature (see 4.5.2) within the accuracy requirements specified in table I for the temperature range and limiting pressures indicated. Valve capacities shall be in accordance with table II. Overheat protection shall be provided to prevent damage to valve internal parts and to the thermal sensing apparatus. The type II valve shall control outlet pressure in addition to temperature (see 4.5.2). Pressure adjustment shall be in definite proportion to temperature change. Maximum delivery pressure shall be maintained for the specified operating pressure within ± 1 pound per square inch (psi). Valve response time shall be kept to a minimum, consistent with the standard practice for the intended service.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

TABLE I. Valve characteristics.

	Type I			Type II
	Class 1	Class 2	Class 3	
Temperature range °F*	40	100	50	100
Accuracy °F	±4	±2	±4	±2
Inlet pressure psi max.**	125	250	200	600
Pressure differential psi min.	5	5	5	15

*Maximum sensed temperature shall not exceed 250°F for type I valves or 450°F for type II valves.
**Based on saturated steam pressure.

TABLE II. Valve capacities - minimum.

Nominal pipe size, inches	Steam service 35 psi inlet 20 psi outlet pounds/hour	Liquid service 5 psi pressure drop GPM	Air or gas service 5 psi inlet 0-3 psi outlet CFM @ 68°F
1/4	32	1.3	4
3/8	60	2.1	8
1/2	95	4.0	12
3/4	210	7.3	21
1	300	11.0	30
1-1/4	500	17.0	45
1-1/2	750	26.0	72
2	1,200	43.0	115
2-1/2	2,100	78.0	240
3	3,200	125.0	396
4	6,500	200.0	711
5	9,500	350.0	1,164
6	14,000	585.0	1,732

NOTE: The valve is set in the position it would assume at a temperature of 10°F above or below the temperature at which the valve is set to close, as applicable. The above capacities refer to the heating or cooling medium flowing through the main valve (see 4.5.1).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

3.8 Construction. When assembled and installed in the required piping circuit, the temperature-regulating valve shall operate as specified in 3.7 without evidence of binding, seizing, or permanent deformation caused by system temperature and pressure variations. Valve hysteresis shall be controlled in a positive manner. Direction of flow shall be clearly marked on the valve body. Internal fluid passages shall be free of extraneous matter that restrict fluid flow. When specified (see 6.2), a strainer shall be furnished to preclude the damaging effects of scale, dirt, and welding chips in the line. Thermal sensing and actuating components shall be so arranged as not to be in direct contact with the fluid through the main valve. The valve assembly shall include the following components:

3.8.1 Main valve. The main valve shall be a single- or double-seated, mechanically actuated, gate or globe valve. The valve shall be suitably balanced, and when intended for heating applications, shall be designed for dead-end shutoff. When required for cooling applications, a continuous flow bypass shall be furnished with the main valve. The valve body shall be bronze, brass, cast or ductile iron, or cast or forged steel, as specified (see 6.2). For pressures above 250 psi, the valve body shall be cast or forged steel. Trim material shall be suitable for the intended service. Unless otherwise specified (see 6.2), the trim shall be as follows:

3.8.1.1 Seats. Seats shall be either integral with the valve body or securely attached to the body, and shall be corrosion-resistant steel (CRES), hard faced alloy steel, or bronze when the intended operating medium is other than steam. Seat rings shall be renewable and so arranged that leakage between the seat and the body is precluded.

3.8.1.2 Disks, plugs, and gates. Disks, plugs, or gates, for service other than steam, shall consist of composition material or alloy steel hard bronze or CRES, and may be hard faced. Steam service shall be alloy steel or CRES, and may be hard faced. Pistons shall be designed for minimum clearance, compatible with nonbinding operation.

3.8.1.3 Stems. Valve stems shall be CRES. Valve stems and shafts that pass from a pressure zone to the atmosphere shall be sealed against leakage and shall be designed for nonbinding movement against the thrust loads imposed. Stem lubrication shall be provided when the packing material furnished is subject to extrusion from the stuffing box as a result of stem friction. Lubrication used shall not react chemically with the stuffing box or the packing. When packing is used, the manufacturer's standard composition material shall be furnished.

3.8.1.4 Springs. Springs shall be carbon steel or CRES. Carbon steel springs shall be made corrosion-resistant. Helical spring ends shall be ground smooth.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

3.8.1.5 Diaphragms. Diaphragms shall be made of rubber, leather, synthetic material reinforced with cloth, phosphor-bronze, nickel-copper alloy, or CRES. Diaphragm plates and other parts against which the diaphragm flexes shall be smooth and well rounded. The design shall be such that the diaphragm will not be subject to injurious twisting, wrinkling, or cutting.

3.8.1.6 Bellows. Bellows shall be of nickel-copper alloy, manganese-bronze, phosphor-bronze, CRES, or brass. When the bellows is in contact with steam, and in all cases when phosphor-bronze or brass is used, the bellows shall be of seamless two-ply construction.

3.8.2 Pilot valve. The pilot valve shall be either integral with or connected to the main valve by piping in accordance with the requirements specified herein. The pilot valve shall function with the thermostatic bulb to provide instant response to a sensed temperature change. The valve shall be weight, level, or spring-loaded, operated by the line pressure of the main valve and sized to provide fullstroke control of the main valve disk, plug, or gate. Interior metal parts shall be CRES. When provided, the body shall be of the same material as the main valve. The seat ring shall be of polytetrafluoroethylene or composition material suitable for the intended service. Connections shall be leaktight and the operating range shall be preset.

3.8.3 Type II valve pressure pilot. The type II valve pressure pilot shall be designed to control discharge pressure from the main valve. After sensing a pressure increase, the pilot shall act mechanically to control the main valve in accordance with the accuracy requirements of 3.7. Internal metal parts shall be CRES. When provided, the valve body shall be of the same material as the main valve. Seats shall be a CRES ring or CRES with a polytetrafluoroethylene ring. Connections shall be leaktight and the pressure adjustment shall be preset. The internal pilot chamber shall be self-draining.

3.8.4 Thermostatic control. The thermostatic bulb and the capillary tube which connects the bulb to the temperature (pressure-actuated) bellows or diaphragm, shall be a hermetically sealed assembly containing either a temperature-sensitive liquid, or a volatile fluid suitable for the temperature range and application specified. The materials of the bulb, capillary tubing, bellows or diaphragm, and the materials used in joining and sealing the assembly, shall not react chemically either with each other or with the fluid with which contact is made. Interior surfaces shall be freed of imperfections that affect control function or accuracy. The bulb shall be plain, equipped with a union connection or a separable socket, as specified (see 6.2). The volatile fluid-type bulb shall be sized to preclude vapor from entering the capillary tube. Capillary tubing shall be either extra heavy walled or armored and constructed of copper, nickel-plated copper, or brass. Armored tubing shall be protected by a spirally-wound armor of bronze or brass. A means to prevent coil unwinding shall be furnished. Tubing shall be capable of withstanding, without rupture, repeated slow bending at a radius of 4 inches through a 90-degree (°) angle. Unless otherwise specified (see 6.2), tubing shall be provided in 8-foot lengths. Tubing connections to the main valve shall be leaktight.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

3.8.5 Electric control. A normally closed solenoid control shall be supplied with the type I, class 3, valve. The solenoid shall be opened (energized) in response to a sensed temperature change and shall cause the main valve to admit or cut off fluid flow as required for the intended application. The control enclosure shall be a general purpose class, type I, in accordance with NEMA ICS 6. The coil shall be selected for high temperature, class H, continuous duty. The control body shall be brass and shall be appropriately sealed to prevent dust and moisture contamination. The control head and seat shall be constructed of CRES. Unless otherwise specified (see 6.2), the electrical supply shall be 120 volts (V), 60 hertz (Hz), alternating current.

3.9 Fastening devices. Screws, pins, bolts, and similar parts shall be installed with means for preventing loss of tightness. When subject to removal or adjustment, such parts shall not be swaged, peened, staked, or otherwise permanently deformed.

3.10 Identification marking. Assemblies and parts shall be marked for identification in accordance with MSS-SP-25.

3.11 Packing and maintenance tools. When specified (see 6.2), packing and maintenance tools shall be furnished.

3.12 Workmanship. The quality of workmanship shall be such as to produce valves that are in accordance with the requirements of this specification and that are so constructed as to insure the proper functioning of all parts of the unit.

3.12.1 Casting and forging. All castings shall be free from blowholes, porosity, hard spots, shrinkage defects, cracks, or other defects that may render the casting unsound for use. Forgings shall be free from scale, enclosures, cold shuts, mismatching, and other defects that may affect the structrural strength of the forgings. Repair processes, such as welding, peening, plugging, or filling with cold solder or metallic paste shall not be attempted without authorization of the contracting officer.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection requirements (examinations and tests) as specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to ensure supplies and services conform to prescribed requirements.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

4.1.1 Responsibility for compliance. All items must meet all requirements of sections 3 and 5. The inspection set forth in this specification shall become a part of the contractor's overall inspection system or quality program. The absence of any inspection requirements in the specification shall not relieve the contractor of the responsibility of ensuring that all products or supplies submitted to the Government for acceptance comply with all requirements of the contract. Sampling inspection, as part of manufacturing operations, is an acceptable practic to ascertain conformance to requirements, however, this does not authorize submission of known defective material, either indicated or actual, nor does it commit the Government to accept defective material.

4.2 Component and material inspection. Components and materials shall be inspected in accordance with all the requirements specified herein and in applicable referenced documents.

4.2.1 Classification of inspections. The inspection requirements specified herein are classified as follows:

a. First article inspection (see 4.2.2).
b. Quality conformance inspection (see 4.2.3).

4.2.2 First article inspection. The first article inspection shall be performed on one valve of each type when a first article is required. This inspection shall include the examination of 4.4 (see 3.2 and 6.2.1), and the tests of 4.5. The first article may be either a first production item or a standard production item from the supplier's current inventory provided the item meets the requirements of the specification and is representative of the design, construction, and manufacturing technique applicable to the remaining items to be furnished under the contract.

4.2.3 Quality conformance inspection. The quality conformance inspection shall include the examination of 4.5, the tests of 4.5, and the packaging inspection of 4.6.

4.3 Inspection lot. All units of the same type, style, and class offered to the Government at one time shall be considered a lot for purposes of inspection. The sample unit shall be one complete valve.

4.4 Examination. Each valve shall be examined for compliance with the requirements specified in section 3 of this specification. Any redesign or modification of the contractor's standard product to comply with specified requirements, or any necessary redesign or modification following failure to meet specified requirements shall receive particular attention for adequacy and suitability. This element of inspection shall encompass all visual examinations and dimensional measurements. Noncompliance with any specified requirements or presence of one or more defects preventing or lessening maximum efficiency shall constitute cause for rejection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

4.5 Tests. The first article shall be tested as specified in 4.2.2. Each production unit shall be tested as specified in 4.5.1 and 4.5.2. Failure to pass any test shall constitute cause for rejection.

4.5.1 Leakage tests. Valve pressure containing parts shall be subjected to a hydrostatic test pressure of twice the specified operating pressure (see 6.2) for a minimum of 3 minutes. Any leakage noted shall be cause for rejection. Single seated valves shall be tested for seat leakage at full-line pressure with one of the operating mediums in table II directed on the upstream side of the valve. The valve shall be in the position it would assume at a temperature of 10°F above or below the temperature at which the valve is set to close, as applicable. Any valve exhibiting a leakage of over 0.01 percent of rated capacity shall be rejected.

4.5.2 Operating test. The valve assembly shall be installed in test piping arranged with the intended application. The valve shall be tested with one of the operating mediums specified in table II to verify compliance with 3.7. At least three temperature adjustments shall be present over the specified range to cause the main valve to open and close in a complete cycle. Upon completion of the test, the valve assembly shall be removed from the test piping, dismantled, and inspected for defects. Leakage, any permanent deformation, or malfunction of any valve component during the test shall constitute cause for rejection. Type II valves shall also be tested for pressure regulation in accordance with 3.7.

4.6 Packaging inspection. The preservation, packing, and marking of the valves shall be inspected to verify conformance to the requirements of section 5.

5. PACKAGING

5.1 Preservation. Preservation shall be level A or C as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Valves. The valves shall be preserved and packaged in accordance with the applicable level A requirements of MIL-E-17555.

5.1.1.2 Electrical components. Electrical components shall be cleaned, preserved, and packaged in accordance with the applicable level A requirements of MIL-E-17555.

5.1.2 Level C. The valves shall be preserved and packaged in accordance with supplier's standard practice.

5.2 Packing. Packing shall be level A, B, or C as specified (see 6.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.
OFFICIAL BUSINESS

5.2.1 Level A. The valves shall be packed in accordance with the applicable level A requirements of MIL-E-17555.

5.2.2 Level B. The valves shall be packed in accordance with the applicable level B requirements of MIL-E-17555.

5.2.3 Level C. The valves shall be packed in a manner which will insure arrival at destination in satisfactory condition, and be acceptable to the carrier at lowest rates. Containers and packing shall comply with Uniform Freight Classification rules or National Motor Freight Classification rules.

5.3 Marking. In addition to any special marking required by the contract or order (see 6.2), all packaging markings shall be in accordance with the requirements of MIL-STD-129.

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

6.1 Intended use. The valves specified herein are intended to control temperatures by varying the fluid flow of a heat-transfer medium which is used to either heat or cool a separate fluid flow. Usually, the valve application involves utilization of steam flow to heat water in instantaneous heaters and storage tanks. In addition to these functions, the type II valve is capable of regulating the heated equipment supply pressure.

6.2 Ordering data.

6.2.1 Acquisition requirements. Acquisition documents should specify the following:

a. Title, number, and date of this specification.
b. Issue of DODISS to be cited in the solicitation, and if required, the specific issue of individual documents referenced (see 2.1.1 and 2.2).
c. Type, style, and class of valve required (see 1.2).
d. Valve operating pressure, temperature, fluid service, and end connections required (see 3.1 and 4.5.1).
e. When first article is required for inspection and approval (see 3.2 and 4.2.2).
f. Temperature calibration, if other than as specified (see 3.6)
g. When a strainer is required (see 3.8).
h. Main valve body material required (see 3.8.1).
i. Trim, if other than as specified (see 3.8.1).
j. Thermostatic bulb connection required (see 3.8.4).
k. Capillary tubing length, if other than as specified (see 3.8.4).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

l. Electrical characteristics of type I, class 3, valve, if other than as specified (see 3.8.5).
m. Packaging and maintenance tools, if required (see 3.11).
n. Level of preservation and level of packing required (see 5.1 and 5.2).
o. Marking required (see 5.3).

6.3 Options. The size of the temperature regulator should be selected for the intended application, rather than for the pipe size of the heater line, in which the valve is installed. In most applications, the valve will be smaller than the heater piping. For heating fluids with steam, the following approximation may be used to determine the valve size required:

a. For water; lbs. steam / hr.* = $\frac{GPM}{2}$ (temperature rise °F)

b. For fuel oil; lbs. steam / hr.* = $\frac{GPM}{4}$ (temperature rise °F)

c. For air; lbs. steam / hr.* = $\frac{GPM}{925}$ (temperature rise °F)

d. For radiation; lbs. steam / hr.* = $\frac{Sq.\ ft.\ EDR}{4}$

*Minimum flow at 5 PSI input pressure (saturated steam).
EDR is equivalent direct (steam) radiation.

Final valve size selection should be made in accordance with manufacturer's recommendations for the particular steam flow.

6.4 First article. When a first article inspection is required, the item will be tested and should be a first production item or it may be a standard production item from the contractor's current inventory as specified in 4.2.2. The first article should consist of one complete valve. The contracting officer should include specific instructions in acquisition documents regarding arrangements for examination, test, and approval of the first article.


6.5 Data requirements. When this specification is used in an acquisition and data are required to be delivered, the data requirements shall be developed as specified by an approved Data Item Description (DD Form 1664) and delivered in accordance with the approved Contract Data Requirements List (CDRL), incorporated into the contract. When the provisions of DOD FAR Supplement, Part 27, Sub-Part 27.475-1 (DD Form 1423) are invoked and the DD Form 1423 is not used, the data shall be delivered by the contractor in accordance with the contract or purchase order requirements.

Source: https://assist.dla.mil -- Downloaded: 2026l0-18T11:32Z
Check the source to verify that this is the current version before use.

6.6 Subject term (key word) listing.

Bronze
Copper
High Pressure
Iron
Military Specification
Nickel
Pressure
Regulating
Stainless Steel
Steam
Steel

6.7 Part Identifying Number (PIN). The PIN to be used for valves acquired to this specification are created as follows:

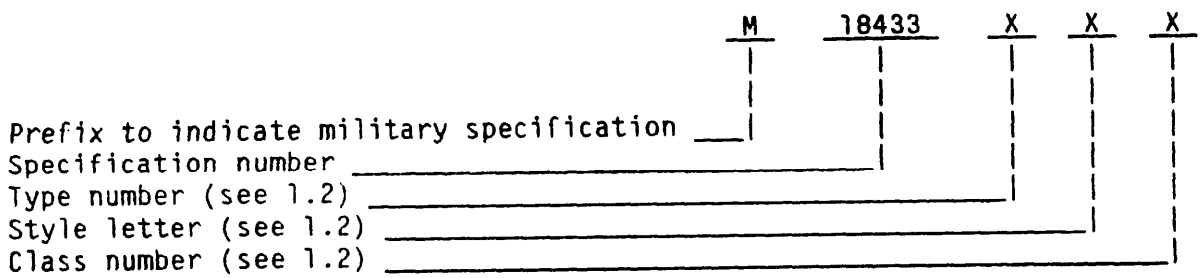

6.8 Changes from previous issue. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extensiveness of the changes.

Custodian:
Navy - YD

Review activity:
DLA - CS

Preparing activity:
Navy - YD

(Project 4820-N022)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

(See Instructions – Reverse Side)

1. DOCUMENT NUMBER	2. DOCUMENT TITLE
MIL-V-18433C	VALVES, TEMPERATURE-REGULATING (THERMOSTATICALLY CONTROLLED)

3a. NAME OF SUBMITTING ORGANIZATION	4. TYPE OF ORGANIZATION *(Mark one)*
	☐ VENDOR
	☐ USER
b. ADDRESS *(Street, City, State, ZIP Code)*	☐ MANUFACTURER
	☐ OTHER *(Specify)*:

5. PROBLEM AREAS

a. Paragraph Number and Wording:

b. Recommended Wording:

c. Reason/Rationale for Recommendation:

6. REMARKS

7a. NAME OF SUBMITTER *(Last, First, MI)* – Optional	b. WORK TELEPHONE NUMBER *(Include Area Code)* – Optional
c. MAILING ADDRESS *(Street, City, State, ZIP Code)* – Optional	8. DATE OF SUBMISSION *(YYMMDD)*

(TO DETACH THIS FORM, CUT ALONG THIS LINE.)

DD FORM 82 MAR 1426 PREVIOUS EDITION IS OBSOLETE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.

INSTRUCTIONS: In a continuing effort to make our standardization documents better, the DoD provides this form for use in submitting comments and suggestions for improvements. All users of military standardization documents are invited to provide suggestions. This form may be detached, folded along the lines indicated, taped along the loose edge *(DO NOT STAPLE)*, and mailed. In block 5, be as specific as possible about particular problem areas such as wording which required interpretation, was too rigid, restrictive, loose, ambiguous, or was incompatible, and give proposed wording changes which would alleviate the problems. Enter in block 6 any remarks not related to a specific paragraph of the document. If block 7 is filled out, an acknowledgement will be mailed to you within 30 days to let you know that your comments were received and are being considered.

NOTE: This form may not be used to request copies of documents, nor to request waivers, deviations, or clarification of specification requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document*(s)* or to amend contractual requirements.

(Fold along this line)

(Fold along this line)

DEPARTMENT OF THE NAVY

Commanding Officer (Code 156)
Naval Construction Battalion Center
Port Hueneme, CA 93043-5000

NO POSTAGE NECESSARY IF MAILED IN THE UNITED STATES

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

BUSINESS REPLY MAIL
FIRST CLASS PERMIT NO. 12503 WASHINGTON D. C.

POSTAGE WILL BE PAID BY THE DEPARTMENT OF THE NAVY

Commanding Officer
Code 156
Naval Construction Battalion Center
Port Hueneme, CA 93043-5000

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T11:32Z
Check the source to verify that this is the current version before use.