[INCH-POUND]
A-A-55545/1
March 11, 1999

COMMERCIAL ITEM DESCRIPTION
SPECIFICATION SHEET

FUSE CARTRIDGE, CLASS CC, 600 VOLTS (V) AC, TIME DELAY, 1/10 AMPERES (A) TO 30A

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for class CC, 600 V ac, time delay, fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 7.1).

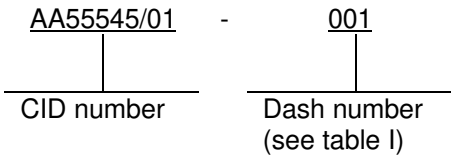

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Fuse cartridges supplied to this CID shall be as specified herein, and shall meet the requirements of Underwriters Laboratories (UL) 248-4 for class CC, low voltage fuses (see figure 1).

3.2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 600 V ac.

3.4 Short circuit interrupt rating. The ac short circuit interrupt rating shall be 200,000 amperes root mean square (RMS) symmetrical.

3.5 Opening time. The minimum opening time at 200 percent of rating shall be 12 seconds.

3.5 Accommodating fuseholder. Fuse cartridges supplied to this CID may be used with fuseholder CID A-A-55546.

3.7 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's (MFGR) standard commercial PIN.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAM, 3990 East Broad Street, Columbus, OH 43213-1199, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5920
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

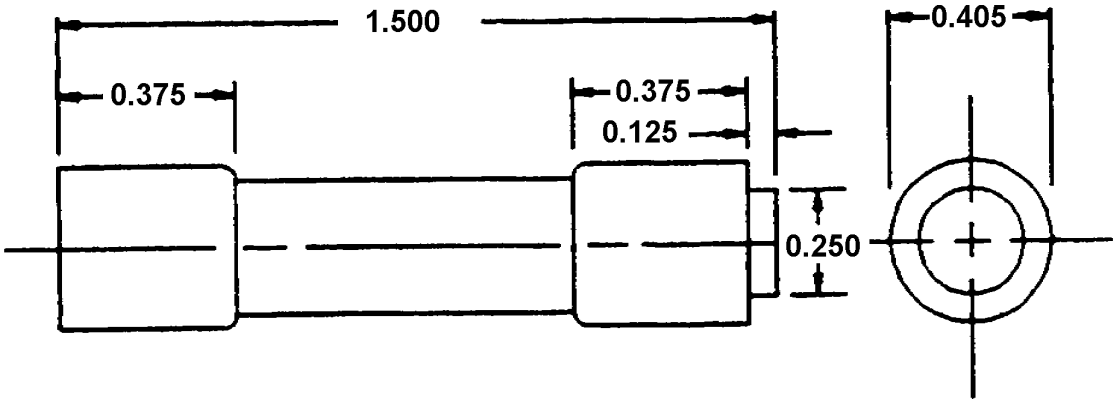

Inches	mm
0.125	3.175
0.250	6.35
0.375	9.52
0.405	10.28
1.500	38.1

NOTES:

1. Dimensions are in inches.
2. Tolerance is ± 0.005 inch (0.13 mm), unless otherwise specified.
3. The US Government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

AA55545/01-	Ampere rating	AA55545/01-	Ampere rating
001	0.1	023	2.5
002	0.125	024	2.8
003	0.15	025	3
004	0.187	026	3.2
005	0.2	027	3.5
006	0.25	028	4
007	0.3	029	4.5
008	0.4	030	5
009	0.5	031	5.6
010	0.6	032	6
011	0.75	033	6.25
012	0.8	034	7
013	1	035	7.5
014	1.125	036	8
015	1.25	037	9
016	1.3	038	10
017	1.4	039	12
018	1.5	040	15
019	1.6	041	17.5
020	1.8	042	20
021	2	043	25
022	2.25	044	30

4. REGULATORY REQUIREMENTS. This section is not applicable to this CID sheet.

5. QUALITY ASSURANCE PROVISIONS. Quality assurance provisions shall be as specified in A-A-55545.

6. PACKAGING. Packaging shall be as specified in A-A-55545.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuse cartridges to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.3 Source of documents. This section is not applicable to this CID.

Commercial Item Description

A-A-55545 - Fuse Cartridge, Class CC, 600 Volts (V) AC, General Requirements for.

A-A-55546 - Fuseholder Block, Class CC, 30 Amperes (A), 600 Volts (V) AC, One, Two, and Three Pole.

(Copies of federal specifications and standards are available from the Defense Automated Printing Service, Building 4D (DPM-DODSSP), 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 248-4 - Low-Voltage Fuses, Class CC, Standard For.

(Application for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.4 Ordering data. Ordering data shall be as specified in A-A-55545.

7.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

Manufacturer's CAGE	Manufacturer's name and address
71424	Gould Electronics, Incorporated 374 Merrimac Street Newburyport, MA 01950-1998 (978) 465-4237
71400	Cooper Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 394-2877

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

7.6 Part number (P/N) supersession data. This CID supersedes the following manufacturers' P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE II. P/N supersession data.

Dash number (see table I) AA55545/01-	MFGR'S CAGE	MFGR'S P/N 1/	MFGR'S CAGE	MFGR'S P/N 1/
001	71424	---	71400	FNQ-R 0.1
002	71424	---	71400	FNQ-R 0.125
003	71424	---	71400	FNQ-R 0.15
004	71424	---	71400	FNQ-R 0.187
005	71424	---	71400	FNQ-R 0.120
006	71424	ATDR 1/4	71400	FNQ-R 0.25
007	71424	---	71400	FNQ-R 0.3
008	71424	---	71400	FNQ-R 0.4
009	71424	ATDR 1/2	71400	FNQ-R 0.5
010	71424	---	71400	FNQ-R 0.6
011	71424	---	71400	FNQ-R 0.75
012	71424	ATDR 8/10	71400	FNQ-R 0.8
013	71424	ATDR 1	71400	FNQ-R 1
014	71424	ATDR 1 1/8	71400	FNQ-R 1.125
015	71424	ATDR 1 1/4	71400	FNQ-R 1.25
016	71424	---	71400	FNQ-R 1.3
017	71424	ATDR 1 4/10	71400	FNQ-R 1.4
018	71424	ATDR 1 1/2	71400	FNQ-R 1.5
019	71424	ATDR 1 6/10	71400	FNQ-R 1.6
020	71424	ATDR 1 8/10	71400	FNQ-R 1.8
021	71424	ATDR 2	71400	FNQ-R 2
022	71424	ATDR 2 1/4	71400	FNQ-R 2.25
023	71424	ATDR 2 1/2	71400	FNQ-R 2.5
024	71424	ATDR 2 8/10	71400	FNQ-R 2.8
025	71424	ATDR 3	71400	FNQ-R 3
026	71424	ATDR 3 2/10	71400	FNQ-R 3.2
027	71424	ATDR 3 1/2	71400	FNQ-R 3.5
028	71424	ATDR 4	71400	FNQ-R 4
029	71424	ATDR 4 1/2	71400	FNQ-R 4.5
030	71424	ATDR 5	71400	FNQ-R 5
031	71424	ATDR 5 6/10	71400	FNQ-R 5.6
032	71424	ATDR 6	71400	FNQ-R 6
033	71424	ATDR 6 1/4	71400	FNQ-R 6.25

See footnote at end of table.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

TABLE II. P/N supersession data – continued.

Dash number (see table I) AA55545/01-	MFGR'S CAGE	MFGR'S P/N 1/	MFGR'S CAGE	MFGR'S P/N 1/
034	71424	ATDR 7	71400	FNQ-R 7
035	71424	ATDR 7 1/2	71400	FNQ-R 7.5
036	71424	ATDR 8	71400	FNQ-R 8
037	71424	ATDR 9	71400	FNQ-R 9
038	71424	ATDR 10	71400	FNQ-R 10
039	71424	ATDR 12	71400	FNQ-R 12
040	71424	ATDR 15	71400	FNQ-R 15
041	71424	ATDR 17 1/2	71400	FNQ-R 17.5
042	71424	ATDR 20	71400	FNQ-R 20
043	71424	ATDR 25	71400	FNQ-R 25
044	71424	ATDR 30	71400	FNQ-R 30

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown.

7.7 Government users. To acquire information on obtaining these fuses from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-CM, Post Office Box 3990, Columbus, OH 43216-5000, or telephone (614) 692-7884.

MILITARY INTEREST:

Custodian:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-CC

Project 5920-0573-01

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.