[INCH-POUND]
A-A-55545/2
March 11, 1999

COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, CLASS CC, 600 VOLTS (V) AC, FAST ACTING, 1/10 AMPERES (A) TO 30A

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for class CC, 600 V ac, fast acting, fuse cartridges used for protection of equipment containing solid state devices or other electronic components requiring fast response on overloads. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 7.1).

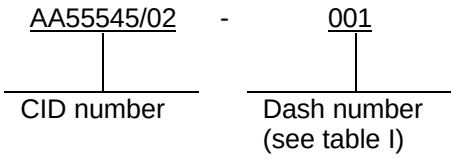

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Fuse cartridges supplied to this CID shall be as specified herein, and shall meet the requirements of Underwriters Laboratories (UL) 248-4 for class CC, low voltage fuses (see figure 1).

3.2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 600 V ac.

3.4 Short circuit interrupt rating. The ac short circuit interrupt rating shall be 200,000 amperes root mean square (RMS) symmetrical.

3.5 Accommodating fuseholder. Fuse cartridges supplied to this CID may be used with fuseholder CID A-A-55546.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAM, 3990 East Broad Street, Columbus, OH 43213-1199, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

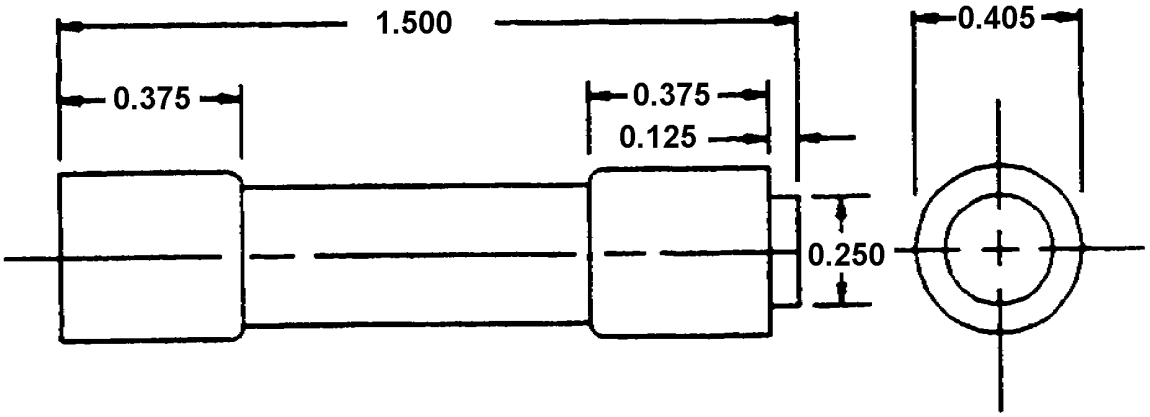

Inches	mm
0.125	3.175
0.250	6.35
0.375	9.52
0.405	10.28
1.500	38.1

NOTES:

1. Dimensions are in inches.
2. Tolerance is ± 0.005 inch (0.13 mm), unless otherwise specified.
3. The US Government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

3.7 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's (MFGR) standard commercial PIN.

TABLE I. Electrical characteristics.

AA55545/02-	Ampere rating	AA55545/02-	Ampere rating
001	0.1	014	4
002	0.125	015	5
003	0.2	016	6
004	0.25	017	7
005	0.3	018	8
006	0.5	019	9
007	0.75	020	10
008	1	021	12
009	1.5	022	15
010	2	023	20
011	2.5	024	25
012	3	025	30
013	3.5		

4. REGULATORY REQUIREMENTS. This section is not applicable to this CID sheet.

5. QUALITY ASSURANCE PROVISIONS. Quality assurance provisions shall be as specified in A-A-55545.

6. PACKAGING. Packaging shall be as specified in A-A-55545.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuse cartridges to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.3 Source of documents. This section is not applicable to this CID.

Commercial Item Description

A-A-55545 - Fuse Cartridge, Class CC, 600 Volts (V) AC, General Requirements for.

A-A-55546 - Fuseholder Block, Class CC, 30 Amperes (A), 600 Volts (V) AC, One, Two and Three Pole.

(Copies of federal specifications and standards are available from the Defense Automated Printing Service, Building 4D (DPM-DODSSP), 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 248-4 - Low-Voltage Fuses, Class CC, Standard For.

(Application for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.4 Ordering data. Ordering data shall be as specified in A-A-55545.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

7.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

Manufacturer's CAGE	Manufacturer's name and address
71424	Gould Electronics, Incorporated 374 Merrimac Street Newburyport, MA 01950-1998 (978) 465-4237
71400	Cooper Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 394-2877

7.6 Part number (P/N) supersession data. This CID supersedes the following manufacturers' P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

TABLE II. P/N supersession data.

Dash number (see table I) AA55545/02-	MFGR'S CAGE	MFGR'S P/N 1/	MFGR'S CAGE	MFGR'S P/N 1/
001	71424	ATMR 1/10	71400	KTK-R 0.1
002	71424	ATMR 1/8	71400	KTK-R 0.125
003	71424	ATMR 2/10	71400	KTK-R 0.2
004	71424	ATMR 1/4	71400	KTK-R 0.25
005	71424	ATMR 3/10	71400	KTK-R 0.3
006	71424	ATMR 1/2	71400	KTK-R 0.5
007	71424	ATMR 3/4	71400	KTK-R 0.75
008	71424	ATMR 1	71400	KTK-R 1
009	71424	ATMR 1 1/2	71400	KTK-R 1.5
010	71424	ATMR 2	71400	KTK-R 2
011	71424	ATMR 2 1/2	71400	KTK-R 2.5
012	71424	ATMR 3	71400	KTK-R 3
013	71424	ATMR 3 1/2	71400	KTK-R 3.5
014	71424	ATMR 4	71400	KTK-R 4
015	71424	ATMR 5	71400	KTK-R 5
016	71424	ATMR 6	71400	KTK-R 6
017	71424	ATMR 7	71400	KTK-R 7
018	71424	ATMR 8	71400	KTK-R 8
019	71424	ATMR 9	71400	KTK-R 9

See footnote at end of table.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

TABLE II. P/N supersession data – continued.

Dash number (see table I) AA55545/02-	MFGR'S CAGE	MFGR'S P/N 1/	MFGR'S CAGE	MFGR'S P/N 1/
020	71424	ATMR 10	71400	KTK-R 10
021	71424	ATMR 12	71400	KTK-R 12
022	71424	ATMR 15	71400	KTK-R 15
023	71424	ATMR 20	71400	KTK-R 20
024	71424	ATMR 25	71400	KTK-R 25
025	71424	ATMR 30	71400	KTK-R 30

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown.

7.7 Government users. To acquire information on obtaining these fuses from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-CM, Post Office Box 3990, Columbus, OH 43216-5000, or telephone (614) 692-7884.

MILITARY INTEREST:

Custodian:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-CC

Project 5920-0573-02

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.