[INCH-POUND]
A-A-55546
March 11, 1999


COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, CLASS CC, 30 AMPERES (A), 600 VOLTS (V) AC, ONE, TWO, AND THREE POLE

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for one, two, and three pole, 30 A, 600 V ac, class CC fuseholder blocks. Fuseholder blocks covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 7.1).

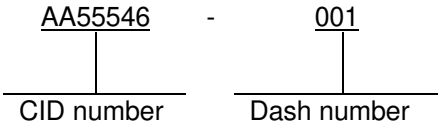

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Fuseholder blocks supplied to this CID shall be as specified herein (see figure 1).

3.2 Ampere rating. The ampere rating shall be 30 A maximum.

3.3 Voltage rating. The voltage rating shall be 600 V ac maximum.

3.4 Dielectric strength. The dielectric strength shall be 1,200 volts minimum.

3.5 Interrupting rating. This class CC fuseholder shall be used with class CC fuses that have an interrupting rating of 200,000 amperes maximum.

3.6 Fuseholder body. The fuseholder body shall be thermoplastic with a UL 94VO flammability rating.


3.7 Fuse cartridge accommodation. This fuseholder accepts 30 ampere, class CC fuse cartridges as called out in CID A-A-55545/1 and A-A-55545/2.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAM, 3990 East Broad Street, Columbus, OH 43213-1199, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

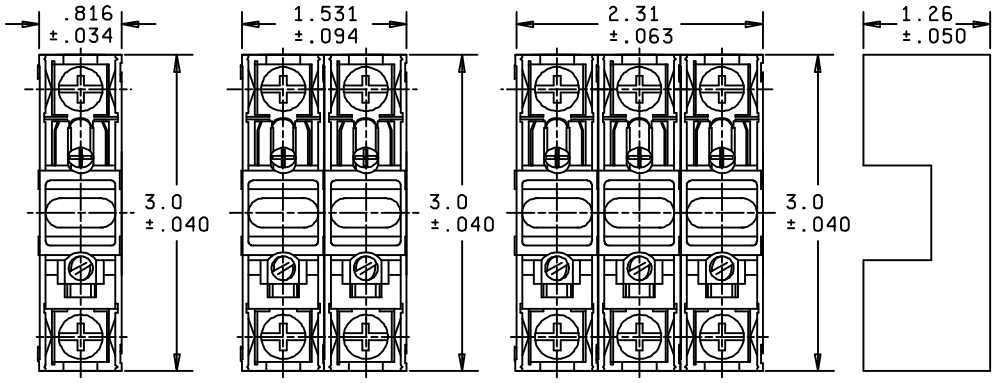

Inches	Mm	Inches	mm
.034	0.86	.816	20.73
.040	1.02	1.260	32.00
.050	1.27	1.531	38.88
.063	1.60	2.310	58.67
.094	2.38	3.000	76.20

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ±0.13mm (0.005 inch), unless otherwise specified.
3. The US Government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

FIGURE 1. Configuration and dimensions.

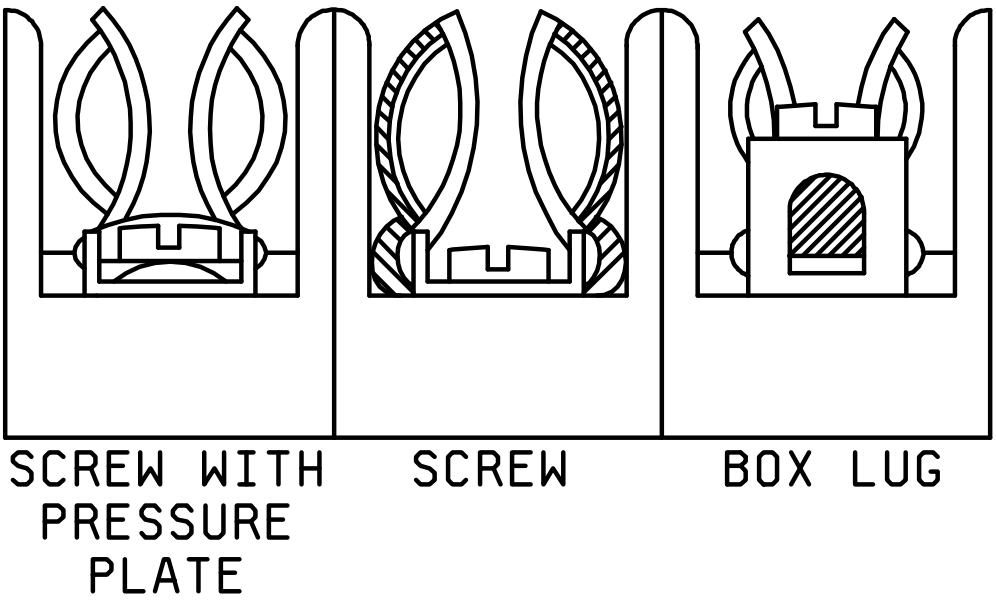


Figure 2. Wire termination configuration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

3.8 Wire termination. Wire termination shall be as specified in figure 2 and as follows:

a. Screw with pressure plate and quick connect terminal. For use with solid or stranded wire without terminal. Recommended where vibration will be a factor.

b. Screw with quick connect terminal. For use with spade lugs or ring terminals.

c. Box lug connector. For use with all types of wire without terminals.

3.9 Wire size. The maximum wire size shall be #6 CU for box lug connectors, #10 CU for pressure plate with quick connect terminals and #10 CU for the screw with quick connect terminals.

3.10 Fuse clips/quick connect terminal plating. Fuse clips and quick connect terminals shall be tin-plated copper alloy. Use of pure tin plating is prohibited as a final finish and as an undercoat. Use of tin-lead (Sn-Pb) finishes are acceptable provided that the minimum lead content is 3 percent.

3.11 Box lug material. The box lug material shall be copper.

3.12 Screw and captive pressure plate material. Screw and captive pressure plate material shall be zinc-plated steel.

3.14 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

TABLE I. Characteristics.

AA55546-	Ampere rating	Number of poles	Connector type	Maximum wire size
001 002 003	30	1 2 3	Screw with pressure plate with quick connect terminal	#10 CU
004 005 006	30	1 2 3	Screw with quick connect terminal	#10 CU
007 008 009	30	1 2 3	Box lug	#6 CU

4. REGULATORY REQUIREMENTS.

4.1 Recycled/recovered materials. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

5. QUALITY ASSURANCE PROVISIONS.

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

5.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 6 months.

b. The company must have sold 1,000 units meeting this CID in the commercial marketplace over the past 6 months.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

6. PACKAGING.

6.1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these fuse cartridges to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.3 Source of documents.

Commercial Item Description

A-A-55545/1	-	Fuse Cartridge, Class CC, 600 Volts (V) AC, Time Delay, 1/10 Amperes (A) to 30A.
A-A-55545/2	-	Fuse Cartridge, Class CC, 600 Volts (V) AC, Fast Acting, 1/10 Amperes (A) to 30A.

(Copies of federal specifications and standards are available from the Defense Automated Printing Service, Building 4D (DPM-DODSSP), 700 Robbins Avenue, Philadelphia, PA 19111-5094.)

Other Publications

UNDERWRITERS LABORATORIES, INCORPORATED (UL)

UL 94VO	-	Safety Tests for Flammability of Plastic Materials for Parts in Devices in Appliances, Standard For.

(Application for copies should be addressed to the Underwriters Laboratories, Incorporated, 333 Pfingsten Road, Northbrook, IL 60062-2096.)

(Industry association specifications and standards are generally available for reference from libraries. They are also distributed among technical groups and using Federal agencies.)

7.4 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.

7.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

Manufacturer's CAGE	Manufacturer's name and address
71424	Gould Electronics, Incorporated 374 Merrimac Street Newburyport, MA 01950-1998 (978) 465-4237
71400	Cooper Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 394-2877

7.6 Part number (P/N) supersession data. This CID supersedes the following manufacturers' P/N's as shown. This information is being provided to assist in reducing proliferation in the Government inventory system.

TABLE II. P/N supersession data.

Dash number (see table I) AA55546-	MFGR'S CAGE	MFGR'S P/N 1/	MFGR'S CAGE	MFGR'S P/N 1/
001	71424	30321R	71400	BC6031PQ
002	71424	30322R	71400	BC6032PQ
003	71424	30323R	71400	BC6033PQ
004	71424	30311R	71400	BC6031SQ
005	71424	30312R	71400	BC6032SQ
006	71424	30313R	71400	BC6033SQ
007	71424	30351R	71400	BC6031B
008	71424	30352R	71400	BC6032B
009	71424	30353R	71400	BC6033B

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID P/N shown.

7.7 Government users. To acquire information on obtaining these fuses from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-CM, Post Office Box 3990, Columbus, OH 43216-5000, or telephone (614) 692-7884.

MILITARY INTEREST:

Custodian:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-CC

Project 5920-0574

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:52Z
Check the source to verify that this is the current version before use.