MILITARY SPECIFICATION SHEET

METER, TIME TOTALIZING, MINIATURE, DIGITAL, 28 V DC, ROUND

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirement for acquiring the meter described herein shall consist of this specification and the latest issue in effect of MIL-M-7793.

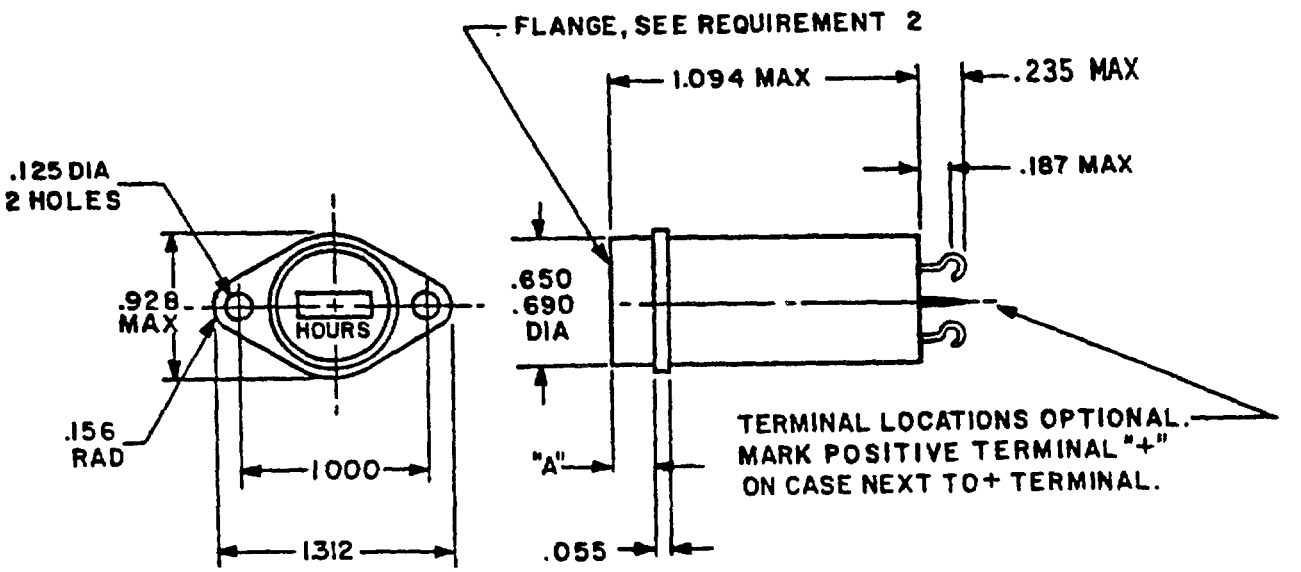


FIGURE 1.

NOTE: For dimension "A" see TABLE I.

AMSC N/A FSC 6645

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. Dimensions are in inches. Unless otherwise specified, tolerances are ±.02 for two-place decimals and ±.015 for three-place decimals.

2. Mounting flange: Meters with fixed flanges shall be tin-plated on front surface of mounting flange in accordance with MIL-T-10727 to provide an electrical ground for the case. In accordance with Table I, meters may be furnished with no flange or with adjustible split mount flanges in accordance with MS3345-1.

Performance:

Life accuracy: ±0.1% from -65 to +125°C and 10 to 34 V DC.

Power consumption: Power consumption at 28 V DC shall not exceed 85 milliwatts.

Ripple voltage: Meter shall operate normally when subjected to the ripple requirements of 5.2.2, 5.2.2.1 and Figure 7 of MIL-STD-704A.

Operating temperature range: -65 to +125°C.

Time range: Total readout of the meters shall be 9999 hours.

Transient protection: No temporary or permanent degradation shall be produced in the meter for the input voltage and time values shown in MIL-STD-704A, Figure 17 and Figure 9, Curve 1 (600 V and 80 V transients, respectively).

Voltage range: Operating voltage shall be from 10 to 34 V DC.

Weight: Weight shall be not greater than 0.6 ounce with flange

Dielectric test voltages: 350 Vrms (altitude)
600 Vrms (room)

Random vibration required.

Qualification tests: Qualification tests will be conducted in accordance with MIL-M-7793, except that the voltage, temperature, dielectric test voltages and accuracy shall be as specified herein.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.

TABLE I.

Military Part Number	Flange Data Dim A ±.015	Military Part Number	Flange Data Dim A ±.015
M7793/2-001	Adjustible per MS3345-1	M7793/2-015	.375
-002	No flange	-016	.406
-003	.000 (Flush)	-017	.438
-004	.031	-018	.469
-005	.062	-019	.500
-006	.094	-020	.531
-007	.125	-021	.562
-008	.156	-022	.594
-009	.188	-023	.625
-010	.218	-024	.656
-011	.250	-025	.688
-012	.281	-026	.719
-013	.312	-027	.750
-014	.344	-028	.781

Custodians:
Navy - AS
Army - AR
Air Force - 99

Preparing activity:
Navy - AS

(Project Number 6645-0388)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.