MILITARY SPECIFICATION SHEET

METER, TIME TOTALIZING, MINIATURE, DIGITAL, 115 V, 60 Hz, SQUARE

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirement for acquiring the meter described herein shall consist of this specification and the latest issue in effect of MIL-M-7793.

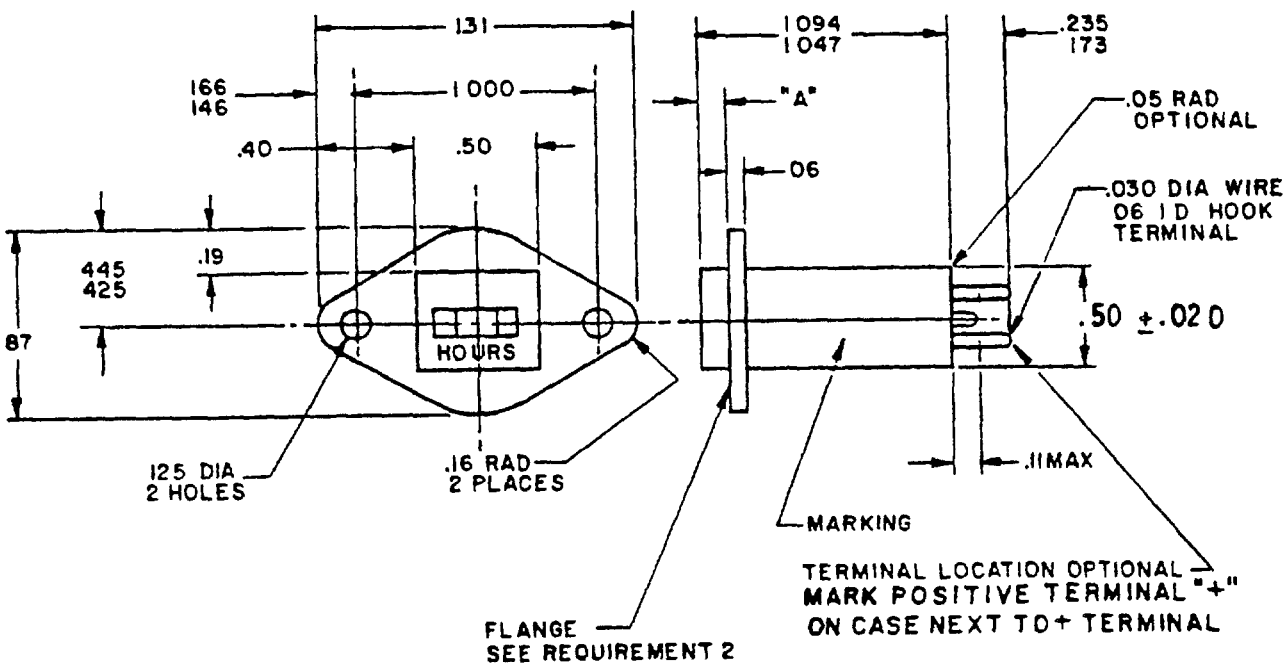


FIGURE 1.

NOTE: For dimension "A" see TABLE I.

AMSC N/A FSC 6645

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. Dimensions are in inches. Unless otherwise specified, tolerances are ±.02 for two-place decimals and ±.015 for three-place decimals.

2. Mounting flange: Meters with fixed flanges shall be tin-plated on front surface of mounting flange in accordance with MIL-T-10727 to provide an electrical ground for the case. In accordance with Table I, meters may be furnished with no flange or with adjustible split mount flanges in accordance with MS3345-2.

Performance:

Dielectric test voltage: 350 Vrms (altitude)
600 Vrms (room)

Life accuracy: ±0.1% from -65 to +125°C and 75 to 150 V AC at 60 Hz.

Frequency rating: Meter shall operate satisfactorily and maintain accurately the life accuracy limits as specified above over the frequency range of 50 to 70 Hz (see Note 1).

Power consumption: Power consumption at 115 V AC, 60 Hz shall not exceed 0 3 W

Operating temperature range. -65 to +125°C

Time range: Total readout of the meters shall be 9999 hours.

Transient protection: No temporary or permanent degradation shall be produced in the meter if the input voltage should increase to 180 V rms at 50 to 70 Hz for a period of 150 milliseconds maximum

Voltage range Operating voltage shall be from 75 to 150 V AC

Weight. Weight shall be not greater than 0 6 ounce with flange

Random vibration required.

Qualification tests Qualification tests shall be conducted in accordance with MIL-M-7793, except that the dielectric strength, voltage, temperature and accuracy shall be as specified herein

NOTE:

1. Accuracy is degraded at the same percent as the percentage change in the input frequency range from 60 Hz, plus the specified accuracy tolerance

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.

TABLE I.

Military Part Number	Flange Data Dim A ±.015	Military Part Number	Flange Data Dim A ±.015
M7793/3-001	Adjustible per MS3345-2	M7793/3-015	.375
-002	No flange	-016	.406
-003	.000 (Flush)	-017	.438
-004	.031	-018	.469
-005	.062	-019	.500
-006	.094	-020	.531
-007	.125	-021	.562
-008	.156	-022	.594
-009	.188	-023	.625
-010	.218	-024	.656
-011	.250	-025	.688
-012	.281	-026	.719
-013	.312	-027	.750
-014	.344	-028	.781

Custodians:
Navy - AS
Army - AR
Air Force - 99

Preparing activity:
Navy - AS

(Project Number 6645-0389)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T08:57Z
Check the source to verify that this is the current version before use.