INCH-POUND
MIL-DTL-24646/4B
29 October 2008
SUPERSEDING
MIL-DTL-24646/4A
17 May 2002

DETAIL SPECIFICATION SHEET

FUSE BOXES, FEEDER DISTRIBUTION, TOTALLY ENCLOSED, 450 VOLTS, ALTERNATING CURRENT, THREE PHASE BUSES, SINGLE AND THREE PHASE BRANCHES, 0-30 AND 31-60 AMPERE FUSES, SYMBOLS 543, 544, 545, 546 AND 547

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-24646.


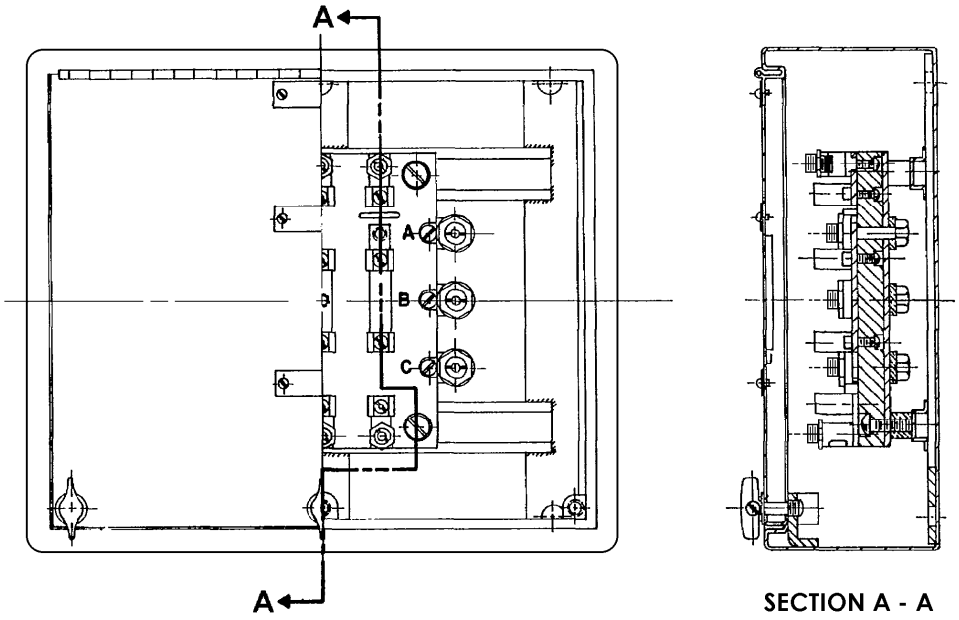


FIGURE 1. Fuse box assembly, typical. Item No. 01, 02, 03, 04, 05
(Symbol 543 shown)

NOTES:
1. Dimensions are in inches.
2. Unless otherwise specified herein, tolerances shall be as follows:
   Two place decimals - plus or minus 0.02.
   Three place decimals - plus or minus 0.005.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

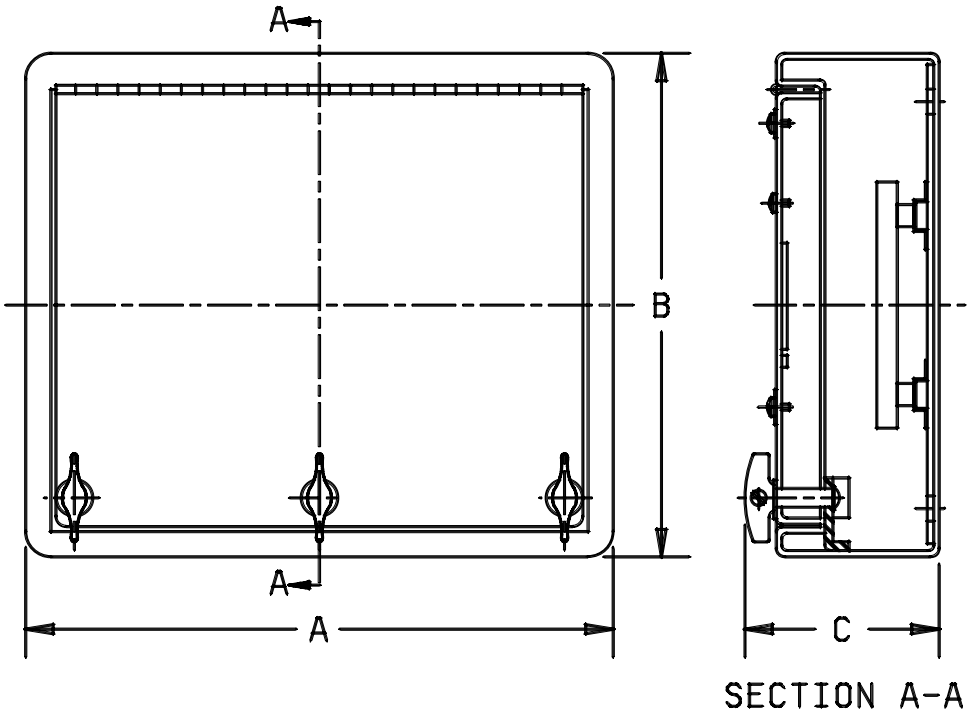


SYMBOL NO	DIMENSIONS (REF)		
	A	B	C
543	14.16	12.16	4.75
544	18.16	12.16	4.75
545	22.16	12.16	4.75
546	16.16	14.16	4.75
547	22.16	14.16	4.75


FIGURE 2. Enclosure, overall dimensions. Item No. 06, 07, 08, 09, 10 (Symbols 543, 544, 545, 546 and 547)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

SYMBOL NO	DIMENSIONS			
	A	B	C	D
543	5.50	11.00	5.25	10.50
544	7.00	14.00	5.25	10.50
546	6.00	12.00	6.25	12.50

A. Symbols 543, 544 and 546.

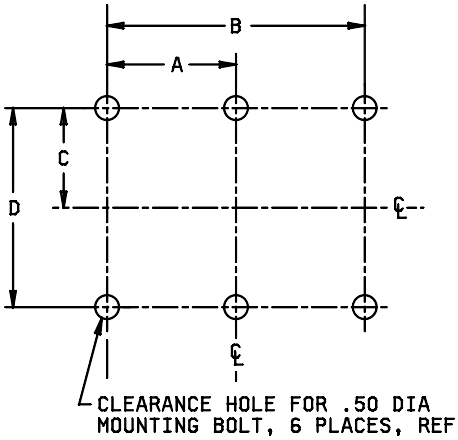

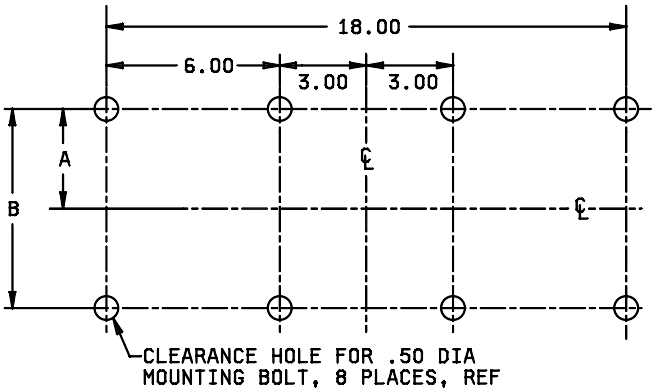


B. Symbols 545 and 547.

SYMBOL NO	DIMENSIONS	
	A	B
545	5.25	10.50
547	6.25	12.50

FIGURE 3. Mounting dimensions, ref.


Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

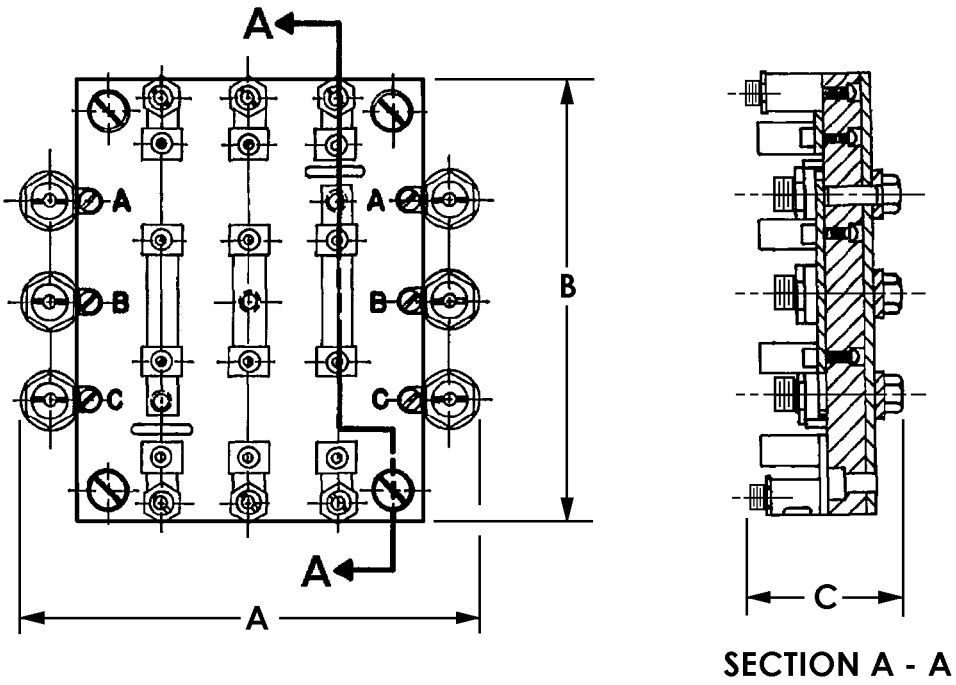


SYMBOL NO	DIMENSIONS (MAX)		
	A	B	C
543	7.87	7.12	2.80
544	11.87	7.12	2.80
545	16.37	7.12	2.70
546	8.87	8.38	2.80
547	14.37	8.38	2.80

FIGURE 4. Fuse block assembly, typical. Item No. 11, 12, 13, 14, 15
(Symbols 543, 544, 545, 546 and 547)


Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

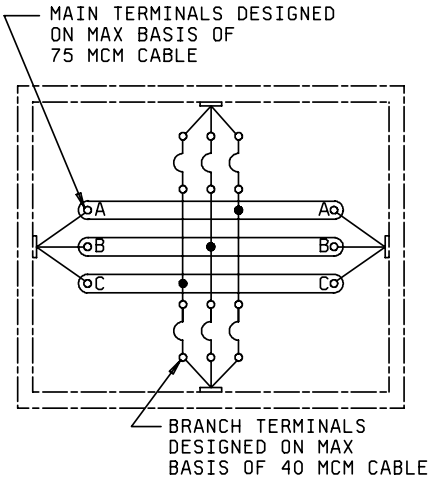


A. Two 3-phase branches
(Symbol 543)

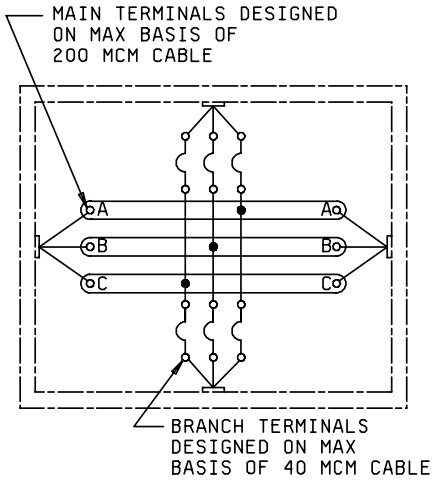

B. Two 3-phase branches
(Symbol 546)

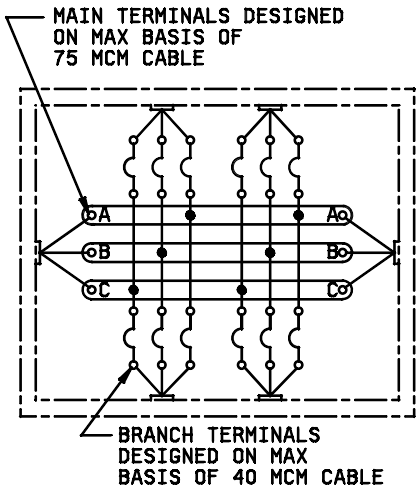


C. Four 3-phase branches
(Symbol 544)

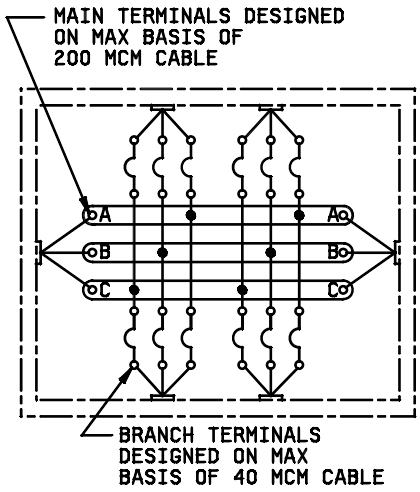


D. Four 3-phase branches
(Symbol 547)

FIGURE 5. Wiring diagrams. Item No. 16, 17, 18, 19, 20

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

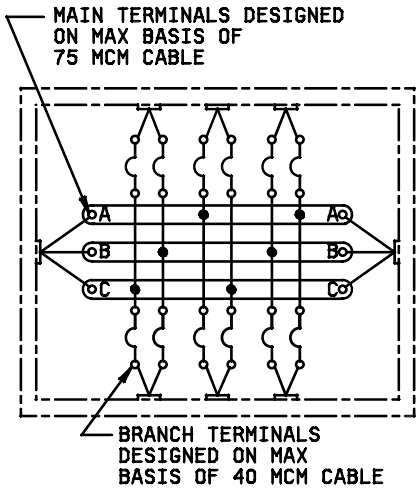

E. Six single-phase branches
(Symbol 544)

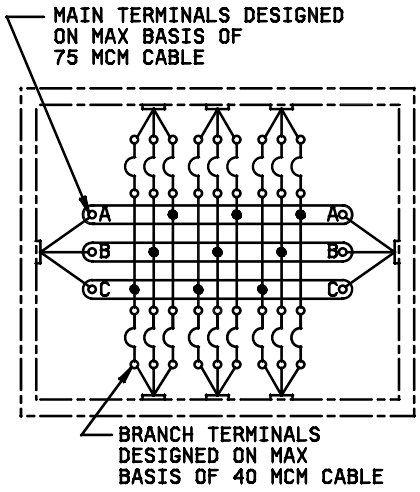

F. Six 3-phase branches
(Symbol 545)

FIGURE 5. Wiring diagrams. Item No. 16, 17, 18, 19, 20 - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Symbol numbers: See table I.

Design:

Electrical rating: 450 volts alternating current, 0-30 and 31-60 ampere, 60 hertz.
Dimensions and configuration: See figures 1, 2, 3 and 4.
Wiring diagrams: See figure 5.
Mounting dimensions: See figure 3.
Degree of enclosure: Totally enclosed.
Designation and marking: See MIL-DTL-24646.
Parts: The parts listed in table II and specified in MIL-DTL-24646 shall be used in the construction of the fuse boxes specified herein.

General information:
Military part numbers and general information are as specified in table I.

TABLE I. Military parts number and general information.

Military part no.	Symbol no.	Weight in pounds	No. of circuits	Feeder MCM	Branch MCM	Fuse size	Bus bar size	Supersedes	
								Drawing no.	Type
M24646/4-001	543	14.0	2	75	40	0-30A	1.00 x 0.25	9-S-4875-L	-
M24646/4-002	544	23.1	4 6	75	40	0-30A 0-30A	.75 x .25	9-S-4876-L	-
M24646/4-003	545	28.8	6	75	40	0-30A	.75 x .19	9-S-4877-L	-
M24646/4-004	546	28.6	2	200	40	31-60A	1.00 x .25	9000-S-6202-73215	E E-1
M24646/4-005	547	40.8	4	200	40	31-60A	1.00 x .25	9000-S-6202-73216	-

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

TABLE II. Parts list.

Item no. 1/	Description	QTY M /-					Material/ specification	Remarks
		001	002	003	004	005		
01	Fuse box assembly (sym 543)	-					MIL-DTL-24646/4	See fig. 1
02	Fuse box assembly (sym 544)		-				MIL-DTL-24646/4	See fig. 1
03	Fuse box assembly (sym 545			-			MIL-DTL-24646/4	See fig. 1
04	Fuse box assembly (sym 546)				-		MIL-DTL-24646/4	See fig. 1
05	Fuse box assembly (sym 547)					-	MIL-DTL-24646/4	See fig. 1
06	Enclosure (12 x 14 x 4)	1					M24142/16-004	See fig. 2
07	Enclosure (12 x 18 x 4)		1				M24142/16-006	See fig. 2
08	Enclosure (12 x 22 x 4)			1			M24142/18-004	See fig. 2
09	Enclosure (14 x 22 x 4)					1	M24142/18-005	See fig. 2
10	Enclosure (14 x 16 x 4)				1		9-S-73408 Type E	See fig. 4
11	Fuse block assembly	1					MIL-DTL-24646/4	See fig. 4
12	Fuse block assembly		1				MIL-DTL-24646/4	See fig. 4
13	Fuse block assembly			1			MIL-DTL-24646/4	See fig. 4
14	Fuse block assembly				1		MIL-DTL-24646/4	See fig. 4
15	Fuse block assembly					1	MIL-DTL-24646/4	See fig. 4
16	Wiring diagram	1					MIL-E-2036	See fig. 5
17 2/	Wiring diagram		2				MIL-E-2036	See fig. 5
18	Wiring diagram			1			MIL-E-2036	See fig. 5
19	Wiring diagram				1		MIL-E-2036	See fig. 5
20	Wiring diagram					1	MIL-E-2036	See fig. 5
21	Fuse clip (0-30A)	12	24	36	-	-	A-A-55507/1-06	N/A
22	Fuse clip (31-60A)	-	-	-	12	24	A-A-55507/1-08	N/A
23	Identification plate	1	1	1	1	1	Brass, ASTM B36/B36M B121/B121M	N/A
24	Information plate	2	2	4	4	6	Brass, ASTM B36/B36M B121/B121M	N/A

1/ Item numbers after the figure titles are the same as the item numbers shown in this table.
2/ Unless otherwise specified, both single phase and three phase wiring diagrams shall be furnished.

Referenced documents. In addition to MIL-DTL-24646, this document references the following:

MIL-E-2036 ASTM B36/B36M ASTM B121/B121M

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.

The margins of this specification sheet are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodian:
Navy - SH
DLA - CC

Preparing activity:
DLA - CC

(Project 5920-2008-020)

NOTE: the activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T00:28Z
Check the source to verify that this is the current version before use.