MILITARY SPECIFICATION

SAFETY EQUIPMENT SET; RESPIRATORY, 2-MAN

This specification is approved for use by all
Departments and Agencies of the Department of Defense.

1. SCOPE

1.1 This specification covers a set which provides essential equipment for physical and respiratory protection of personnel engaged in cleaning leaded gasoline storage tanks.

2. APPLICABLE DOCUMENTS

2.1 Government documents. The following documents of the issue in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

SPECIFICATIONS

FEDERAL

L-P-535		Plastic Sheet (Sheeting), Plastic Strip, Vinyl Chloride Polymer and Vinyl Chloride Vinyl Acetate Copolymer, Rigid.
QQ-S-698	-	Steel, Sheet and Strip, Low Carbon.
ZZ-G-381	-	Gloves, Rubber, Industrial.
GGG-W-631	-	Wrench, Adjustable, Open-end, Auto and Monkey.
PPP-B-566	-	Boxes, Folding, Paperboard.
PPP-B-585	-	Boxes, Wood, Wirebound.
PPP-B-601	-	*Boxes,* Wood, Cleated-Plywood*
PPP-B-621	-	Boxes, Wood, Nailed and Lock-Corner.
PPP-B-636	-	Box, Fiberboard.
PPP-B-676	-	Boxes, Setup.
PPP-C-843	-	Cushioning, Material Cellulosic.
PPP-T-45	-	Tape, Gummed, Paper, Reinforced and Plain, for Sealing and Securing.
PPP-T-60		Tape, Pressure-Sensitive Adhesive; WaterProof, For Packaging.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

MILITARY

MIL-B-18/9	Batteries, Dry, BA30.
MIL-P-116	Preservation, Methods of.
MIL-I-2703	Indicator, Combustible Gas, Portable.
MIL-B-2885	Boot, Fireman (Rubber).
MIL-T-10798	Trunk, Locker, Foot, Barracks.
MIL-R-17729	Respirator Outfit, Supplied-fir, Two-Man

STANDARDS

FEDERAL

FED-STD-356	Commercial Packaging of Supplies and Equipment.

MILITARY

MIL-STD-105	Sampling Procedures and Tables for Inspection by Attributes.
MIL-STD-129	Marking for Shipment and Storage.

PUBLICATIONS

DEPARTMENT OF THE ARMY SUPPLY CATALOG

SC 4240-94-CL-E01 - Safety Equipment Set, Respiratory, 2-Man.

(Copies of Specifications, standards, drawings, and publications required by suppliers in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

3. REQUIREMENTS

3.1 Materials and components.

3.1.1 Materials. All materials used shall conform to the specifications and specification figures cited herein.

3.1.2 Components. All components of the set shall conform to the specifications and specification figures listed herein. Each set shall consist of 2 chests containing components therein as specified. Chest No. 1 shall contain the safety equipment and Chest No. 2 shall contain the respirator outfit.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

3.1.2.1 Chest No. 1. Chest No. 1 shall be a trunk locker conforming to MIL-T-10798 modified in accordance with Specification Figures 1, 2, and 3. Chest No. 1 shall contain the items of equipment as specified in table I.

Table I. Items of equipment contained in Chest No. 1

Quantity	Item of equipment	Reference
2 pr	Fireman boots, size 8	MIL-B-2885, type II, class 1
2 pr	Fireman boots, size 10	
4 pr	Rubber gloves, size 11, 18 in. long	ZZ-G-381 type II, class 3
1 ea	Wrench, open-end, adjustable, single head, 0.947 in. jaw opening. 8 in. long	GGG-W-631
1 ea	Portable combustible gas indicator, complete with two 15-foot lengths of hose	MIL-I-2703, type E
1 ea	Probe (see 3.1.2.1.2)	MIL-I-2703
6 ea	*Batteries, dry, 1.5V, cylindrical, 1-11/32 in. diameter by 2-11/32 in. long	MIL-B-18/9

*Batteries are not to be supplied by the contractor with the Portable Combustible Gas Indicator. Batteries shall be obtained by using activities through appropriate supply charnels for initial use and replacement.

3.1.2.1.1 Loading plan. Specification Figure 4 shall be as printed, , or other permanent reproduction, heat-sealed between 2 sheets of clear transparent plastic material in accordance with composition B, type I, class 3 of L-P-535, each 0.008 inch minimum thickness. The loading plan shall be securely attached to the inside and near the center of the lid of the chest No. 1.

3.1.2.1.2 Probe. The probe shall be as specified in MIL-I-2703, except that the overall length shall be 30 to 33-1/2 inches.

3.1.2.2 Chest No. 2. Chest No. 2 shall be a respirator outfit conforming to MIL-R-17729.

3.2 Technical publications. In addition to other technical publications elsewhere specified, one copy of the latest revision of Department of the Army Supply Catalog No. sc 4240-94-CL-EO1, "Safety Equipment Set, Respiratory, 2-Man" shall be furnished in Chest No. 1.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

3.3 Identification marking. The following shall be stenciled on the outside of the appropriate chest using 1-1/2 inch capitals and numerals:

(a) Chest No. 1:

"SAFETY EQUIPMENT SET, RESPIRATORY, 2-MAN
SAFETY EQUIPMENT
CHEST NO. 1 OF 2"

(b) Chest No. 2:

"SAFETY EQUIPMENT SET, RESPIRATORY, 2-MAN
RESPIRATOR OUTFIT
WEST NO. 2 OF 2"

3.4 Workmanship. The set and components thereof shall be free from damage that will interfere with their respective performance or function.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection.

4.1.1 Supplier's responsibility. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified in the contract or order, the supplier may use his own or any other facilities suitable for the performance of the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure supplies and services conform to specified requirements.

4.1.2 Objective evidence. The supplier shall provide objective evidence acceptable to the contracting officer that the requirements of 3.1 a-rid section 5 for which specific inspection has not been provided in this specification have been satisfied.

4.2 Quality conformance inspection.

4.2.1 Lotting. A lot shall consist of the safety equipment sets offered for acceptance at one time, which has been produced by one manufacturer under essentially the same manufacturing conditions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

4.2.2 Sampling.

4.2.2.1 Sampling for nondestructive examination. Sampling shall be conducted in accordance with MIL-STD-105.

4.2.3 Inspection procedure.

4.2.3.1 Examination. Sample sets and level A preparation for delivery thereof shall be examined in accordance with the classification of defects and MIL-STD-105.

4.2.3.2 Classification of defects.

(a) Safety equipment set, respiratory, 2-man

Categories	Defects
Critical:	None defined
Major:	AQL 1.5 percent defective
101	Component missing, damaged, or not as specified
102	Technical publication or loading plan missing, incomplete, or illegible
103	Hardware incorrectly located, damaged, or not as specified
104	Identification marking missing, incorrect, or illegible

(b) Preparation for delivery (section 5)

Categories	Defects
Critical:	None defined
Major:	AQL 4.0 percent defective
101	Preservative missing where specified
102	Packaging method incorrect
103	Components or technical publication missing
104	Intermediate packaging not as specified
105	Container incorrect
106	Container closure incorrect

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

107	Container or package damaged (broken, torn, punctured, or crushed)
108	Internal cushioning or blocking missing or insufficient to make a tight pack
109	When used, metal banding loose
110	Marking incorrect, missing, or illegible

5. PREPARATION FOR DELIVERY

5.1 Preservation and Packaging. Levels shall be A or C as specified (see 6.2).

5.1.1 Level A.

5.1.1.1 Safety equipment. (Chest No. 1 and its components).

(a) Fireman Boots. Each mated pair of boots of one type only, shall be secured together with cotton tape or twine to prevent separation.

(b) Rubber gloves. Each pair of gloves shall be packaged in a snug-fitting setup paperboard box conforming to type I, variety 1, class A, style 4 of PPP-B-676; or in a snug-fitting folding paperboard box conforming to variety 1, style III, type G, class i of PPP-B-566. Each box shall be secured with a minimum of 2 inch wide gummed paper tape conforming to type III, grade B of PPP-T-45, applied at the center of the length opening and extending over the top and along the bottom at least 1 inch.

(c) Wrench, open end, adjustable. The wrench shall be cleaned and preserved with a medium preservative oil (cold application) conforming to P-7 of MIL-P-116, and packaged in accordance with method IC-1 of the same specification.

(d) portable combustible gas indicator. The indicator shall be preserved and packaged in accordance with method IIb of MIL-P-116. The package shall be of a size comparable to the space provided for stowage within the chest (ref fig 4 Loading Plan).

(e) Probe. No packaging required.

(f) Technical Publications. The technical publications shall be preserved and packaged in accordance with method IC-3 of MIL-P-116.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

(g) Chest. The chest hinges and draw pull catches shall be preserved with a medium preservative oil (cold application) conforming to type P-7 of MIL-P-116.

5.1.1.2 Respirator outfit (Chest No. 2). The respirator outfit shall be preserved and packaged in accordance with level A of MIL-R-17729.

5.1.2 Intermediate packaging. The safety equipment preserved and packaged as specified in 5.1.1 shall be intermediately packaged within chest No. 1. The items shall be placed in the chest in the following sequence and in their respective locations in accordance with figure 4 loading plan. The respirator outfit (Chest No. 2) shall be intermediately packaged in accordance with MIL-R-17729:

(a) place the probe in the bottom of the chest as shown,

(b) Install the L-shaped frame in the location shown, and insert the packaged gas indicator in this location.

(c) Secure the packaged wrench to the bottom of the chest with pressure sensitive tape conforming to type III, class 1 of PPP-T-60.

(d) The packaged boots, gloves, and technical publications shall be placed within the chest as shown.

(e) The safety equipment shall be restricted from movement within the container by filling all voids within the container with cushioning material conforming to type II, class A of PPP-C-843. The seam around the lid of the chest shall be sealed with pressure sensitive tape conforming to type III, class 1 of PPP-T-60.

5.1.3 Level C. The safety equipment (Chest No. 1) and Respirator outfit (Chest No.2) shall be preserved and packaged within their respective chests in accordance with FED-STD-356, Commercial packaging of Supplies and Equipment. Stowing procedures for safety equipment (Chest No. 1) shall be in accordance with figure 4 loading plan of this specification

5.2 Packing. Levels shall be A or C as specified (see 6.2).

5.2.1 Level A.

(a) Chest No. 1 (Safety Equipment). The chest, with safety equipment intermediately packaged therein, (see 5.1.2) shall be packed within a wood box conforming to one of the following specifications for a type 1 easy load: PPP-B-601 overseas type, style A, grade A;

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

PPP-B-621 class 2, style 4 or 4-1/2, grade A; PPP-B-585 class 2, style 2. The boxes shall be closed and strapped in accordance with the closure requirements specified in the appendix of the applicable specification. Galvanized strapping shall be used.

(b) Chest No. 2 (Respirator Outfit). The respirator outfit shall be packed in accordance with level A requirements of MIL-R-17729.

5.2.2 Level c. Chest No. 1 (Safety Equipment) and Chest No. 2 (Respirator) with their respective items preserved and packaged as specified in 5.1.3 shall be individually packed within a fiberboard box conforming to RSC, type CF, class domestic, variety SW, grade 275 of PPP-B-636. The box shall be closed in accordance with the closure requirements specified in the appendix of PPP-B-636.

5.3 Marking. In addition to any special marking required by the contract or order, intermediate and shipping containers shall be marked in accordance with MIL-STD-129.

6. NOTES

6.1 Intended use. The “Safety Equipment Set, Respiratory, 2-Man” is intended for use by personnel in the cleaning and repairing of leaded gasoline storage tanks.

6.2 Ordering data. Procurement documents should specify the following:

(a) Title, number, and date of this specification.
(b) Level of packaging and packing required.

6.3 Supersession data. This specification supersedes Edgewood Arsenal. Purchase Description 197-54-824, dated 2 August 1962.

Custodian:

Army-EA

Preparing activity:

Army-EA

Project No, 4240-A589

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.



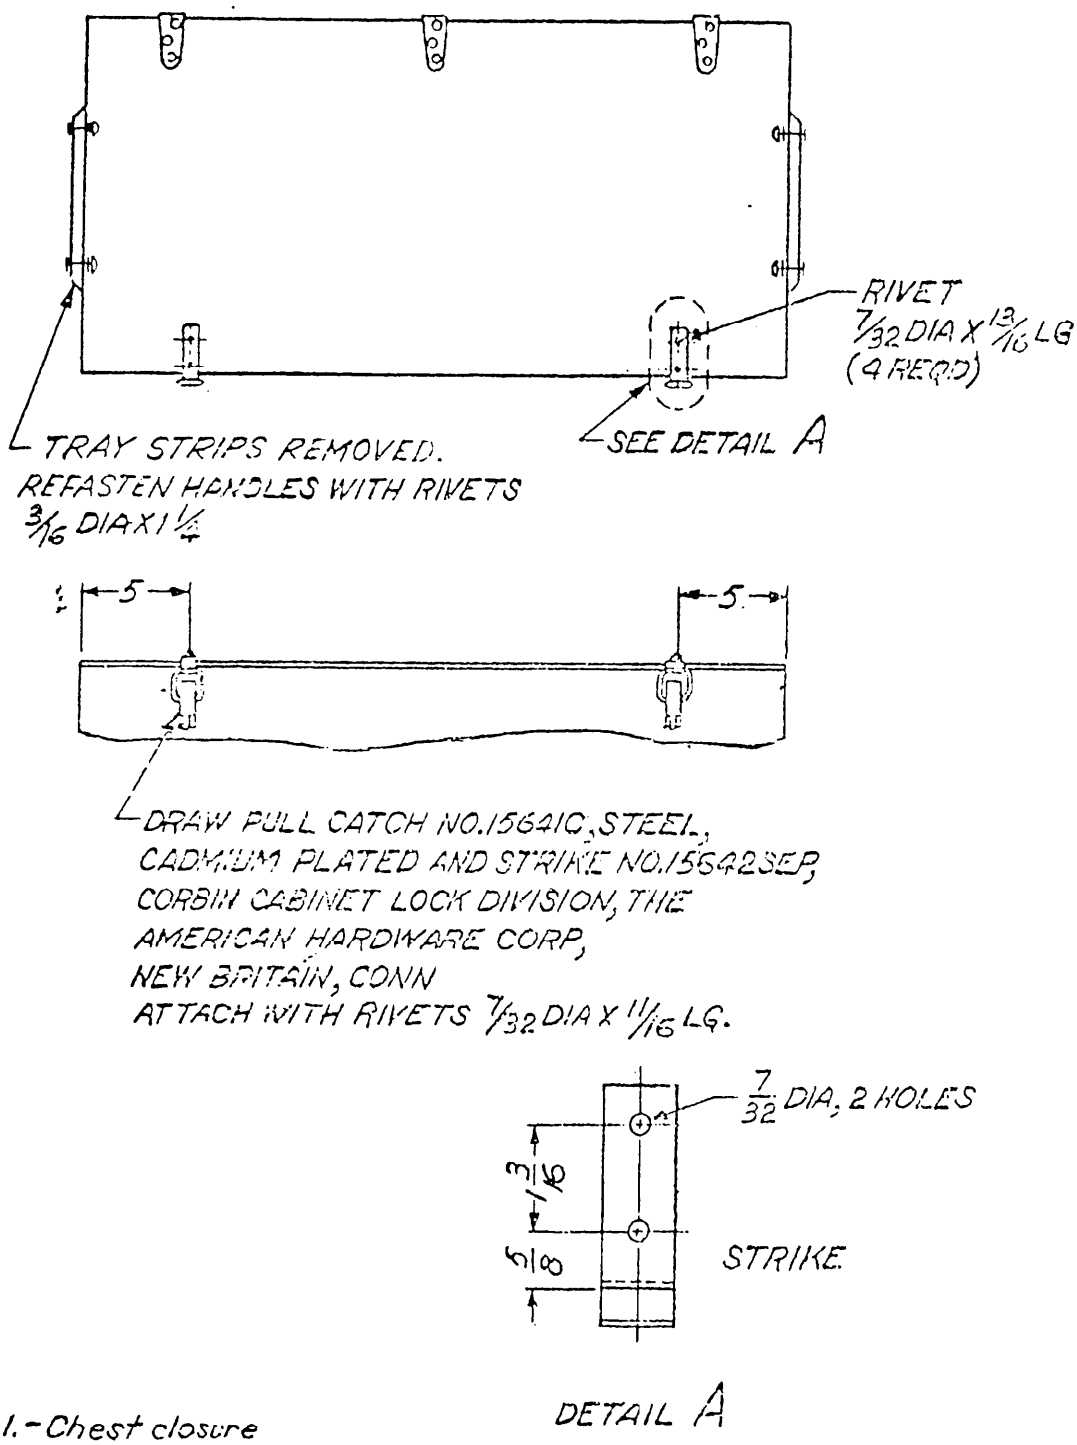



Figure 1. - Chest closure

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.

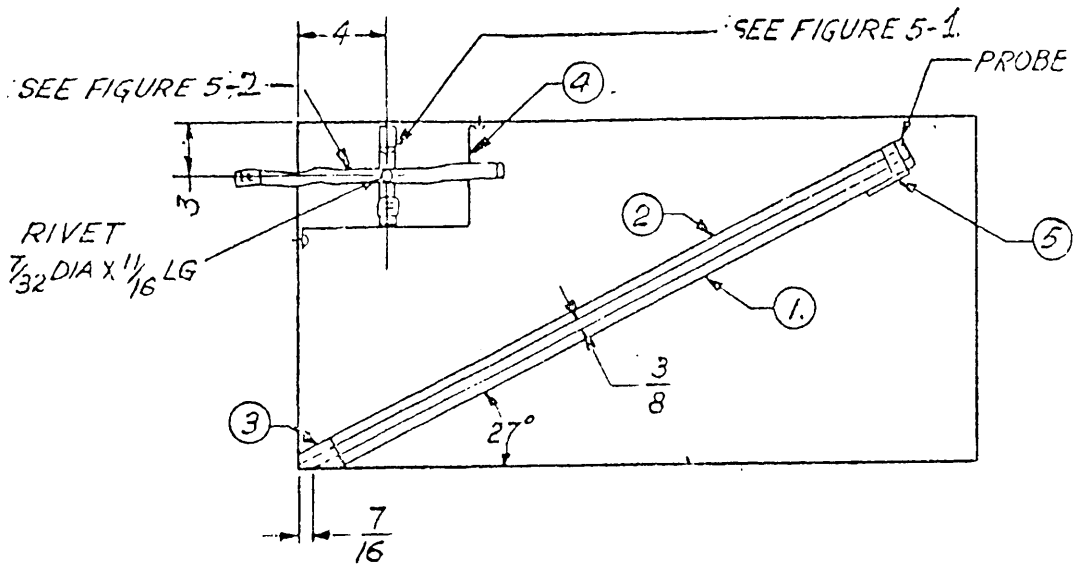


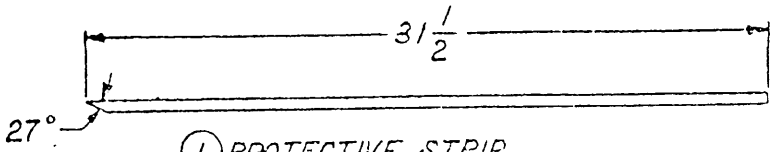

(1.) PROTECTIVE STRIP
SOFT LUMBER 1/2 X 1/2

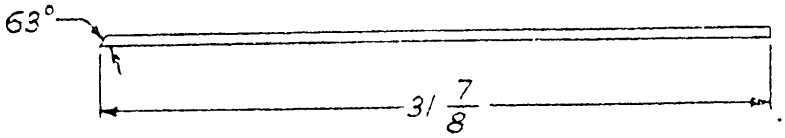

(2.) PROTECTIVE STRIP
SOFT LUMBER 1/2 X 1/2

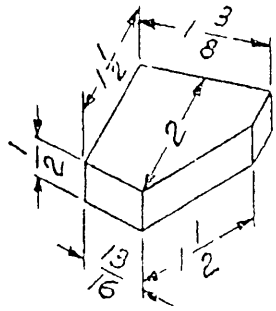

(3.) END BLOCK
SOFT LUMBER

NOTES:
PARTS 1, 2, AND 3 TO BE FASTENED WITH BRADS IN BOTTOM OF TRUNK, LOCKER.

SEE LOADING PLAN FOR INSTALLATION OF PART 4.

Figure 2.-Modification to interior of chest

Source: https://assist.dla.mil -- Downloaded: 202610-22T21:00Z
Check the source to verify that this is the current version before use.


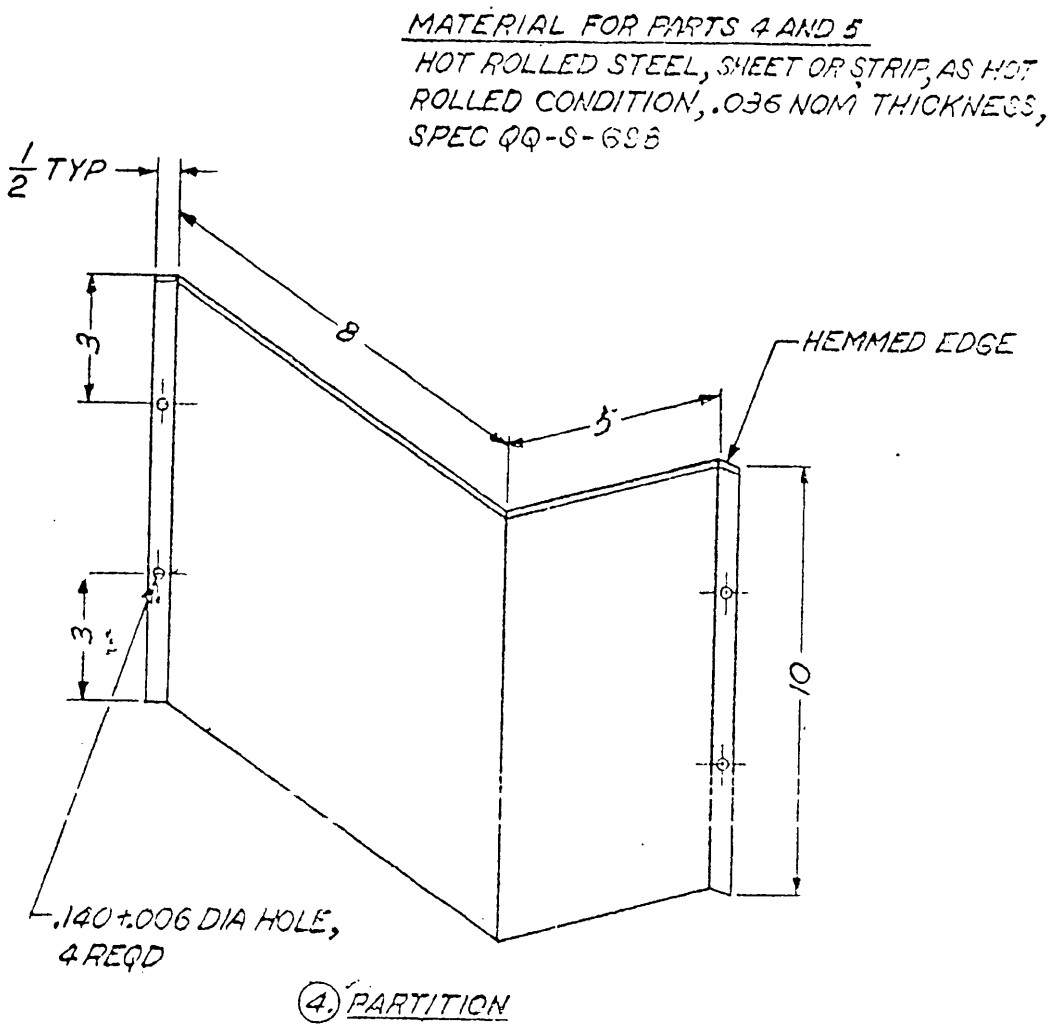


Figure 3. -Partition and retainer clip

Source: https://assist.dla.mil -- Downloaded: 2026l0-22T21:00Z
Check the source to verify that this is the currentversion before use.

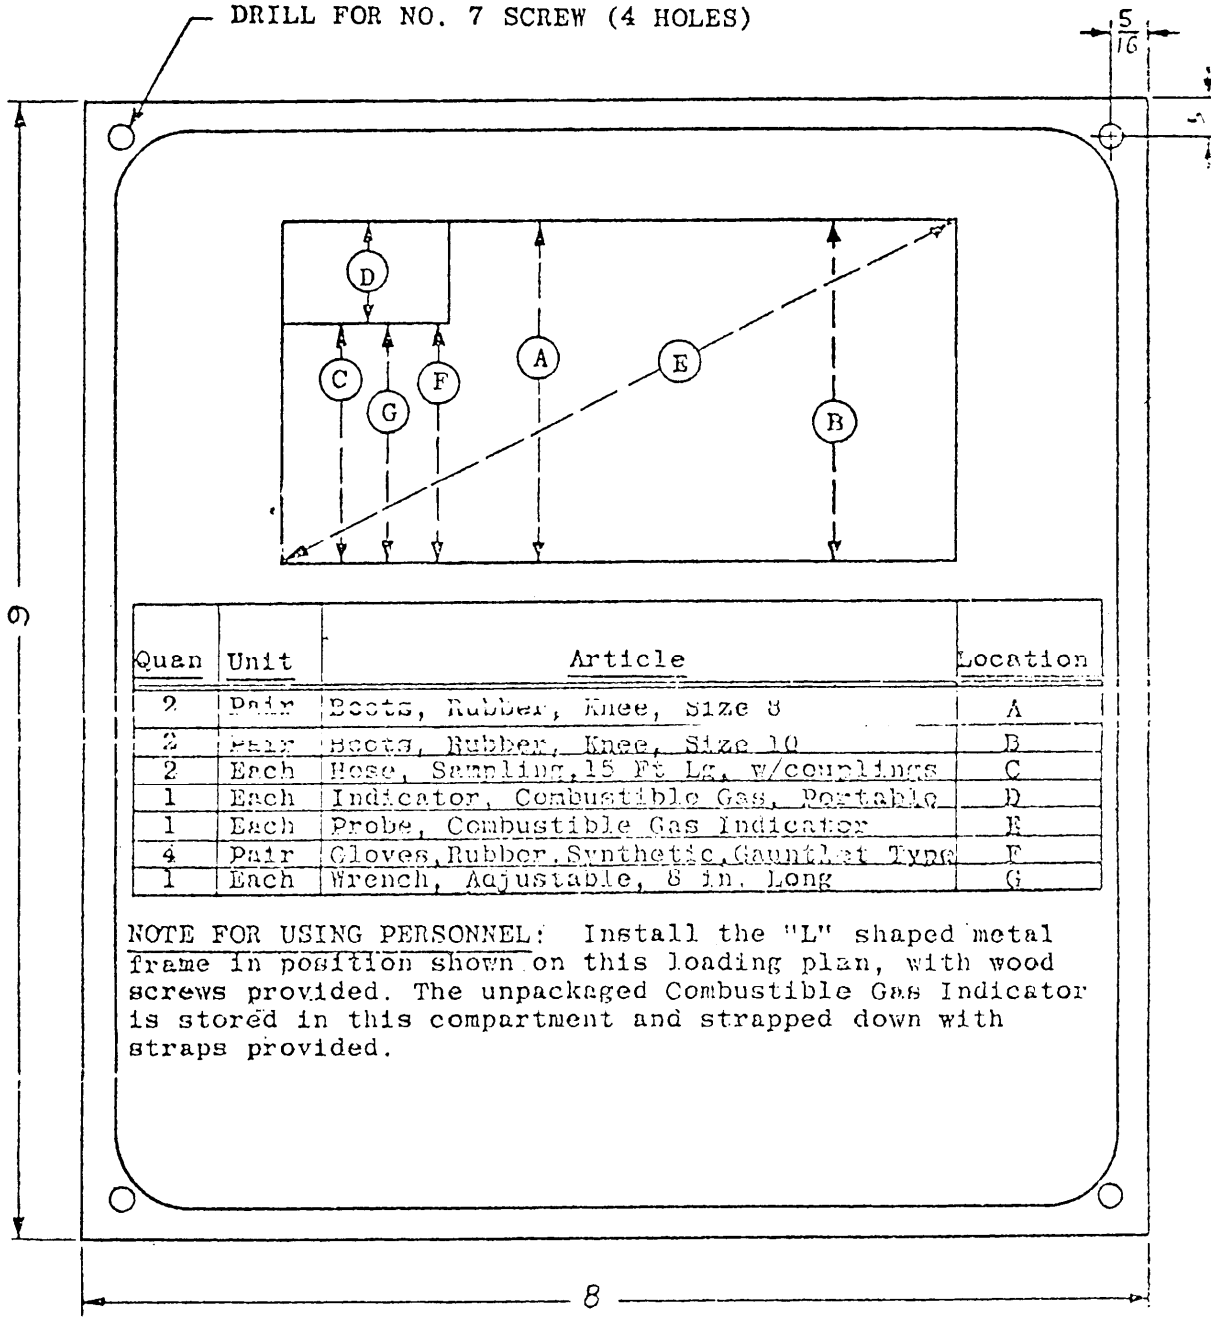


Quan	Unit	Article	Location
2	Pair	Boots, Rubber, Knee, Size 8	A
2	Pair	Boots, Rubber, Knee, Size 10	B
2	Each	Hose, Sampling, 15 Ft Lg, w/couplings	C
1	Each	Indicator, Combustible Gas, Portable	D
1	Each	Probe, Combustible Gas Indicator	E
4	Pair	Gloves, Rubber, Synthetic, Gauntlet Type	F
1	Each	Wrench, Adjustable, 8 in. Long	G

NOTE FOR USING PERSONNEL: Install the "L" shaped metal frame in position shown on this loading plan, with wood screws provided. The unpackaged Combustible Gas Indicator is stored in this compartment and strapped down with straps provided.

Figure 4. - Loading plan

Source: https://assist.dla.mil -- Downloaded: 2026l0-22T21:00Z
Check the source to verify that this is the currentversion before use.

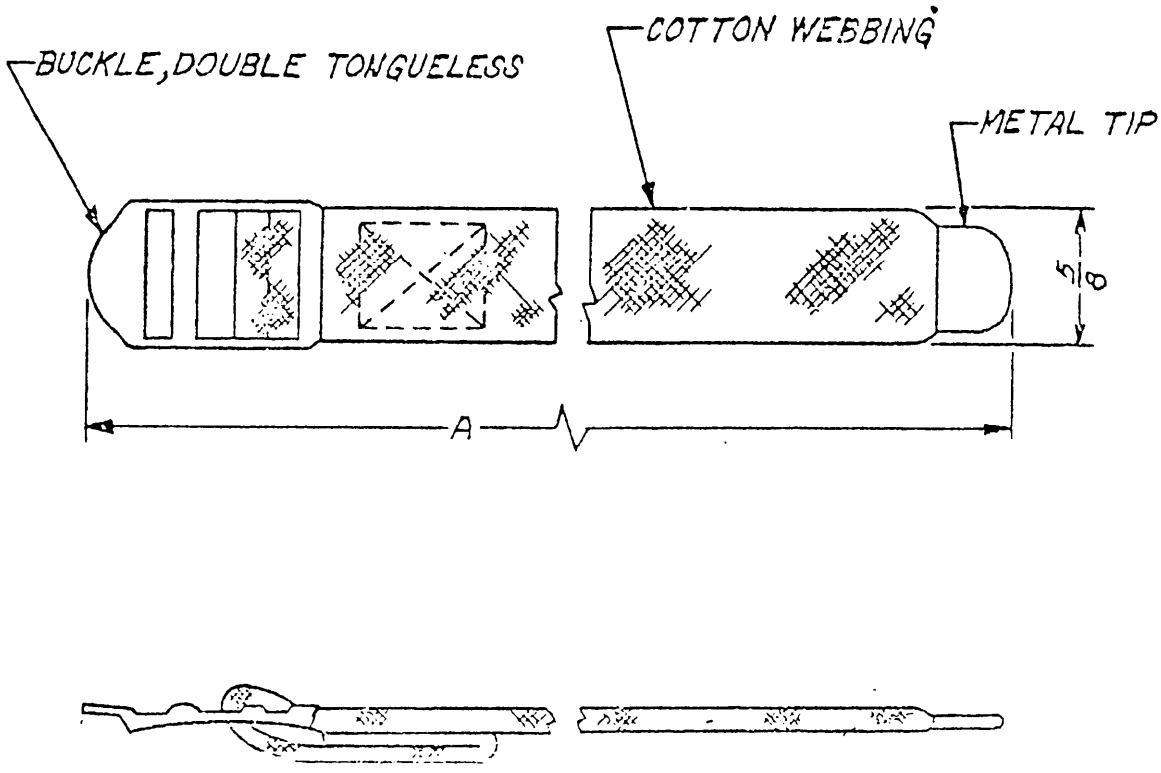

PART NO.	A DIM
1	30"
2	34"

Figure 5.-Tiedown strap

Source: https://assist.dla.mil -- Downloaded: 202610-22T21:00Z
Check the source to verify that this is the currentversion before use.

SPECIFICATION ANALYSIS SHEET

Form Approved
Budget Bureau No. 22-R255

INSTRUCTIONS: This sheet is to be filled out by personnel, either Government or contractor, involved in the use of the specification in procurement of products for ultimate use by the Department of Defense. This sheet is provided for obtaining information on the use of this specification which will insure that suitable products can be procured with a minimum amount of delay and at the least cost. Comments and the return of this form will be appreciated. Fold on lines on reverse side, staple in corner, and send to preparing activity. Comments and suggestions submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or serve to amend contractual requirements.

SPECIFICATION

ORGANIZATION

CITY AND STATE | CONTRACT NUMBER

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE SPECIFICATION CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2. COMMENTS ON ANY SPECIFICATION REQUIREMENT CONSIDERED TOO RIGID

3. IS THE SPECIFICATION RESTRICTIVE?

☐ YES ☐ NO *(If "yes", in what way?)*

4. REMARKS *(Attach any pertinent data which may be of use in improving this specification. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity)*

SUBMITTED BY *(Printed or typed name and activity - Optional)* | DATE

DD FORM 1 JAN 66 1426 REPLACES EDITION OF 1 OCT 64 WHICH MAY BE USED.

Source: https://assist.dla.mil -- Downloaded: 20260-22T21:00Z
Check the source to verify that this is the current version before use.

FOLD

POSTAGE AND FEES PAID

OFFICIAL BUSINESS

Commander
Edgewood Arsenal
Attn: SAREA-TS-S
Aberdeen Proving Ground, MD 21010

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T21:00Z
Check the source to verify that this is the current version before use.