
DETAIL SPECIFICATION SHEET

# EXPANSION JOINTS, PIPE, METALLIC, SINGLE BELLOWS, CORRUGATED, UNREINFORCED

This specification is approved for use by all Departments
and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17813.

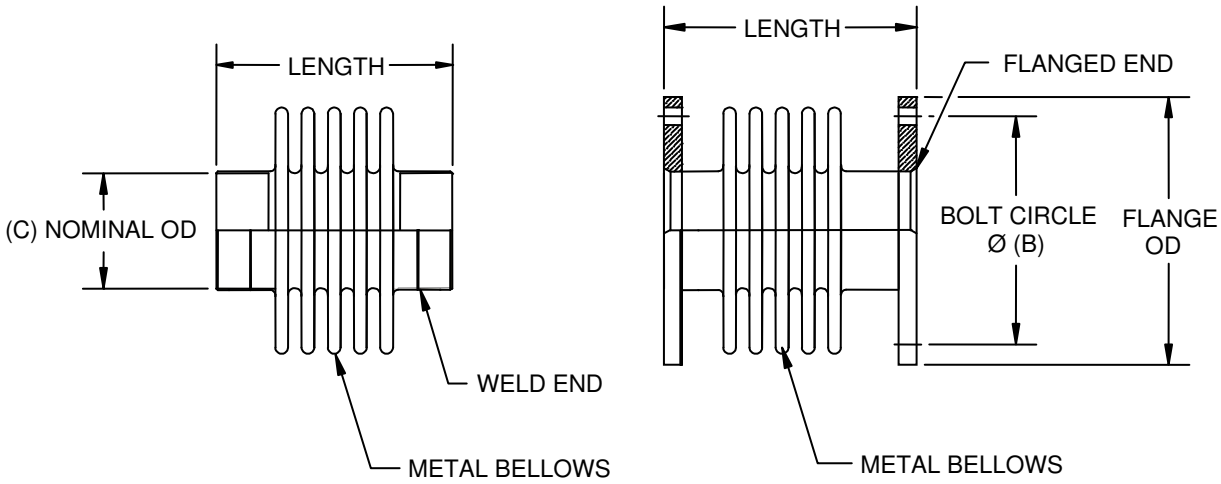


| DN | C-NPS inch (mm) | Flange OD inch (mm) 1/ | B (bolt circle diameter) inch (mm) 1/ |
|---|---|---|---|
| 50 | 2 (50.8) | 6 (152.4) | 4.75 (120.7) |
| 65 | 2.5 (76.2) | 7 (177.8) | 5.5 (139.7) |
| 80 | 3 (76.2) | 7.5 (190.5) | 6 (152.4) |
| 90 | 3.5 (101.6) | 8.5 (215.9) | 7 (177.8) |
| 100 | 4 (101.6) | 9 (228.6) | 7.5 (190.5) |
| 125 | 5 (127) | 10 (254.0) | 8.5 (215.9) |
| 150 | 6 (152.4) | 11 (279.4) | 9.5 (241.3) |
| 200 | 8 (203.2) | 13.5 (342.9) | 11.75 (298.5) |
| 250 | 10 (254) | 16 (406.4) | 14.25 (362.0) |
| 300 | 12 (304.8) | 19 ( 482.6) | 17 (431.8) |
| 350 | 14 (355.6) | 21 (533.4) | 18.75 (476.3) |
| 400 | 16 (406.4) | 23.5 (596.9) | 21.25 (539.8) |
| 450 | 18 (457.2) | 25 (635) | 22.75 (577.9) |
| 500 | 20 (508) | 27.5 (698.5) | 25 (635) |
| 550 | 22 (558.8) | - | - |
| 600 | 24 (609.6) | 32 (812.8) | 29.5 (749.3) |

1/ See ASME B16.5, flange dimensions,150 pound.

FIGURE 1. Expansion joint, single bellows, unreinforced.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:36Z
Check the source to verify that this is the current version before use.

NOTES:

1. Dimensions are in inches. Metric equivalents are given for information only.
2. The illustration is for identification purposes only and is not intended to restrict designs and shapes of fastening devices, which conform to the requirements and are within the envelope dimensions.

FIGURE 1. Expansion joint, single bellows, unreinforced – Continued.

REQUIREMENTS:

Design and construction:

Dimensions and configuration: See figure 1.

Construction: Corrugated bellows, single, unreinforced expansion joints shall be formed by one of the methods described in the EJMA Standards. Sizes up to and including 10 inches shall be formed from seamless tubing or from a tube having only a longitudinal welded seam. For sizes larger than 10 inches, more than one longitudinal welded seam is permissible. In no case will circumferential seams be accepted on formed corrugated bellows unless the requirements of a particular application require construction and the design is approved by the procuring organization. Corrugations shall be symmetrical and of similar dimensions.

The classification of the expansion joints covered under this specification sheet are as follows:


Type I - shall have corrugated bellows.

Class 1 - shall have a single bellows.

Materials and finishes.

Materials and finishes for the bellows and flanges shall be in accordance with MIL-DTL-17813.

The Part or Identifying Number (PIN) consists of the letters M, the basic specification number, specification sheet number, size, type, class, pressure rating, and end connection.

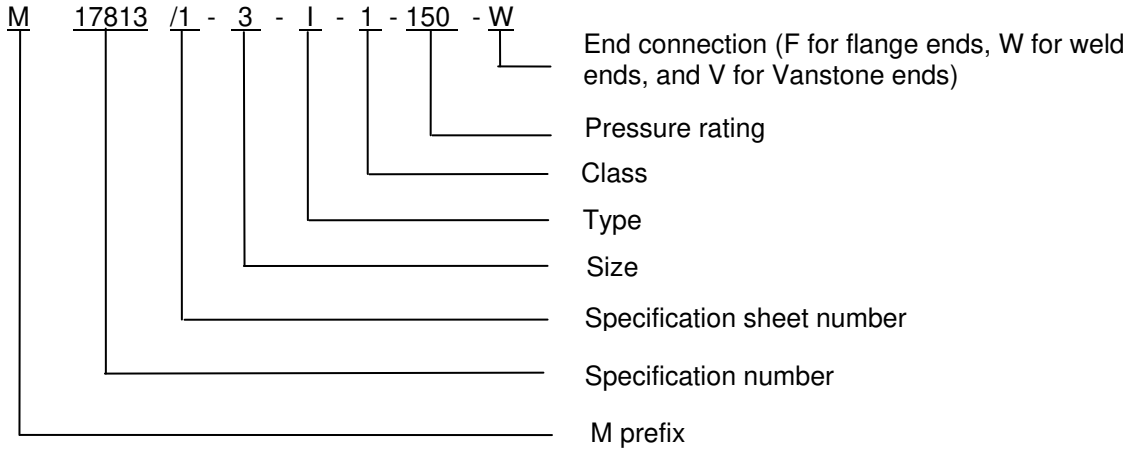


PIN example: M17813/1-3-I-1-150-W



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:36Z
Check the source to verify that this is the current version before use.

Referenced documents. In addition to MIL-DTL-17813, this document references the following:

ASME B16.5
EJMA Standards

CONCLUDING MATERIAL

Custodians:
Army - AT
Navy - SH
Air Force - 99
DLA - CC

Preparing activity:
DLA - CC

(Project 4730-2009-099)

Review activities:
Army - CE
Navy – MC, SA
Air Force - 71

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:36Z
Check the source to verify that this is the current version before use.