W-C-375/10A
September 12, 1980
SUPERSEDING
W-C 375/10
July 22, 1975

FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

# CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, SINGLE POLE

(15 THROUGH 100 AMPERES)

The complete requirements for procuring the circuit breakers described herein shall consist of this document and the latest issue of Federal Specification W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

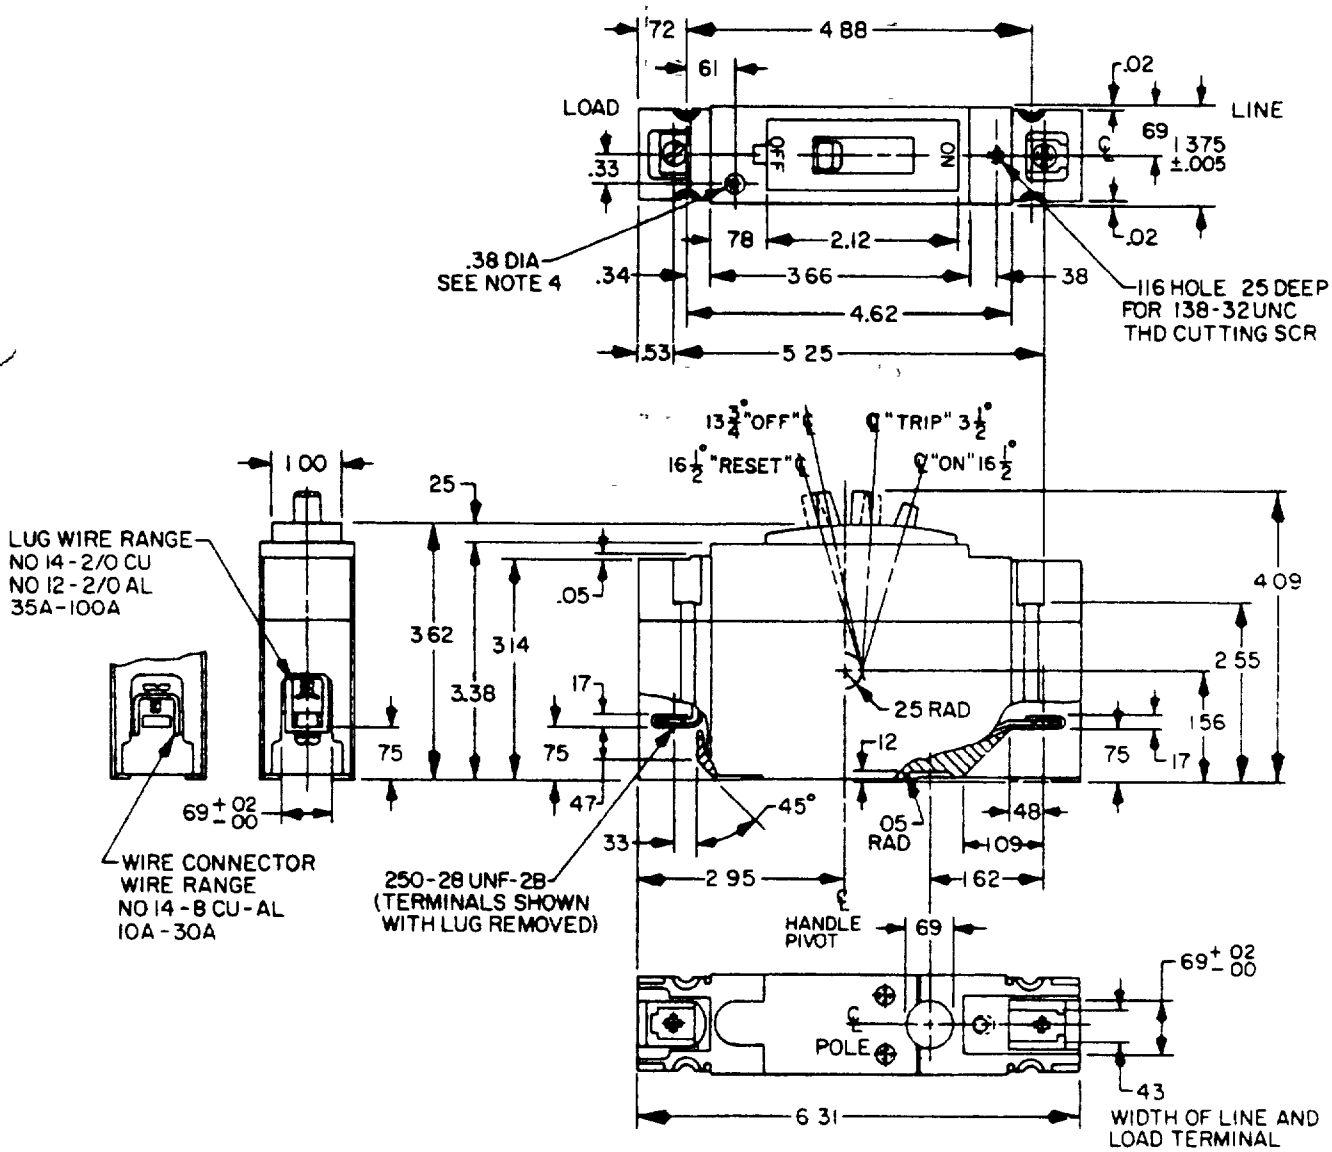



FIGURE 1



FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

| INCHES | MM | INCHES | MM | INCHES | MM | INCHES | MM | INCHES | MM |
|---|---|---|---|---|---|---|---|---|---|
| .005 | .13 | .33 | 8.4 | .69 | 17.5 | 1.62 | 41.1 | 4.09 | 103 9 |
| 02 | 5 | .34 | 8.6 | .72 | 18.3 | 2 12 | 53.8 | 4.62 | 117.3 |
| .05 | 1.3 | .38 | 9.7 | .75 | 19.0 | 2.55 | 64.8 | 4.88 | 124.0 |
| .116 | 2.95 | .43 | 10.9 | .78 | 19.8 | 2.95 | 74.9 | 5.25 | 133 4 |
| 12 | 3.0 | .47 | 11.9 | 1.00 | 25.4 | 3.14 | 79.8 | 6 31 | 160.3 |
| .138 | 3.51 | .48 | 12.2 | 1 09 | 27.7 | 3.38 | 85.9 | | |
| 17 | 4.3 | .53 | 13.5 | 1.375 | 34.2 | 3.62 | 91.9 | | |
| .250 | 6.35 | .61 | 15.5 | 1.56 | 39.6 | 3 66 | 93.0 | | |

NOTES.
1. Dimensions are in inches
2 Metric equivalents are given for general information only and are based upon 1.00 inch = 25.4 mm.
3 Unless otherwise specified, tolerances are ±.02 (.5 mm) on decimals and ±1° on angles
4. Twist to trip button.
5 Line and load terminals furnished with circuit breaker.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Design and construction - See figure 1.

Trip indication - See figure 1.

Mounting - See figure 1.

Electrical:

Interrupting current rating - See table I.

Voltage rating - See table I.

Current rating - See table I

Frequency - 60 hertz.

Calibration - At 40°C.

Enclosure for overload, endurance, and short circuit tests - General Electric Catalog No. TE100S/F, or equivalent.

Supersession data: See table II.

TABLE I. Part numbers and current rating

| Government part number | Current rating | Voltage rating | Interrupting current rating |
|---|---|---|---|
| WC375/10-002 | 15 | 120 Vac | 7,500 |
| -003 | 20 | 120 Vac | 10,000 |
| -004 | 25 | 120 Vac | 10,000 |
| -005 | 30 | 120 Vac | 10,000 |
| -006 | 35 | 120 Vac | 10,000 |
| -007 | 40 | 120 Vac | 10,000 |
| -008 | 45 | 120 Vac | 10,000 |
| -009 | 50 | 120 Vac | 10,000 |
| -010 | 60 | 120 Vac | 10,000 |
| -011 | 70 | 120/240 Vac | 5,000 |
| -012 | 80 | 120/240 Vac | 5,000 |
| -013 | 90 | 120/240 Vac | 5,000 |
| -014 | 100 | 120/240 Vac | 5,000 |

TABLE II. Supersession and cross reference

| Government part number | Commercial equivalent | Will replace numbers FSCM 24446 | | | |
|---|---|---|---|---|---|
| WC375/10-002 | TEB111015WL | TEB111015 | TE111015WL | TE111015 | TE1015 |
| -003 | 020 | 020 | 020 | 020 | TE1020 |
| -004 | 025 | 025 | 025 | 025 | |
| -005 | 030 | 030 | 030 | 030 | TE1030 |
| -006 | 035 | 035 | 035 | 035 | |
| -007 | 040 | 040 | 040 | 040 | TE1040 |
| -008 | 045 | 045 | 045 | 045 | |
| -009 | 050 | 050 | 050 | 050 | TE1050 |
| -010 | 060 | 060 | 060 | 060 | |
| -011 | 070 | 070 | 070 | 070 | |
| -012 | 080 | 080 | 080 | 080 | |
| -013 | 090 | 090 | 090 | 090 | |
| -014 | 100 | 100 | 100 | 100 | |



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:
Navy - YD
Air Force - 85

Review activities:
Air Force - 99
DLA - ES

User activities
Navy - OS, MC

Civil Agency Coordinating Activities:
DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HEW - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - DMS

Preparing activity.
DLA - ES

Project No. 5925-0390-5

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein.



Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.