FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)

CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND SERVICE, TYPE I, SERIES TRIP, TWO POLE (15 THROUGH 100 AMPERES)

The complete requirements for procuring the circuit breakers described herein shall consist of this document and the latest issue of Federal Specification W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

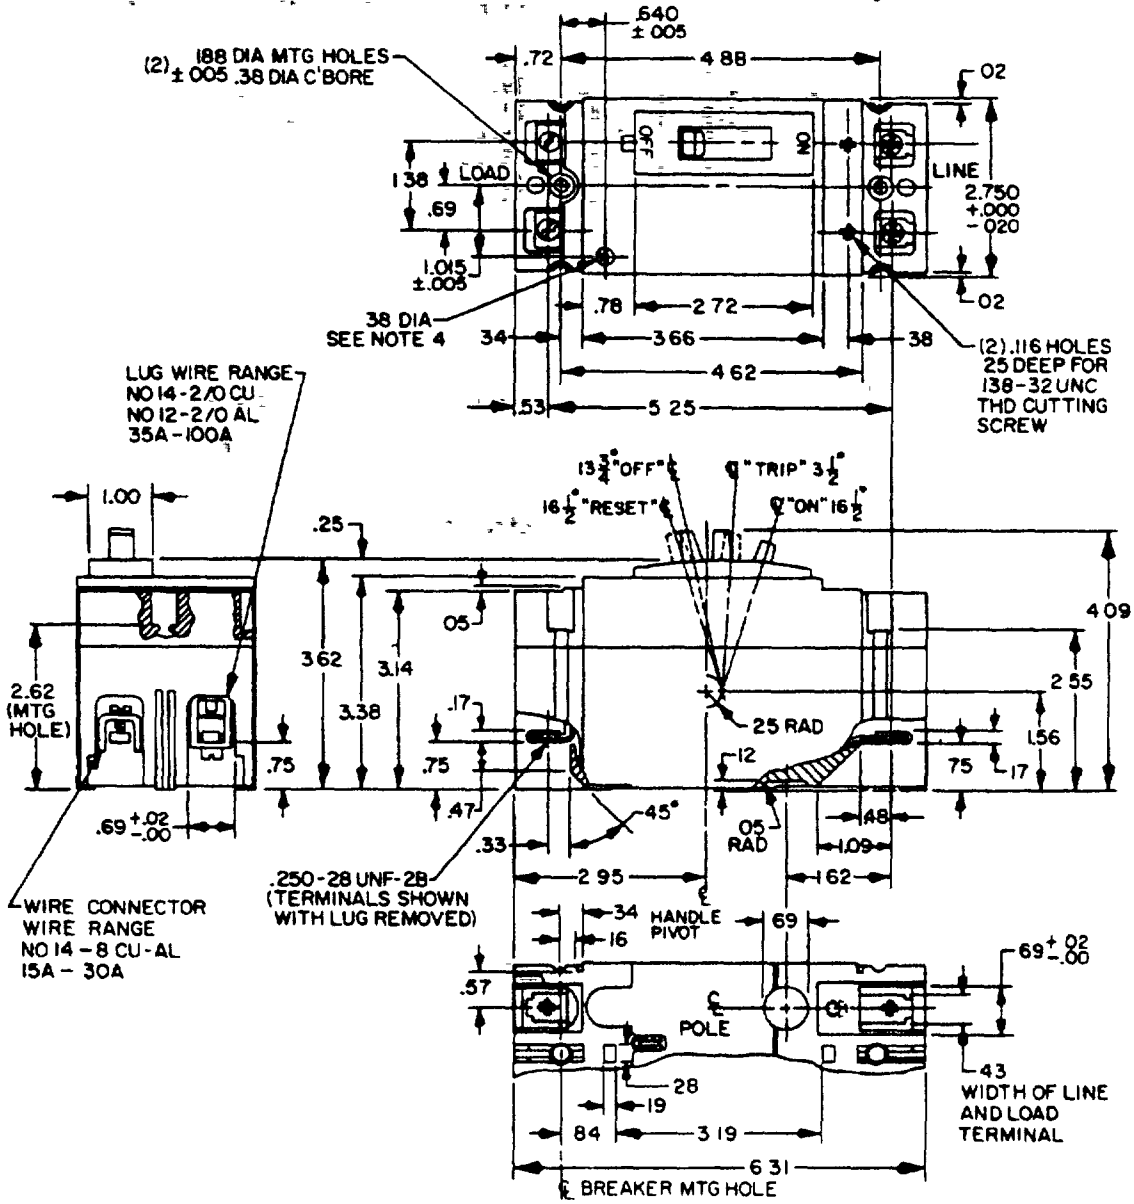


FIGURE 1.

FSC 5925

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

INCHES	MM	INCHES	MM	INCHES	MM	INCHES	MM	INCHES	MM
005	.13	250	6.35	.640	16.26	1-56	39 6	3 62	91 9
.02	.5	.28	7.1	.69	17.5	1.62	41.1	3.66	93.0
05	1.3	.33	8.4	.72	18.3	2.55	64.8	4.09	103.9
.116	2.95	.34	8.6	.75	19.0	2.62	66.5	4.62	117 3
.12	3.0	.38	9.7	.78	19 8	2 72	69.1	4.88	124.0
138	3 51	43	10.9	.84	21.3	2.750	69.85	5.25	133.4
16	4.1	.47	11.9	1.00	25.4	2.95	74.9	6.31	160 3
.17	4.3	.48	12.2	1.015	25.78	3.14	79.8		
188	4.78	.53	13.5	1.09	27 7	3 19	81 0		
19	4.8	.57	14.5	1.38	35 1	3.38	85.9		

NOTES
1. Dimensions are in inches.
2. Metric equivalents are given for general information only and are based upon 1.00 inch = 25.4 mm.
3. Unless otherwise specified, tolerances are ± 02 (.5 mm) on decimals and $\pm 1^{0}$ on angles.
4. Twist to trip button.
5. Line and load terminals furnished with circuit breaker.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction - See figure 1.

Trip indication - See figure 1.

Common trip - All poles shall make and break simultaneously when operated manually or automatically.

Mounting - See figure 1.

Electrical:

Interrupting current rating - RMS symmetrical - 10,000 amperes.

Voltage rating - 240 Vac maximum.

Current rating - See table I

Frequency - 60 hertz.

Calibration - At 40°C.

Enclosure for overload, endurance, and short circuit tests - General Electric Catalog No TE100S/F, or equivalent.

Supersession data See table II.

TABLE I. Part numbers and current rating

Government part number	Current rating
WC375/11-002	15
-003	20
-004	25
-005	30
-006	35
-007	40
-008	45
-009	50
-010	60
-011	70
-012	80
-013	90
-014	100

TABLE II. Supersession and cross reference

Government part number	Commercial equivalent	Will replace numbers FSCM 24446		
WC375/11-002	TEB122015WL	TEB122015	TE122015	TE122015WL
-003	020	020	020	020
-004	025	025	025	025
-005	030	030	030	030
-006	035	035	035	035
-007	040	040	040	040
-008	045	045	045	045
-009	050	050	050	050
-010	060	060	060	060
-011	070	070	070	070
-012	080	080	080	080
-013	090	090	090	090
-014	100	100	100	100

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:
Navy - YD
Air Force - 85

Review activities:
Air Force - 99
DLA - ES

User activities
Navy - OS, MC

Civil Agency Coordinating Activities:
DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HEW - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - DMS

Preparing activity
DLA - ES

Project No. 5925-0390-6

U.S. GOVERNMENT PRINTING OFFICE : 1981 - 341-705/1201

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.