FEDERAL SPECIFICATION SHEET

(DETAIL SPECIFICATION)


CIRCUIT BREAKERS, MOLDED CASE, BRANCH CIRCUIT AND

SERVICE, TYPE I, SERIES TRIP, TWO POLE

(15 THRU 125 AMPERES)

The complete requirements for procuring the circuit breakers described herein shall consist of this document and the latest issue of Specification W-C-375.

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

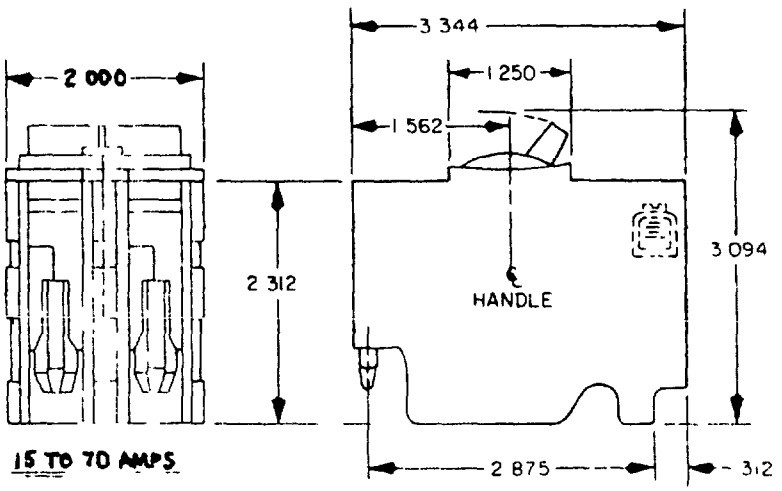

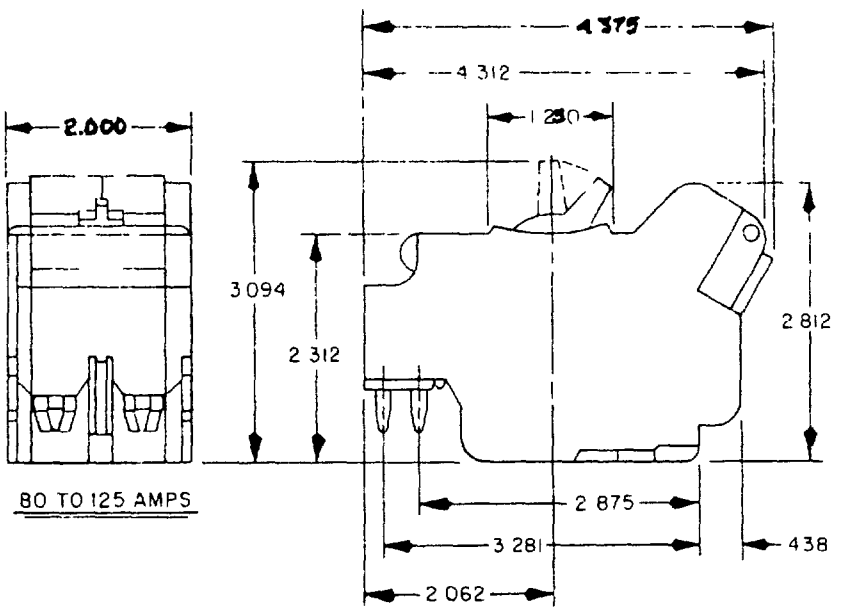


FIGURE 1

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

INCHES	MM	INCHES	MM
312	7 92	2.812	71.42
438	11 13	2 875	73.03
1 250	31 75	3 094	78.59
1.562	39 67	3 281	83.34
2.000	50 80	3 344	84.94
2 062	52 37	4.312	109.52
2.312	58 72	4 375	111.13

NOTES
1 Dimensions are in inches
2 Metric equivalents (to the nearest 01 mm) are given for general information only and are based upon 1 inch - 25 4 mm
3 Tolerance is ± 010 (25 mm).
4. Lug sizes 15 thru 50A 14 thru #4 60 thru 70A #4 thru #2, 80 thru 100A #4 thru 1 0 125A #6-2 0 terminals shall be suitable for aluminum (AL) or copper (CU) wire

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Design and construction - See figure
Trip indication - See figure
Common trip - All poles shall make and break simultaneously when operated manually or automatically

Electrical
Interrupting current rating - RMS symmetrical - 10,000 amperes
Voltage rating - 120/240 Vac
Trip current - See table I
Frequency - 60 hertz
Calibration - At 40°C

Enclosure for overload, endurance, and short circuit tests - 15 thru 30 ampere breakers, Federal Pacific Electric Catalog No 102-F/S, 35 thru 50 ampere breakers, Catalog No 102-4F/S, 60 thru 100 ampere breakers, Catalog No 104-8F/S, 125 ampere breakers, Catalog No 128-40, or equivalent

TABLE I Part numbers and current rating

Government part number	Current rating
WC375/14-001	15
-002	20
-003	25
-004	30
-005	35
-006	40
-007	45
-008	50
-009	60
-010	70
-011	80
-012	90
-013	100
-014	125

TABLE II Supersession and cross reference

Government part number	Superseded number		Will replace number		
	FSCM 21810				
WC375/14-001	215	NA215	215H	NAH215	NAH215H
-002	220	220	220	220	220
-003	225	225	225	225	225
-004	230	230	230	230	230
-005	235	235	235	235	235
-006	240	240	240	240	240
-007	245	245	245	245	245
-008	250	250	250	250	250
-009	2P60	2P60	2P60H	NAH2P60H	NAH2P60H
-010	2P70	2P70	2P70	2P70	2P70
-011	2P80	2P80	2P80	2P80	2P80
-012	2P90	2P90	2P90	2P90	2P90
-013	2P100	2P100	2P100	2P100	2P100
-014	2P125	2P125	2P125	2P125	2P125

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.

MILITARY CUSTODIANS:

Navy - YD
Air Force - 85

Review activities:

Air Force - 80
DSA - ES

User activities:

Navy - OS, MC

Civil Agency Coordinating Activity:

DC GOVT - DCG
GSA - FSS, PCD, PBO
DOT - ACO
HEW - FEC
HUD - TCS
Interior - BPA
Justice - FPI
Postal - POS
VA - DMS

Preparing activity:

DSA - ES

Project No. 5925-0091-14

Orders for this publication are to be placed with General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of the general specification to obtain extra copies and other documents referenced herein. Price 25 cents each.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T11:26Z
Check the source to verify that this is the current version before use.